



**COMMONWEALTH OF PENNSYLVANIA  
DEPARTMENT OF ENVIRONMENTAL PROTECTION  
AIR QUALITY PROGRAM**

**STATE ONLY NATURAL MINOR OPERATING PERMIT**

Issue Date: March 24, 2026

Effective Date: March 24, 2026

Expiration Date: February 28, 2031

In accordance with the provisions of the Air Pollution Control Act, the Act of January 8, 1960, P.L. 2119, as amended, and 25 Pa. Code Chapter 127, the Owner, [and Operator if noted] (hereinafter referred to as permittee) identified below is authorized by the Department of Environmental Protection (Department) to operate the air emission source(s) more fully described in this permit. This Facility is subject to all terms and conditions specified in this permit. Nothing in this permit relieves the permittee from its obligations to comply with all applicable Federal, State and Local laws and regulations.

The regulatory or statutory authority for each permit condition is set forth in brackets. All terms and conditions in this permit are federally enforceable unless otherwise designated.

**State Only Permit No: 43-00356**

Natural Minor

Federal Tax Id - Plant Code: 25-1662167-1

**Owner Information**

Name: HERMITAGE MUNI AUTH MERCER CNTY

Mailing Address: 2133 BROADWAY RD  
HERMITAGE, PA 16148-9009

**Plant Information**

Plant: HERMITAGE MUNI AUTH/HERMITAGE WPCP

Location: 43 Mercer County 43918 Hermitage City

SIC Code: 4952 Trans. & Utilities - Sewerage Systems

**Responsible Official**

Name: WAYNE COVERT

Title: MGR/SUPT

Phone: (724) 347 - 4941

Email: wcovert@hermitage.net

**Permit Contact Person**

Name: WAYNE COVERT

Title: MGR/SUPT

Phone: (724) 347 - 4941

Email: wcovert@hermitage.net

[Signature] \_\_\_\_\_

LORI L. MCNABB, NORTHWEST REGION AIR PROGRAM MANAGER



## SECTION A. Table of Contents

### Section A. Facility/Source Identification

Table of Contents  
Site Inventory List

### Section B. General State Only Requirements

- #001 Definitions.
- #002 Operating Permit Duration.
- #003 Permit Renewal.
- #004 Operating Permit Fees under Subchapter F.
- #005 Transfer of Operating Permits.
- #006 Inspection and Entry.
- #007 Compliance Requirements.
- #008 Need to Halt or Reduce Activity Not a Defense.
- #009 Duty to Provide Information.
- #010 Revising an Operating Permit for Cause.
- #011 Operating Permit Modifications
- #012 Severability Clause.
- #013 De Minimis Emission Increases.
- #014 Operational Flexibility.
- #015 Reactivation of Sources
- #016 Health Risk-based Emission Standards and Operating Practice Requirements.
- #017 Circumvention.
- #018 Reporting Requirements.
- #019 Sampling, Testing and Monitoring Procedures.
- #020 Recordkeeping.
- #021 Property Rights.
- #022 Alternative Operating Scenarios.
- #023 Prohibition of Air Pollution
- #024 Reporting
- #025 Report Format

### Section C. Site Level State Only Requirements

- C-I: Restrictions
- C-II: Testing Requirements
- C-III: Monitoring Requirements
- C-IV: Recordkeeping Requirements
- C-V: Reporting Requirements
- C-VI: Work Practice Standards
- C-VII: Additional Requirements
- C-VIII: Compliance Certification
- C-IX: Compliance Schedule

### Section D. Source Level State Only Requirements

- D-I: Restrictions
- D-II: Testing Requirements
- D-III: Monitoring Requirements
- D-IV: Recordkeeping Requirements
- D-V: Reporting Requirements
- D-VI: Work Practice Standards
- D-VII: Additional Requirements

Note: These same sub-sections are repeated for each source!

### Section E. Source Group Restrictions



## SECTION A. Table of Contents

- E-I: Restrictions
- E-II: Testing Requirements
- E-III: Monitoring Requirements
- E-IV: Recordkeeping Requirements
- E-V: Reporting Requirements
- E-VI: Work Practice Standards
- E-VII: Additional Requirements

### Section F. Alternative Operating Scenario(s)


- F-I: Restrictions
- F-II: Testing Requirements
- F-III: Monitoring Requirements
- F-IV: Recordkeeping Requirements
- F-V: Reporting Requirements
- F-VI: Work Practice Standards
- F-VII: Additional Requirements

### Section G. Emission Restriction Summary

### Section H. Miscellaneous



**SECTION A. Site Inventory List**

Source ID	Source Name	Capacity/Throughput	Fuel/Material
030	START UP BOILER (150 HP)	6.277 MMBTU/HR	
		9.808 MCF/HR	BIOGAS
		6.277 MCF/HR	Natural Gas
031	MISCELLANEOUS NATURAL GAS COMBUSTION	1.104 MMBTU/HR	
		1.104 MCF/HR	Natural Gas
105	EMERGENCY GENERATOR (1474 HP)	24.603 MMBTU/HR	
		177.000 Gal/HR	Diesel Fuel
106	COMBINED HEAT & POWER UNIT (CHP) (375-KW)	3.260 MMBTU/HR	
		3.263 MMBTU/HR	Special A
		N/A	Special A
107	768 BHP VOLVO TAD1631GE EMER GEN ENG SN 2160052565	38.620 Gal/HR	Diesel Fuel
C102	EMERGENCY FLARE (11,600 SCFH)		
C103	CHP GAS ABSORPTION MEDIA SCRUBBER		
FML01	NATURAL GAS SUPPLY		
FML02	BIOGAS SUPPLY		
FML03	DIESEL TANK		
S030	BOILER STACK		
S031	MISCELLANEOUS NATURAL GAS COMBUSTION STACK		
S102	FLARE STACK		
S105	EMERGENCY GENERATOR STACK		
S106	CHP UNIT STACK		
S107	EMERGENCY GENERATOR STACK		

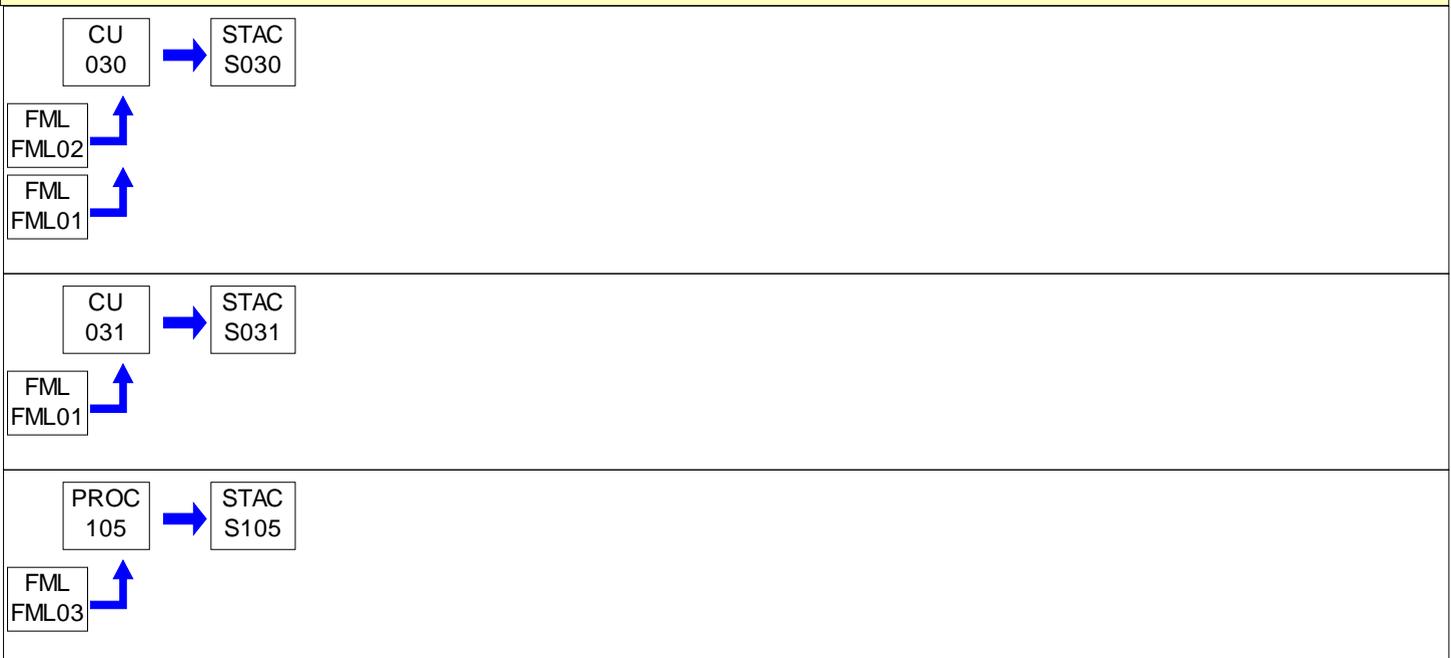**PERMIT MAPS**



### PERMIT MAPS

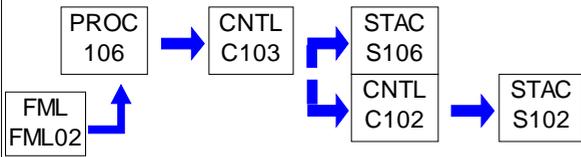

**SECTION B. General State Only Requirements****#001 [25 Pa. Code § 121.1]****Definitions.**

Words and terms that are not otherwise defined in this permit shall have the meanings set forth in Section 3 of the Air Pollution Control Act (35 P.S. § 4003) and in 25 Pa. Code § 121.1.

**#002 [25 Pa. Code § 127.446]****Operating Permit Duration.**

- (a) This operating permit is issued for a fixed term of five (5) years and shall expire on the date specified on Page 1 of this permit.
- (b) The terms and conditions of the expired permit shall automatically continue pending issuance of a new operating permit, provided the permittee has submitted a timely and complete application and paid applicable fees required under 25 Pa. Code Chapter 127, Subchapter I and the Department is unable, through no fault of the permittee, to issue or deny a new permit before the expiration of the previous permit.

**#003 [25 Pa. Code §§ 127.412, 127.413, 127.414, 127.446 & 127.703(b)]****Permit Renewal.**

- (a) The permittee shall submit a timely and complete application for renewal of the operating permit to the appropriate Regional Air Program Manager. The application for renewal of the operating permit shall be submitted at least six (6) months and not more than 18 months before the expiration date of this permit.
- (b) The application for permit renewal shall include the current permit number, a description of any permit revisions that occurred during the permit term, and any applicable requirements that were promulgated and not incorporated into the permit during the permit term. An application is complete if it contains sufficient information to begin processing the application, has the applicable sections completed and has been signed by a responsible official.
- (c) The permittee shall submit with the renewal application a fee for the processing of the application as specified in 25 Pa. Code § 127.703(b). The fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" and submitted with the fee form to the respective regional office.
- (d) The renewal application shall also include submission of proof that the local municipality and county, in which the facility is located, have been notified in accordance with 25 Pa. Code § 127.413.
- (e) The application for renewal of the operating permit shall also include submission of supplemental compliance review forms in accordance with the requirements of 25 Pa. Code § 127.412(b) and § 127.412(j).
- (f) The permittee, upon becoming aware that any relevant facts were omitted or incorrect information was submitted in the permit application, shall promptly submit such supplementary facts or corrected information as necessary to address any requirements that become applicable to the source after the permittee submits a complete application, but prior to the date the Department takes action on the permit application.

**#004 [25 Pa. Code § 127.703]****Operating Permit Fees under Subchapter F.**

- (a) The permittee shall pay the annual operating permit maintenance fee according to the following fee schedule in either paragraph (1) or (2) in accordance with 25 Pa. Code § 127.703(d) on or before December 31 of each year for the next calendar year.
- (1) For a synthetic minor facility, a fee equal to:
- (i) Four thousand dollars (\$4,000) for calendar years 2021—2025.
  - (ii) Five thousand dollars (\$5,000) for calendar years 2026—2030.
  - (iii) Six thousand three hundred dollars (\$6,300) for the calendar years beginning with 2031.
- (2) For a facility that is not a synthetic minor, a fee equal to:

**SECTION B. General State Only Requirements**

- (i) Two thousand dollars (\$2,000) for calendar years 2021—2025.
- (ii) Two thousand five hundred dollars (\$2,500) for calendar years 2026—2030.
- (iii) Three thousand one hundred dollars (\$3,100) for the calendar years beginning with 2031.

(b) The applicable fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" with the permit number clearly indicated and submitted to the respective regional office.

**#005 [25 Pa. Code §§ 127.450 (a)(4) and 127.464]****Transfer of Operating Permits.**

(a) This operating permit may not be transferred to another person, except in cases of transfer-of-ownership that are documented and approved by the Department.

(b) In accordance with 25 Pa. Code § 127.450(a)(4), a change in ownership of the source shall be treated as an administrative amendment if the Department determines that no other change in the permit is required and a written agreement has been submitted to the Department identifying the specific date of the transfer of permit responsibility, coverage and liability between the current and the new permittee and a compliance review form has been submitted to, and the permit transfer has been approved by, the Department.

(c) This operating permit is valid only for those specific sources and the specific source locations described in this permit.

**#006 [25 Pa. Code § 127.441 and 35 P.S. § 4008]****Inspection and Entry.**

(a) Upon presentation of credentials and other documents as may be required by law, the permittee shall allow the Department or authorized representatives of the Department to perform the following:

(1) Enter at reasonable times upon the permittee's premises where a source is located or emissions related activity is conducted, or where records are kept under the conditions of this permit;

(2) Have access to and copy, at reasonable times, any records that are kept under the conditions of this permit;

(3) Inspect at reasonable times, any facilities, equipment including monitoring and air pollution control equipment, practices, or operations regulated or required under this permit;

(4) Sample or monitor, at reasonable times, any substances or parameters, for the purpose of assuring compliance with the permit or applicable requirements as authorized by the Clean Air Act, the Air Pollution Control Act, or the regulations promulgated under the Acts.

(b) Pursuant to 35 P.S. § 4008, no person shall hinder, obstruct, prevent or interfere with the Department or its personnel in the performance of any duty authorized under the Air Pollution Control Act or regulations adopted thereunder including denying the Department access to a source at this facility. Refusal of entry or access may constitute grounds for permit revocation and assessment of criminal and/or civil penalties.

(c) Nothing in this permit condition shall limit the ability of the EPA to inspect or enter the premises of the permittee in accordance with Section 114 or other applicable provisions of the Clean Air Act.

**#007 [25 Pa. Code §§ 127.441 & 127.444]****Compliance Requirements.**

(a) The permittee shall comply with the conditions of this operating permit. Noncompliance with this permit constitutes a violation of the Clean Air Act and the Air Pollution Control Act and is grounds for one or more of the following:

- (1) Enforcement action

**SECTION B. General State Only Requirements**

(2) Permit termination, revocation and reissuance or modification

(3) Denial of a permit renewal application

(b) A person may not cause or permit the operation of a source which is subject to 25 Pa. Code Article III unless the source(s) and air cleaning devices identified in the application for the plan approval and operating permit and the plan approval issued for the source is operated and maintained in accordance with specifications in the applications and the conditions in the plan approval and operating permit issued by the Department. A person may not cause or permit the operation of an air contamination source subject to 25 Pa. Code Chapter 127 in a manner inconsistent with good operating practices.

(c) For purposes of Sub-condition (b) of this permit condition, the specifications in applications for plan approvals and operating permits are the physical configurations and engineering design details which the Department determines are essential for the permittee's compliance with the applicable requirements in this State-Only permit. Nothing in this sub-condition shall be construed to create an independent affirmative duty upon the permittee to obtain a predetermination from the Department for physical configuration or engineering design detail changes made by the permittee.

**#008 [25 Pa. Code § 127.441]****Need to Halt or Reduce Activity Not a Defense.**

It shall not be a defense for the permittee in an enforcement action that it was necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.

**#009 [25 Pa. Code §§ 127.442(a) & 127.461]****Duty to Provide Information.**

(a) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of each source at the facility.

(b) The permittee shall furnish to the Department, in writing, information that the Department may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit, or to determine compliance with the permit. Upon request, the permittee shall also furnish to the Department copies of records that the permittee is required to maintain in accordance with this permit.

**#010 [25 Pa. Code § 127.461]****Revising an Operating Permit for Cause.**

This operating permit may be terminated, modified, suspended or revoked and reissued if one or more of the following applies:

(1) The permittee constructs or operates the source subject to the operating permit so that it is in violation of the Air Pollution Control Act, the Clean Air Act, the regulations thereunder, a plan approval, a permit or in a manner that causes air pollution.

(2) The permittee fails to properly or adequately maintain or repair an air pollution control device or equipment attached to or otherwise made a part of the source.

(3) The permittee has failed to submit a report required by the operating permit or an applicable regulation.

(4) The EPA determines that the permit is not in compliance with the Clean Air Act or the regulations thereunder.

**#011 [25 Pa. Code §§ 127.450, 127.462, 127.465 & 127.703]****Operating Permit Modifications**

(a) The permittee is authorized to make administrative amendments, minor operating permit modifications and significant operating permit modifications, under this permit, as outlined below:

(b) Administrative Amendments. The permittee shall submit the application for administrative operating permit amendments (as defined in 25 Pa. Code § 127.450(a)), according to procedures specified in § 127.450 unless

**SECTION B. General State Only Requirements**

precluded by the Clean Air Act or its regulations.

(c) Minor Operating Permit Modifications. The permittee shall submit the application for minor operating permit modifications (as defined 25 Pa. Code § 121.1) in accordance with 25 Pa. Code § 127.462.

(d) Significant Operating Permit Modifications. The permittee shall submit the application for significant operating permit modifications in accordance with 25 Pa. Code § 127.465.

(e) The applicable fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" with the permit number clearly indicated and submitted to the respective regional office.

**#012 [25 Pa. Code § 127.441]****Severability Clause.**

The provisions of this permit are severable, and if any provision of this permit is determined by a court of competent jurisdiction to be invalid or unenforceable, such a determination will not affect the remaining provisions of this permit.

**#013 [25 Pa. Code § 127.449]****De Minimis Emission Increases.**

(a) This permit authorizes de minimis emission increases in accordance with 25 Pa. Code § 127.449 so long as the permittee provides the Department with seven (7) days prior written notice before commencing any de minimis emissions increase. The written notice shall:

(1) Identify and describe the pollutants that will be emitted as a result of the de minimis emissions increase.

(2) Provide emission rates expressed in tons per year and in terms necessary to establish compliance consistent with any applicable requirement.

(b) The Department may disapprove or condition de minimis emission increases at any time.

(c) Except as provided below in (d), the permittee is authorized to make de minimis emission increases (expressed in tons per year) up to the following amounts without the need for a plan approval or prior issuance of a permit modification:

(1) Four tons of carbon monoxide from a single source during the term of the permit and 20 tons of carbon monoxide at the facility during the term of the permit.

(2) One ton of NO<sub>x</sub> from a single source during the term of the permit and 5 tons of NO<sub>x</sub> at the facility during the term of the permit.

(3) One and six-tenths tons of the oxides of sulfur from a single source during the term of the permit and 8.0 tons of oxides of sulfur at the facility during the term of the permit.

(4) Six-tenths of a ton of PM<sub>10</sub> from a single source during the term of the permit and 3.0 tons of PM<sub>10</sub> at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(5) One ton of VOCs from a single source during the term of the permit and 5.0 tons of VOCs at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(6) Other sources and classes of sources determined to be of minor significance by the Department.

(d) In accordance with § 127.14, the permittee is authorized to install the following minor sources without the need for a plan approval or permit modification:

(1) Air conditioning or ventilation systems not designed to remove pollutants generated or released from other sources.

**SECTION B. General State Only Requirements**

- (2) Combustion units rated at 2,500,000 or less Btu per hour of heat input.
- (3) Combustion units with a rated capacity of less than 10,000,000 Btu per hour heat input fueled by natural gas supplied by a public utility or by commercial fuel oils which are No. 2 or lighter, viscosity less than or equal to 5.82 c St, and which meet the sulfur content requirements of 25 Pa. Code §123.22 (relating to combustion units). For purposes of this permit, commercial fuel oil shall be virgin oil which has no reprocessed, recycled or waste material added.
- (4) Space heaters which heat by direct heat transfer.
- (5) Laboratory equipment used exclusively for chemical or physical analysis.
- (6) Other sources and classes of sources determined to be of minor significance by the Department.
- (e) This permit does not authorize de minimis emission increases if the emissions increase would cause one or more of the following:
- (1) Increase the emissions of a pollutant regulated under Section 112 of the Clean Air Act except as authorized in Subparagraphs (c)(4) and (5) of this permit condition.
- (2) Subject the facility to the prevention of significant deterioration requirements in 25 Pa. Code Chapter 127, Subchapter D and/or the new source review requirements in Subchapter E.
- (3) Violate any applicable requirement of this permit, the Air Pollution Control Act, the Clean Air Act, or the regulations promulgated under either of the acts.
- (f) Emissions authorized under this permit condition shall be included in the monitoring, recordkeeping and reporting requirements of this permit.
- (g) Except for de minimis emission increases, installation of minor sources made pursuant to this permit condition and Plan Approval Exemptions under 25 Pa. Code § 127.14 (relating to exemptions), the permittee is prohibited from making changes or engaging in activities that are not specifically authorized under this permit without first applying for a plan approval. In accordance with § 127.14(b), a plan approval is not required for the construction, modification, reactivation, or installation of the sources creating the de minimis emissions increase.
- (h) The permittee may not meet de minimis emission threshold levels by offsetting emission increases or decreases at the same source.

**#014 [25 Pa. Code § 127.3]****Operational Flexibility.**

The permittee is authorized to make changes within the facility in accordance with the regulatory provisions outlined in 25 Pa. Code § 127.3 (relating to operational flexibility) to implement the operational flexibility requirements provisions authorized under Section 6.1(i) of the Air Pollution Control Act and the operational flexibility terms and conditions of this permit. The provisions in 25 Pa. Code Chapter 127 which implement the operational flexibility requirements include the following:

- (1) Section 127.14 (relating to exemptions)
- (2) Section 127.447 (relating to alternative operating scenarios)
- (3) Section 127.448 (relating to emissions trading at facilities with Federally enforceable emissions caps)
- (4) Section 127.449 (relating to de minimis emission increases)
- (5) Section 127.450 (relating to administrative operating permit amendments)
- (6) Section 127.462 (relating to minor operating permit modifications)
- (7) Subchapter H (relating to general plan approvals and general operating permits)

**SECTION B. General State Only Requirements****#015 [25 Pa. Code § 127.11a]****Reactivation of Sources**

- (a) The permittee may not reactivate a source that has been out of operation or production for at least one year unless the reactivation is conducted in accordance with a plan approval granted by the Department or in accordance with reactivation and maintenance plans developed and approved by the Department in accordance with 25 Pa. Code § 127.11a(a).
- (b) A source which has been out of operation or production for more than five (5) years but less than 10 years may be reactivated and will not be considered a new source if the permittee satisfies the conditions specified in 25 Pa. Code § 127.11a(b).

**#016 [25 Pa. Code § 127.36]****Health Risk-based Emission Standards and Operating Practice Requirements.**

- (a) When needed to protect public health, welfare and the environment from emissions of hazardous air pollutants from new and existing sources, the permittee shall comply with the health risk-based emission standards or operating practice requirements imposed by the Department, except as precluded by §§ 6.6(d)(2) and (3) of the Air Pollution Control Act [35 P.S. § 4006.6(d)(2) and (3)].
- (b) A person challenging a performance or emission standard established by the Department has the burden to demonstrate that performance or emission standard does not meet the requirements of Section 112 of the Clean Air Act.

**#017 [25 Pa. Code § 121.9]****Circumvention.**

No person may permit the use of a device, stack height which exceeds good engineering practice stack height, dispersion technique or other technique which, without resulting in reduction of the total amount of air contaminants emitted, conceals or dilutes an emission of air contaminants which would otherwise be in violation of 25 Pa. Code Article III, except that with prior approval of the Department, the device or technique may be used for control of malodors.

**#018 [25 Pa. Code §§ 127.402(d) & 127.442]****Reporting Requirements.**

- (a) The permittee shall comply with the applicable reporting requirements of the Clean Air Act, the regulations thereunder, the Air Pollution Control Act and 25 Pa. Code Article III including Chapters 127, 135 and 139.
- (b) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of any air contamination source.
- (c) Reports, test data, monitoring data, notifications and requests for renewal of the permit shall be submitted to the:
- Regional Air Program Manager  
PA Department of Environmental Protection  
(At the address given in the permit transmittal letter, or otherwise notified)
- (d) Any records or information including applications, forms, or reports submitted pursuant to this permit condition shall contain a certification by a responsible official as to truth, accuracy and completeness. The certifications submitted under this permit shall require a responsible official of the facility to certify that based on information and belief formed after reasonable inquiry, the statements and information in the documents are true, accurate and complete.
- (e) Any records, reports or information submitted to the Department shall be available to the public except for such records, reports or information which meet the confidentiality requirements of § 4013.2 of the Air Pollution Control Act and §§ 112(d) and 114(c) of the Clean Air Act. The permittee may not request a claim of confidentiality for any emissions data generated for the facility.

**SECTION B. General State Only Requirements****#019 [25 Pa. Code §§ 127.441(c) & 135.5]****Sampling, Testing and Monitoring Procedures.**

(a) The permittee shall comply with the monitoring, recordkeeping or reporting requirements of 25 Pa. Code Chapter 139 and the other applicable requirements of 25 Pa. Code Article III and additional requirements related to monitoring, reporting and recordkeeping required by the Clean Air Act and the regulations thereunder including the Compliance Assurance Monitoring requirements of 40 CFR Part 64, where applicable.

(b) Unless alternative methodology is required by the Clean Air Act and regulations adopted thereunder, sampling, testing and monitoring required by or used by the permittee to demonstrate compliance with any applicable regulation or permit condition shall be conducted in accordance with the requirements of 25 Pa. Code Chapter 139.

**#020 [25 Pa. Code §§ 127.441(c) and 135.5]****Recordkeeping.**

(a) The permittee shall maintain and make available, upon request by the Department, the following records of monitored information:

- (1) The date, place (as defined in the permit) and time of sampling or measurements.
- (2) The dates the analyses were performed.
- (3) The company or entity that performed the analyses.
- (4) The analytical techniques or methods used.
- (5) The results of the analyses.
- (6) The operating conditions as existing at the time of sampling or measurement.

(b) The permittee shall retain records of any required monitoring data and supporting information for at least five (5) years from the date of the monitoring, sample, measurement, report or application. Supporting information includes the calibration data and maintenance records and original strip-chart recordings for continuous monitoring instrumentation, and copies of reports required by the permit.

(c) The permittee shall maintain and make available to the Department upon request, records including computerized records that may be necessary to comply with the reporting, recordkeeping and emission statement requirements in 25 Pa. Code Chapter 135 (relating to reporting of sources). In accordance with 25 Pa. Code Chapter 135, § 135.5, such records may include records of production, fuel usage, maintenance of production or pollution control equipment or other information determined by the Department to be necessary for identification and quantification of potential and actual air contaminant emissions.

**#021 [25 Pa. Code § 127.441(a)]****Property Rights.**

This permit does not convey any property rights of any sort, or any exclusive privileges.

**#022 [25 Pa. Code § 127.447]****Alternative Operating Scenarios.**

The permittee is authorized to make changes at the facility to implement alternative operating scenarios identified in this permit in accordance with 25 Pa. Code § 127.447.

**#023 [25 Pa. Code § 121.7]****Prohibition of Air Pollution**

No person may permit air pollution as that term is defined in the Air Pollution Control Act (35 P.S. §§ 4001-4015).

**SECTION B. General State Only Requirements****#024 [25 Pa. Code §135.3]****Reporting**

(a) If the facility is a Synthetic Minor Facility, the permittee shall submit by March 1 of each year an annual emissions report for the preceding calendar year. The report shall include information for all active previously reported sources, new sources which were first operated during the preceding calendar year, and sources modified during the same period which were not previously reported. All air emissions from the facility should be estimated and reported.

(b) A source owner or operator of a Synthetic Minor Facility may request an extension of time from the Department for the filing of an annual emissions report, and the Department may grant the extension for reasonable cause.

**#025 [25 Pa. Code §135.4]****Report Format**

If applicable, the emissions reports shall contain sufficient information to enable the Department to complete its emission inventory. Emissions reports shall be made by the source owner or operator in a format specified by the Department.

**SECTION C. Site Level Requirements****I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.1]****Prohibition of certain fugitive emissions**

(a) No person may permit the emission into the outdoor atmosphere of a fugitive air contaminant from a source other than the following:

- (1) Construction or demolition of buildings or structures.
- (2) Grading, paving and maintenance of roads and streets.
- (3) Use of roads and streets. Emissions from material in or on trucks, railroad cars and other vehicular equipment are not considered as emissions from use of roads and streets.
- (4) Clearing of land.
- (5) Stockpiling of materials.
- (6) Open burning operations.
- (7) - (8) [Do not apply]
- (9) Sources and classes of sources other than those identified in paragraphs (1)—(8), for which the operator has obtained a determination from the Department that fugitive emissions from the source, after appropriate control, meet the following requirements:
  - (i) The emissions are of minor significance with respect to causing air pollution.
  - (ii) The emissions are not preventing or interfering with the attainment or maintenance of an ambient air quality standard.

(b) An application form for requesting a determination under either subsection (a)(9) or § 129.15(c) is available from the Department. In reviewing these applications, the Department may require the applicant to supply information including, but not limited to, a description of proposed control measures, characteristics of emissions, quantity of emissions and ambient air quality data and analysis showing the impact of the source on ambient air quality. The applicant is required to demonstrate that the requirements of subsections (a)(9) and (c) and § 123.2 [Condition #002, below] (relating to fugitive particulate matter) or of the requirements of § 129.15(c) have been satisfied. Upon such demonstration, the Department will issue a determination, in writing, either as an operating permit condition, for those sources subject to permit requirements under the act, or as an order containing appropriate conditions and limitations.

(c) [Printed under Work Practice Requirements in this section of permit.]

(d) [Does not apply]

**# 002 [25 Pa. Code §123.2]****Fugitive particulate matter**

A person may not permit fugitive particulate matter to be emitted into the outdoor atmosphere from a source specified in § 123.1(a)(1)—(9) [Condition #001, above] (relating to prohibition of certain fugitive emissions) if the emissions are visible at the point the emissions pass outside the person's property.

**# 003 [25 Pa. Code §123.31]****Limitations**

(a) [Printed under Work Practice Requirements in this section of permit.]

(b) A person may not permit the emission into the outdoor atmosphere of any malodorous air contaminants from any source, in such a manner that the malodors are detectable outside the property of the person on whose land the source is being operated.

**SECTION C. Site Level Requirements**

(c) [Does not apply]

**# 004 [25 Pa. Code §123.41]****Limitations**

A person may not permit the emission into the outdoor atmosphere of visible air contaminants in such a manner that the opacity of the emission is either of the following:

- (1) Equal to or greater than 20% for a period or periods aggregating more than 3 minutes in any 1 hour.
- (2) Equal to or greater than 60% at any time.

**# 005 [25 Pa. Code §123.42]****Exceptions**

The limitations of § 123.41 [Condition #004, above] (relating to limitations) shall not apply to a visible emission in any of the following instances:

- (1) When the presence of uncombined water is the only reason for failure of the emission to meet the limitations.
- (2) When the emission results from the operation of equipment used solely to train and test persons in observing the opacity of visible emissions.
- (3) When the emission results from sources specified in § 123.1 (a)(1)—(9) [Condition #001, above] (relating to prohibition of certain fugitive emissions).
- (4) [Does not apply]

**II. TESTING REQUIREMENTS.****# 006 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

The Department reserves the right to require exhaust stack testing of any source(s) as necessary to verify emissions for purposes including determining the correct emission fee, malfunctions, or determining compliance with any applicable requirements.

[Plan Approval 43-356A, Section C, Condition #005]

**# 007 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

[applies to Sources 105 and 106]

In accordance with 40 CFR 60.4243(b)(iii) and 60.4211(g)(3), Sources 105 and 106 shall conduct stack tests in accordance with the provisions of Chapter 139 of the Rules and Regulations of the Department of Environmental Protection. The stack tests are to be conducted every 8,760 hours or 3 years, whichever comes first, to demonstrate compliance. The stack test shall be performed while the aforementioned sources are operating at the maximum or normal rated capacity as stated on the application. For 106, the stack test shall be conducted for NO<sub>x</sub>, CO, and VOC using Department approved methods and in accordance with Subpart JJJJ. For 105, the stack test shall be conducted for NO<sub>x</sub> + NMHC, CO, VOC, and PM using Department approved methods and in accordance with Subpart IIII.

- (a) At least 90 calendar days prior to commencing an emissions testing program, a test protocol shall be submitted to the Department for review and approval in accordance with paragraph (i) of this condition. The test protocol shall meet all applicable requirements specified in the most current version of the Department's Source Testing Manual.
- (b) When testing of a source is required on a recurring basis, a single procedural protocol may be submitted for approval; thereafter, a letter, submitted at least 90 calendar days prior to commencing an emissions testing program, referencing the previously approved procedural protocol is sufficient if the letter is approved by the Department. The letter shall be

**SECTION C. Site Level Requirements**

submitted as required in paragraph (a). If modifications are made to the process(es), if a different stack testing company is used, or if an applicable section of the stack test manual has been revised since the approval, a new protocol shall be submitted for approval.

(c) Pursuant to 25 Pa. Code §§ 139.53(a)(1) and 139.53(a)(3):

(1) Submittals pertaining to emissions testing, specifically test protocols and test reports, shall be made by emailing electronic copies submissions to both PSIMS Administration in Central Office and to the Regional Office AQ Program at the following e-mail addresses:

CENTRAL OFFICE:  
RA-EPstacktesting@pa.gov

NORTHWEST REGIONAL OFFICE:  
RA-EPNWstacktesting@pa.gov

(2) The notifications of emissions testing dates shall be submitted directly to:

(i) the DEP's OnBase electronic upload website where it will be forwarded to the Northwest Regional Office Air Quality Inspector. Upload the written notification at this web address:

<https://www.dep.pa.gov/DataandTools/Pages/Application-Form-Upload.aspx>

(ii) IF the Protocol Reviewer at Central Office Division of Source Testing requested a copy of the notification, then submit a copy to the email address provided by the protocol reviewer.

(d) At least 15 calendar days prior to commencing an emission testing program, notification as to the date and time of testing shall be given to the Department in accordance with paragraph (c) of this condition. Notification shall not be made without prior receipt of a protocol acceptance letter from the Department.

(e) If the proposed testing did not occur per the required notification in paragraph (d) above, an electronic notification shall be sent within 15 calendar days after the expected completion date of the onsite testing to the Department, in accordance with paragraph (c) of this condition, indicating why the proposed completion date of the on-site testing was not adhered to.

(f) A complete test report shall be submitted to the Department no later than 60 calendar days after completion of the onsite testing portion of an emission test program.

(g) A complete test report shall include a summary of the emission results on the first page of the report indicating if each pollutant measured is within permitted limits and a statement of compliance or non-compliance with all applicable permit conditions. The summary results will include, at a minimum, the following information:

(1) A statement that the owner or operator has reviewed the report from the emissions testing body and agrees with the findings.

(2) Permit number(s) and condition(s) which are the basis for the evaluation.

(3) Summary of results with respect to each applicable permit condition.

(4) Statement of compliance or non-compliance with each applicable permit condition.

(h) Pursuant to 25 Pa. Code § 139.3, all submittals shall meet all applicable requirements specified in the most current version of the Department's Source Testing Manual.

(i) All testing shall be performed in accordance with the provisions of Chapter 139 of the Rules and Regulations of the Department of Environmental Protection.

**SECTION C. Site Level Requirements**

(j) The permittee shall ensure all federal reporting requirements contained in the applicable subpart of 40 CFR are followed, including timelines more stringent than those contained herein. In the event of an inconsistency or any conflicting requirements between state and the federal, the most stringent provision, term, condition, method or rule shall be used by default.

(k) Actions Related to Noncompliance Demonstrated by a Stack Test:

(1) If the results of a stack test, performed as required by this approval, exceed the level specified in any condition of this approval, the Permittee shall take appropriate corrective actions. Within 30 days of the Permittee receiving the stack test results, a written description of the corrective actions shall be submitted to the Department. The Permittee shall take appropriate action to minimize emissions from the affected facility while the corrective actions are being implemented. The Department shall notify the Permittee within 30 days, if the corrective actions taken are deficient. Within 30 days of receipt of the notice of deficiency, the Permittee shall submit a description of additional corrective actions to the Department. The Department reserves the authority to use enforcement activities to resolve noncompliant stack tests.

(2) If the results of the required stack test exceed any limit defined in this operating permit, the test was not performed in accordance with the stack test protocol or the source and/or air cleaning device was not operated in accordance with the operating permit, then another stack test shall be performed to determine compliance. Within 120 days of the Permittee receiving the original stack test results, a retest shall be performed. The Department may extend the retesting deadline if the Permittee demonstrates, to the Department's satisfaction, that retesting within 120 days is not practicable. Failure of the second test to demonstrate compliance with the limits in the operating permit, not performing the test in accordance with the stack test protocol or not operating the source and/or air cleaning device in accordance with the operating permit may be grounds for immediate revocation of the operating permit to operate the affected source.

**III. MONITORING REQUIREMENTS.**

**# 008 [25 Pa. Code §123.43]**

**Measuring techniques**

Visible emissions may be measured using either of the following:

- (1) A device approved by the Department and maintained to provide accurate opacity measurements.
- (2) Observers, trained and qualified to measure plume opacity with the naked eye or with the aid of devices approved by the Department.

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

**# 009 [25 Pa. Code §123.1]**

**Prohibition of certain fugitive emissions**

[From 25 Pa. Code § 123.1(c):]

(c) A person responsible for any source specified in subsections (a)(1)—(7) or (9) [Condition #001, above] shall take all reasonable actions to prevent particulate matter from becoming airborne. These actions include, but not be limited to, the following:

- (1) Use, where possible, of water or chemicals for control of dust in the demolition of buildings or structures, construction operations, the grading of roads or the clearing of land.

**SECTION C. Site Level Requirements**

(2) Application of asphalt, oil, water or suitable chemicals on dirt roads, material stockpiles and other surfaces which may give rise to airborne dusts.

(3) Paving and maintenance of roadways.

(4) Prompt removal of earth or other material from paved streets onto which earth or other material has been transported by trucking or earth moving equipment, erosion by water, or other means.

**# 010 [25 Pa. Code §123.31]****Limitations**

From 25 Pa. Code § 123.31(a):]

(a) Limitations are as follows:

(1) If control of malodorous air contaminants is required under subsection (b) [Condition #003, above], emissions shall be incinerated at a minimum of 1200°F for at least 0.3 second prior to their emission into the outdoor atmosphere.

(2) Techniques other than incineration may be used to control malodorous air contaminants if such techniques are equivalent to or better than the required incineration in terms of control of the odor emissions and are approved in writing by the Department.

**VII. ADDITIONAL REQUIREMENTS.****# 011 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

In the event that any Federal Subpart referenced in this permit is revised, the permittee shall comply with the revised version of the subpart, and shall not be required to comply with any provisions in this permit designated as having the subpart as their authority, to the extent that such permit provisions would be inconsistent with the applicable provisions of the revised subpart.

**# 012 [25 Pa. Code §129.14]****Open burning operations**

(a) [Does not apply]

(b) Outside of air basins. No person may permit the open burning of material in an area outside of air basins in a manner that:

(1) The emissions are visible, at any time, at the point such emissions pass outside the property of the person on whose land the open burning is being conducted.

(2) Malodorous air contaminants from the open burning are detectable outside the property of the person on whose land the open burning is being conducted.

(3) The emissions interfere with the reasonable enjoyment of life or property.

(4) The emissions cause damage to vegetation or property.

(5) The emissions are or may be deleterious to human or animal health.

(c) Exceptions. The requirements of subsections (a) and (b) do not apply where the open burning operations result from:

(1) A fire set to prevent or abate a fire hazard, when approved by the Department and set by or under the supervision of a public officer.

(2) Any fire set for the purpose of instructing personnel in fire fighting, when approved by the Department.

(3) A fire set for the prevention and control of disease or pests, when approved by the Department.

**SECTION C. Site Level Requirements**

(4) - (5) [Do not apply]

(6) A fire set solely for recreational or ceremonial purposes.

(7) A fire set solely for cooking food.

(d) Clearing and grubbing wastes. The following is applicable to clearing and grubbing wastes:

(1) As used in this subsection the following terms shall have the following meanings:

**Air curtain destructor**—A mechanical device which forcefully projects a curtain of air across a pit in which open burning is being conducted so that combustion efficiency is increased and smoke and other particulate matter are contained.

**Clearing and grubbing wastes**—Trees, shrubs and other native vegetation which are cleared from land during or prior to the process of construction. The term does not include demolition wastes and dirt laden roots.

(2) [Does not apply]

(3) Subsection (b) notwithstanding clearing and grubbing wastes may be burned outside of an air basin, subject to the following limitations:

(i) Upon receipt of a complaint or determination by the Department that an air pollution problem exists, the Department may order that the open burning cease or comply with subsection (b).

(ii) Authorization for open burning under this paragraph does not apply to clearing and grubbing wastes transported from an air basin for disposal outside of an air basin.

(4) During an air pollution episode, open burning is limited by Chapter 137 (relating to air pollution episodes) and shall cease as specified in that chapter.

[This permit does not constitute authorization to burn solid waste pursuant to Section 610(3) of the Solid Waste Management Act, 35 P.S. Section 6018.610(3), or any other provision of the Solid Waste Management Act.]

**VIII. COMPLIANCE CERTIFICATION.**

No additional compliance certifications exist except as provided in other sections of this permit including Section B (relating to State Only General Requirements).

**IX. COMPLIANCE SCHEDULE.**

#013 23-APR-26

Within 30 days of operating permit issuance, the permittee shall submit a protocol for initial stack testing of Source 106. The protocol shall meet the requirements of Section C, Condition #007. Stack testing shall be conducted within 30 days of protocol acceptance, unless otherwise approved by the DEP, in accordance with Section C, Condition #007 and §40 CFR 60.4244.

**SECTION D. Source Level Requirements**

Source ID: 030

Source Name: START UP BOILER (150 HP)

Source Capacity/Throughput:


6.277 MMBTU/HR

9.808 MCF/HR

BIOGAS

6.277 MCF/HR

Natural Gas

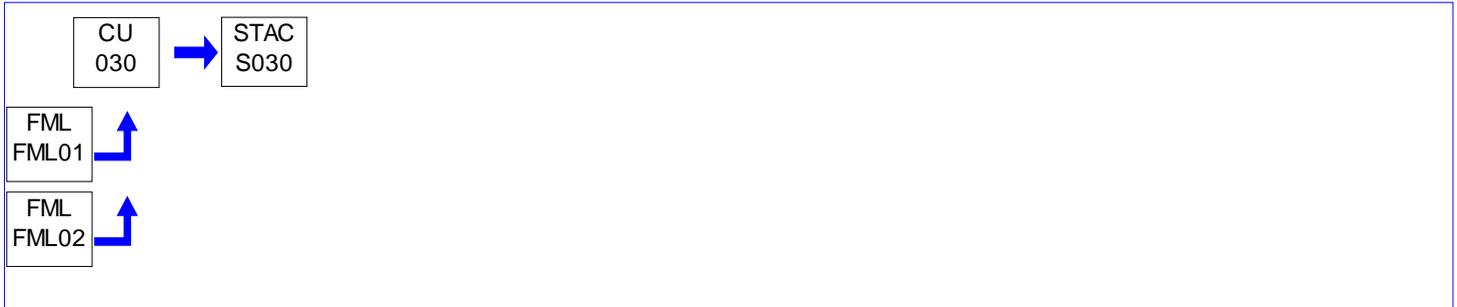**I. RESTRICTIONS.****Emission Restriction(s).**

# 001 [25 Pa. Code §123.11]

**Combustion units**

A person may not permit the emission into the outdoor atmosphere of particulate matter from this combustion unit in excess of the rate of 0.4 pound per million Btu of heat input, when the heat input to the combustion unit in millions of Btus per hour is greater than 2.5 but less than 50.

# 002 [25 Pa. Code §123.22]

**Combustion units**

No person may permit the emission into the outdoor atmosphere of sulfur oxides, expressed as SO<sub>2</sub>, from a combustion unit in excess of the rate of 4 pounds per million Btu of heat input over any 1-hour period.

**Fuel Restriction(s).**

# 003 [25 Pa. Code §127.12b]

**Plan approval terms and conditions.**

This source shall be fueled by natural gas or biogas only.

[Plan Approval 43-356A, Section D, Condition #003]

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

# 004 [25 Pa. Code §127.12b]

**Plan approval terms and conditions.**

(a) The owner or operator of each affected facility shall record and maintain records of operating hours and the amounts of each fuel combusted during each day for source 030.

(b) All records shall be maintained for at least five (5) years.

**SECTION D. Source Level Requirements**

[Plan Approval 43-356A, Section D, Condition #004]

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

**# 005 [25 Pa. Code §127.12b]**

**Plan approval terms and conditions.**

- (a) Natural gas and biogas fuel use will be metered.
- (b) This source will be operated in a manner consistent with good air pollution practices.
- (c) This source will be maintained according to manufacturer's specifications.

[Plan Approval 43-356A, Section D, Condition #005]

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION D. Source Level Requirements**

Source ID: 031

Source Name: MISCELLANEOUS NATURAL GAS COMBUSTION

Source Capacity/Throughput: 1.104 MMBTU/HR

1.104 MCF/HR Natural Gas

**I. RESTRICTIONS.****Emission Restriction(s).**

# 001 [25 Pa. Code §123.22]

**Combustion units**

A person may not permit the emission into the outdoor atmosphere of sulfur oxides, expressed as SO<sub>2</sub>, from a combustion unit in excess of the rate of 4 pounds per million Btu of heat input over a 1-hour period.

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION D. Source Level Requirements**


Source ID: 105

Source Name: EMERGENCY GENERATOR (1474 HP)

Source Capacity/Throughput: 24.603 MMBTU/HR

177.000 Gal/HR

Diesel Fuel

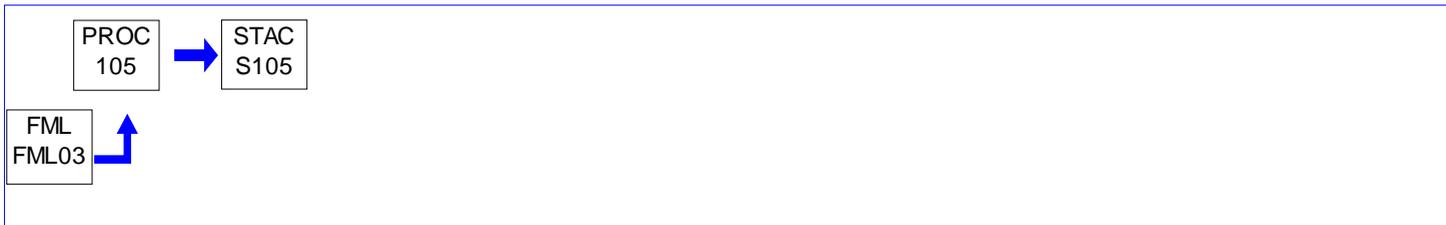**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.21]****General**

No person may permit the emission into the outdoor atmosphere of sulfur oxides from a source in a manner that the concentration of the sulfur oxides, expressed as SO<sub>2</sub>, in the effluent gas exceeds 500 parts per million, by volume, dry basis.

**# 002 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

The following emission limits apply to Source 105:

- (a) NO<sub>x</sub>: [Streamlined by 40 CFR 60.4205]
- (b) CO: 2.0 grams per brakehorsepower hour
- (c) VOC: 1.0 grams per brakehorsepower hour
- (d) PM: [Streamlined by 40 CFR 60.4205]

(These limits are from GP-9, which is considered BAT for this source.)

[Plan Approval 43-356B, Section D, Condition #001]

**# 003 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4205]****Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines****What emission standards must I meet for emergency engines if I am an owner or operator of a stationary CI internal co**

(a) [Does not apply]

(b) Owners and operators of 2007 model year and later emergency stationary CI ICE with a displacement of less than 30 liters per cylinder that are not fire pump engines must comply with the emission standards for new nonroad CI engines in §60.4202, for all pollutants, for the same model year and maximum engine power for their 2007 model year and later emergency stationary CI ICE.

[§ 60.4202 What emission standards must I meet for emergency engines if I am a stationary CI internal combustion engine manufacturer?]

(a) Stationary CI internal combustion engine manufacturers must certify their 2007 model year and later emergency stationary CI ICE with a maximum engine power less than or equal to 2,237 KW (3,000 HP) and a displacement of less than 10 liters per cylinder that are not fire pump engines to the emission standards specified in paragraphs (a)(1) through (2) of this section.

(1) [Does not apply]

**SECTION D. Source Level Requirements**

(2) For engines with a rated power greater than or equal to 37 KW (50 HP), the Tier 2 or Tier 3 emission standards for new nonroad CI engines for the same rated power as described in 40 CFR part 1039, appendix I, for all pollutants and the smoke standards as specified in 40 CFR 1039.105 beginning in model year 2007.

-----  
[Appendix I to Part 1039—Summary of Previous Emission Standards]

(a) [Does not apply]

(b) Tier 2 standards apply as summarized in the following table:

Table 2 to Appendix I—Tier 2 Emission Standards				
Rated power (kW)	Starting model year	NO <sub>x</sub> +NMHC	CO	PM
kW > 560	2006	6.4	*	0.20**

\*[Streamlined by BAT from GP-9]

\*\*[Streamlines process limit of 25 Pa. Code 123.13]

(c) [Does not apply]

(d) Tier 1 through Tier 3 standards applied only for discrete-mode steady-state testing. There were no not-to-exceed standards or transient testing.

[86 FR 34507, June 29, 2021, as amended at 88 FR 4660, Jan. 24, 2023]

-----  
§ 1039.105 What smoke opacity standards must my engines meet?

(a) The smoke opacity standards in this section apply to all engines subject to emission standards under this part, except for the following engines:

(1) - (3) [Do not apply]

(b) Measure smoke opacity as specified in § 1039.501(c). Smoke opacity from your engines may not exceed the following standards:

(1) 20 percent during the acceleration mode.

(2) 15 percent during the lugging mode.

(3) 50 percent during the peaks in either the acceleration or lugging modes.

[69 FR 39213, June 29, 2004, as amended at 88 FR 4658, Jan. 24, 2023]

-----  
(b) - (h) [Do not apply]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37968, June 28, 2011; 81 FR 44219, July 7, 2016; 86 FR 34358, June 29, 2021; 88 FR 4471, Jan. 24, 2023]

-----  
(c) - (d) [Do not apply]

(e) Owners and operators of emergency stationary CI ICE with a displacement of less than 30 liters per cylinder who conduct performance tests in-use must meet the NTE standards as indicated in §60.4212.

(f) [Does not apply]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011; 86 FR 34358, June 29, 2021]

**SECTION D. Source Level Requirements****Fuel Restriction(s).****# 004 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

The average sulfur content of the diesel fuel shall not exceed 0.0015% by weight based on a consecutive 12-month period. [This limit comes from 40 CFR §80.510(b), which took effect on June 1, 2010.]

[Plan Approval 43-356A, Section D, Condition #001]

**# 005 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4207]****Subpart IIII - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines****What fuel requirements must I meet if I am an owner or operator of a stationary CI internal combustion engine subject to**

(a) [Reserved]

(b) Beginning October 1, 2010, owners and operators of stationary CI ICE subject to this subpart with a displacement of less than 30 liters per cylinder that use diesel fuel must use diesel fuel that meets the requirements of 40 CFR 1090.305 for nonroad diesel fuel, except that any existing diesel fuel purchased (or otherwise obtained) prior to October 1, 2010, may be used until depleted.

-----  
[§ 1090.305 ULSD standards.]

(a) Overview. Except as specified in § 1090.300(a), diesel fuel must meet the ULSD per-gallon standards of this section.

(b) Sulfur standard. Maximum sulfur content of 15 ppm.

(c) Cetane index or aromatic content. Diesel fuel must meet one of the following standards:

(1) Minimum cetane index of 40.

(2) Maximum aromatic content of 35 volume percent.

-----  
(c) [Reserved]

(d) - (e) [Do not apply]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011; 78 FR 6695, Jan. 30, 2013; 85 FR 78463, Dec. 4, 2020]

**Operation Hours Restriction(s).****# 006 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

The hours of operation of Source 105 shall not exceed 100 hours in a 12-month rolling period.

[Plan Approval 43-356A, Section D, Condition #004]

**# 007 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4211]****Subpart IIII - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines****What are my compliance requirements if I am an owner or operator of a stationary CI internal combustion engine?**

[From 40 CFR §60.4211(f):]

(f) If you own or operate an emergency stationary ICE, you must operate the emergency stationary ICE according to the requirements in paragraphs (f)(1) through (3) of this section. In order for the engine to be considered an emergency stationary ICE under this subpart, any operation other than emergency operation, maintenance and testing, and operation in non-emergency situations for 50 hours per year, as described in paragraphs (f)(1) through (3), is prohibited. If you do not operate the engine according to the requirements in paragraphs (f)(1) through (3), the engine will not be considered an emergency engine under this subpart and must meet all requirements for non-emergency engines.

**SECTION D. Source Level Requirements**

(1) [Streamlined by Condition #006, above]

(2) You may operate your emergency stationary ICE for the purpose specified in paragraph (f)(2)(i) of this section for a maximum of 100 hours per calendar year. Any operation for non-emergency situations as allowed by paragraph (f)(3) of this section counts as part of the 100 hours per calendar year allowed by this paragraph (f)(2).

(i) Emergency stationary ICE may be operated for maintenance checks and readiness testing, provided that the tests are recommended by federal, state or local government, the manufacturer, the vendor, the regional transmission organization or equivalent balancing authority and transmission operator, or the insurance company associated with the engine. The owner or operator may petition the Administrator for approval of additional hours to be used for maintenance checks and readiness testing, but a petition is not required if the owner or operator maintains records indicating that federal, state, or local standards require maintenance and testing of emergency ICE beyond 100 hours per calendar year.

(ii) - (iii) [Reserved]

(3) Emergency stationary ICE may be operated for up to 50 hours per calendar year in non-emergency situations. The 50 hours of operation in non-emergency situations are counted as part of the 100 hours per calendar year for maintenance and testing provided in paragraph (f)(2) of this section. Except as provided in paragraph (f)(3)(i) of this section, the 50 hours per calendar year for non-emergency situations cannot be used for peak shaving or non-emergency demand response, or to generate income for a facility to an electric grid or otherwise supply power as part of a financial arrangement with another entity.

(i) [Does not apply]

(ii) [Reserved]

**II. TESTING REQUIREMENTS.****# 008 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4212]****Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines****What test methods and other procedures must I use if I am an owner or operator of a stationary CI internal combustion engine with a displacement of less than 30 liters per cylinder?**

Owners and operators of stationary CI ICE with a displacement of less than 30 liters per cylinder who conduct performance tests pursuant to this subpart must do so according to paragraphs (a) through (e) of this section.

(a) The performance test must be conducted according to the in-use testing procedures in 40 CFR part 1039, subpart F, for stationary CI ICE with a displacement of less than 10 liters per cylinder, and according to 40 CFR part 1042, subpart F, for stationary CI ICE with a displacement of greater than or equal to 10 liters per cylinder and less than 30 liters per cylinder. Alternatively, stationary CI ICE that are complying with Tier 2 or Tier 3 emission standards as described in 40 CFR part 1039, appendix I, or with Tier 2 emission standards as described in 40 CFR part 1042, appendix I, may follow the testing procedures specified in § 60.4213, as appropriate.

(b) Exhaust emissions from stationary CI ICE that are complying with the emission standards for new CI engines in 40 CFR part 1039 must not exceed the not-to-exceed (NTE) standards for the same model year and maximum engine power as required in 40 CFR 1039.101(e) and 40 CFR 1039.102(g)(1), except as specified in 40 CFR 1039.104(d). This requirement starts when NTE requirements take effect for nonroad diesel engines under 40 CFR part 1039.

(c) Exhaust emissions from stationary CI ICE subject to Tier 2 or Tier 3 emission standards as described in 40 CFR part 1039, appendix I, or Tier 2 emission standards as described in 40 CFR part 1042, appendix I, must not exceed the NTE numerical requirements, rounded to the same number of decimal places as the applicable standard, determined from the following equation:

$$\text{NTE requirement for each pollutant} = (1.25) * (\text{STD}) \quad (\text{Equation 1})$$

Where:

STD = The standard specified for that pollutant in 40 CFR part 1039 or 1042, as applicable.

**SECTION D. Source Level Requirements**

(d) [Does not apply]

(e) Exhaust emissions from stationary CI ICE that are complying with the emission standards for new CI engines in 40 CFR part 1042 must not exceed the NTE standards for the same model year and maximum engine power as required in 40 CFR 1042.101(c).

[71 FR 39172, July 11, 2006, as amended at 76 FR 37971, June 28, 2011; 86 FR 34359, June 29, 2021]

**III. MONITORING REQUIREMENTS.**

**# 009 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4209]**

**Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines**

**What are the monitoring requirements if I am an owner or operator of a stationary CI internal combustion engine?**

If you are an owner or operator, you must meet the monitoring requirements of this section. In addition, you must also meet the monitoring requirements specified in §60.4211.

(a) If you are an owner or operator of an emergency stationary CI internal combustion engine that does not meet the standards applicable to non-emergency engines, you must install a non-resettable hour meter prior to startup of the engine.

(b) [Does not apply]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011]

**IV. RECORDKEEPING REQUIREMENTS.**

**# 010 [25 Pa. Code §127.12b]**

**Plan approval terms and conditions.**

(a) The permittee shall maintain monthly records of the following.

- (1) Times the source is operated (hours, date and duration of each time the engine is operated);
- (2) Reason the source was operated;
- (3) Diesel fuel consumption;
- (4) Average sulfur content of the diesel fuel.

(b) The facility shall keep a record of the date of the electrical interruption, the cause of the electrical interruption and the duration of the electrical interruption.

(c) The permittee shall, at a minimum, obtain one of the following:

- (1) A fuel analysis of the btu value and sulfur content (% by weight), conducted on each shipment received as prescribed in 25 PA Code Chapter 139;
- (2) Written certification from the fuel supplier, signed by a responsible official, which certifies the aforesaid fuel characteristics for each shipment delivered to the facility.

[Plan Approval 43-356A, Section D, Condition #008]

**# 011 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4214]**

**Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines**

**What are my notification, reporting, and recordkeeping requirements if I am an owner or operator of a stationary CI internal combustion engine?**

(a) [Does not apply]

**SECTION D. Source Level Requirements**

(b) If the stationary CI internal combustion engine is an emergency stationary internal combustion engine, the owner or operator is not required to submit an initial notification. Starting with the model years in table 5 to this subpart, if the emergency engine does not meet the standards applicable to non-emergency engines in the applicable model year, the owner or operator must keep records of the operation of the engine in emergency and non-emergency service that are recorded through the non-resettable hour meter. The owner must record the time of operation of the engine and the reason the engine was in operation during that time.

(c) - (d) [Do not apply]

(e) Owners or operators of stationary CI ICE equipped with AECs pursuant to the requirements of 40 CFR 1039.665 must report the use of AECs as required by 40 CFR 1039.665(e).

[71 FR 39172, July 11, 2006, as amended at 78 FR 6696, Jan. 30, 2013; 81 FR 44219, July 7, 2016; 87 FR 48606, Aug. 10, 2022]

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.****# 012 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

(a) The permittee shall maintain and operate the source in accordance with the manufacturer's specifications and in accordance with good air pollution control practices. A copy of the manufacturer's preventative maintenance specifications shall be maintained on site and provided to the Department as requested.

(b) Source 105 shall only be used during electrical failures or to perform preventative maintenance. The emergency generator shall not be used to supplement the primary power supply to the facility.

[Plan Approval 43-356A, Section D, Condition #010]

**# 013 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4206]****Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines****How long must I meet the emission standards if I am an owner or operator of a stationary CI internal combustion engine?**

Owners and operators of stationary CI ICE must operate and maintain stationary CI ICE that achieve the emission standards as required in §§60.4204 and 60.4205 over the entire life of the engine.

[76 FR 37969, June 28, 2011]

**# 014 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4211]****Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines****What are my compliance requirements if I am an owner or operator of a stationary CI internal combustion engine?**

(a) If you are an owner or operator and must comply with the emission standards specified in this subpart, you must do all of the following, except as permitted under paragraph (g) of this section:

(1) Operate and maintain the stationary CI internal combustion engine and control device according to the manufacturer's emission-related written instructions;

(2) Change only those emission-related settings that are permitted by the manufacturer; and

(3) Meet the requirements of 40 CFR part 1068, as they apply to you.

(b) - (e) [Do not apply]

**SECTION D. Source Level Requirements**

(f) [Printed under Restrictions in this section of the permit.]

(g) If you do not install, configure, operate, and maintain your engine and control device according to the manufacturer's emission-related written instructions, or you change emission-related settings in a way that is not permitted by the manufacturer, you must demonstrate compliance as follows:

(1) - (2) [Do not apply]

(3) If you are an owner or operator of a stationary CI internal combustion engine greater than 500 HP, you must keep a maintenance plan and records of conducted maintenance and must, to the extent practicable, maintain and operate the engine in a manner consistent with good air pollution control practice for minimizing emissions. In addition, you must conduct an initial performance test to demonstrate compliance with the applicable emission standards within 1 year of startup, or within 1 year after an engine and control device is no longer installed, configured, operated, and maintained in accordance with the manufacturer's emission-related written instructions, or within 1 year after you change emission-related settings in a way that is not permitted by the manufacturer. You must conduct subsequent performance testing every 8,760 hours of engine operation or 3 years, whichever comes first, thereafter to demonstrate compliance with the applicable emission standards.

(h) The requirements for operators and prohibited acts specified in 40 CFR 1039.665 apply to owners or operators of stationary CI ICE equipped with AECDs for qualified emergency situations as allowed by 40 CFR 1039.665.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37970, June 28, 2011; 78 FR 6695, Jan. 30, 2013; 81 FR 44219, July 7, 2016; 86 FR 34359, June 29, 2021; 87 FR 48605, Aug. 10, 2022]

**VII. ADDITIONAL REQUIREMENTS.****# 015 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4200]****Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines****Am I subject to this subpart?**

(a) The provisions of this subpart are applicable to manufacturers, owners, and operators of stationary compression ignition (CI) internal combustion engines (ICE) as specified in paragraphs (a)(1) through (3) of this section. For the purposes of this subpart, the date that construction commences is the date the engine is ordered by the owner or operator.

(1) [Does not apply]

(2) Owners and operators of stationary CI ICE that commence construction after July 11, 2005 where the stationary CI ICE are:

(i) Manufactured after April 1, 2006 and are not fire pump engines

(ii) [Does not apply]

(3) - (4) [Do not apply]

(b) [Does not apply]

(c) If you are an owner or operator of an area source subject to this subpart, you are exempt from the obligation to obtain a permit under 40 CFR part 70 or 40 CFR part 71, provided you are not required to obtain a permit under 40 CFR 70.3(a) or 40 CFR 71.3(a) for a reason other than your status as an area source under this subpart. Notwithstanding the previous sentence, you must continue to comply with the provisions of this subpart applicable to area sources.

(d) - (e) [Do not apply]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37967, June 28, 2011; 86 FR 34357, June 29, 2021]

**SECTION D. Source Level Requirements****# 016 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4218]  
Subpart IIII - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines  
What parts of the General Provisions apply to me?**

(a) Table 8 to this subpart shows which parts of the General Provisions in §§ 60.1 through 60.19 apply to you. [Refer to Table 8 of Subpart IIII for General Provisions.]

(b) The provisions of 40 CFR 1068.10 and 1068.11 apply for engine manufacturers. For others, the general confidential business information (CBI) provisions apply as described in 40 CFR part 2.

[88 FR 4471, Jan. 24, 2023]

**# 017 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4219]  
Subpart IIII - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines  
What definitions apply to this subpart?**

[Refer to 40 CFR §60.4219 for definitions applicable to Subpart IIII.]

**SECTION D. Source Level Requirements**

Source ID: 106

Source Name: COMBINED HEAT &amp; POWER UNIT (CHP) (375-KW)

Source Capacity/Throughput:

3.260 MMBTU/HR

3.263 MMBTU/HR

Special A

N/A

Special A

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.13]****Processes**

No person may permit the emission into the outdoor atmosphere of particulate matter from this process in a manner that the concentration of particulate matter in the effluent gas exceeds .04 grain per dry standard cubic foot, when the effluent gas volume is less than 150,000 dry standard cubic feet per minute.

**# 002 [25 Pa. Code §123.21]****General**

No person may permit the emission into the outdoor atmosphere of sulfur oxides from a source in a manner that the concentration of the sulfur oxides, expressed as SO<sub>2</sub>, in the effluent gas exceeds 500 parts per million, by volume, dry basis.

**# 003 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

(a) The flare shall be operated with no visible emissions except for periods not to exceed a total of 5 minutes during any two consecutive hours. The opacity of the emissions shall not be equal to or greater than 10% at any time.

(b) The particulate matter (PM) emissions for the flare shall not exceed 0.02 grain/dscf

[Plan Approval 43-356A, Section D, Condition #003]

**# 004 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4233]****Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines****What emission standards must I meet if I am an owner or operator of a stationary SI internal combustion engine?**

(a) - (d) [Do not apply]

(e) Owners and operators of stationary SI ICE with a maximum engine power greater than or equal to 75 KW (100 HP) (except gasoline and rich burn engines that use LPG) must comply with the emission standards in Table 1 to this subpart for their stationary SI ICE. [Non-applicable text omitted]

[Table 1 to Subpart JJJJ of Part 60]

Engine type and fuel	Maximum engine power	Manufacture date	Emission standards*					
			g/HP-hr			ppmvd at 15% O <sub>2</sub>		
Landfill/Digester Gas			NO <sub>x</sub>	CO	VOC**	NO <sub>x</sub>	CO	VOC**
Lean Burn	500=<HP<1,350	7/1/2010	2.0	5.0	1.0	150	610	80

\*[Owners and operators of stationary non-certified SI engines may choose to comply with the emission standards in units of either g/HP-hr or ppmvd at 15 percent O<sub>2</sub>.]

\*\*[For purposes of this subpart, when calculating emissions of volatile organic compounds, emissions of formaldehyde

**SECTION D. Source Level Requirements**

should not be included.]

[76 FR 37975, June 28, 2011]

-----  
 (f) - (h) [Do not apply]

[73 FR 3591, Jan. 18, 2008, as amended at 76 FR 37973, June 28, 2011]

**II. TESTING REQUIREMENTS.****# 005 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4244]****Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines****What test methods and other procedures must I use if I am an owner or operator of a stationary SI internal combustion engine?**

Owners and operators of stationary SI ICE who conduct performance tests must follow the procedures in paragraphs (a) through (f) of this section.

(a) Each performance test must be conducted within 10 percent of 100 percent peak (or the highest achievable) load and according to the requirements in § 60.8 and under the specific conditions that are specified by Table 2 to this subpart.

-----  
 [From Table 2 to Subpart JJJJ of Part 60 - Requirements for Performance Tests]

1. For each stationary SI internal combustion engine demonstrating compliance according to §60.4244 complying with the requirement to:

a. limit the concentration of NOX in the stationary SI internal combustion engine exhaust, you must:

i. Select the sampling port location and the number/location of traverse points at the exhaust of the stationary internal combustion engine;

ii. Determine the O2 concentration of the stationary internal combustion engine exhaust at the sampling port location;

iii. If necessary, determine the exhaust flowrate of the stationary internal combustion engine exhaust;

iv. If necessary, measure moisture content of the stationary internal combustion engine exhaust at the sampling port location; and

v. Measure NOX at the exhaust of the stationary internal combustion engine; if using a control device, the sampling site must be located at the outlet of the control device

Using:

(1) Method 1 or 1A of 40 CFR part 60, appendix A-1, if measuring flow rate

(2) Method 3, 3A, or 3B[b] of 40 CFR part 60, appendix A-2 or ASTM Method D6522-00 (Reapproved 2005)[a][d]

(3) Method 2 or 2C of 40 CFR part 60, appendix A-1 or Method 19 of 40 CFR part 60, appendix A-7

(4) Method 4 of 40 CFR part 60, appendix A-3, Method 320 of 40 CFR part 63, appendix A[e], or ASTM Method D6348-03[d][e]

(5) Method 7E of 40 CFR part 60, appendix A-4, ASTM Method D6522-00 (Reapproved 2005)[a][d], Method 320 of 40 CFR part 63, appendix A[e], or ASTM Method D6348-03[d][e]

According to the following requirements:

**SECTION D. Source Level Requirements**

(a) Alternatively, for NOX, O<sub>2</sub>, and moisture measurement, ducts =6 inches in diameter may be sampled at a single point located at the duct centroid and ducts >6 and =12 inches in diameter may be sampled at 3 traverse points located at 16.7, 50.0, and 83.3% of the measurement line ('3-point long line'). If the duct is >12 inches in diameter and the sampling port location meets the two and half-diameter criterion of Section 11.1.1 of Method 1 of 40 CFR part 60, Appendix A, the duct may be sampled at '3-point long line'; otherwise, conduct the stratification testing and select sampling points according to Section 8.1.2 of Method 7E of 40 CFR part 60, Appendix A.

(b) Measurements to determine O<sub>2</sub> concentration must be made at the same time as the measurements for NOX concentration.

(c) Measurements to determine the exhaust flowrate must be made (1) at the same time as the measurement for NOX concentration or, alternatively (2) according to the option in Section 11.1.2 of Method 1A of 40 CFR part 60, Appendix A-1, if applicable.

(d) Measurements to determine moisture must be made at the same time as the measurement for NOX concentration.

(e) Results of this test consist of the average of the three 1-hour or longer runs.

b. limit the concentration of CO in the stationary SI internal combustion engine exhaust, you must:

i. Select the sampling port location and the number/location of traverse points at the exhaust of the stationary internal combustion engine;

ii. Determine the O<sub>2</sub> concentration of the stationary internal combustion engine exhaust at the sampling port location;

iii. If necessary, determine the exhaust flowrate of the stationary internal combustion engine exhaust;

iv. If necessary, measure moisture content of the stationary internal combustion engine exhaust at the sampling port location; and

v. Measure CO at the exhaust of the stationary internal combustion engine; if using a control device, the sampling site must be located at the outlet of the control device

Using:

(1) Method 1 or 1A of 40 CFR part 60, appendix A-1, if measuring flow rate

(2) Method 3, 3A, or 3B[b] of 40 CFR part 60, appendix A-2 or ASTM Method D6522-00 (Reapproved 2005)[a][d]

(3) Method 2 or 2C of 40 CFR 60, appendix A-1 or Method 19 of 40 CFR part 60, appendix A-7

(4) Method 4 of 40 CFR part 60, appendix A-3, Method 320 of 40 CFR part 63, appendix A[e], or ASTM Method D6348-03[d][e]

(5) Method 10 of 40 CFR part 60, appendix A4, ASTM Method D6522-00 (Reapproved 2005)[a][d][e], Method 320 of 40 CFR part 63, appendix A[e], or ASTM Method D6348-03[d][e]

According to the following requirements:

(a) Alternatively, for CO, O<sub>2</sub>, and moisture measurement, ducts =6 inches in diameter may be sampled at a single point located at the duct centroid and ducts >6 and =12 inches in diameter may be sampled at 3 traverse points located at 16.7, 50.0, and 83.3% of the measurement line ('3-point long line'). If the duct is >12 inches in diameter and the sampling port location meets the two and half-diameter criterion of Section 11.1.1 of Method 1 of 40 CFR part 60, Appendix A, the duct may be sampled at '3-point long line'; otherwise, conduct the stratification testing and select sampling points according to Section 8.1.2 of Method 7E of 40 CFR part 60, Appendix A.

**SECTION D. Source Level Requirements**

(b) Measurements to determine O<sub>2</sub> concentration must be made at the same time as the measurements for CO concentration.

(c) Measurements to determine the exhaust flowrate must be made (1) at the same time as the measurement for CO concentration or, alternatively (2) according to the option in Section 11.1.2 of Method 1A of 40 CFR part 60, Appendix A-1, if applicable.

(d) Measurements to determine moisture must be made at the same time as the measurement for CO concentration.

(e) Results of this test consist of the average of the three 1-hour or longer runs.

c. limit the concentration of VOC in the stationary SI internal combustion engine exhaust, you must:

i. Select the sampling port location and the number/location of traverse points at the exhaust of the stationary internal combustion engine;

ii. Determine the O<sub>2</sub> concentration of the stationary internal combustion engine exhaust at the sampling port location;

iii. If necessary, determine the exhaust flowrate of the stationary internal combustion engine exhaust;

iv. If necessary, measure moisture content of the stationary internal combustion engine exhaust at the sampling port location; and

v. Measure VOC at the exhaust of the stationary internal combustion engine; if using a control device, the sampling site must be located at the outlet of the control device

Using:

(1) Method 1 or 1A of 40 CFR part 60, appendix A-1, if measuring flow rate

(2) Method 3, 3A, or 3B[b] of 40 CFR part 60, appendix A-2 or ASTM Method D6522-00 (Reapproved 2005)[a][d]

(3) Method 2 or 2C of 40 CFR 60, appendix A-1 or Method 19 of 40 CFR part 60, appendix A-7

(4) Method 4 of 40 CFR part 60, appendix A-3, Method 320 of 40 CFR part 63, appendix A[e], or ASTM Method D6348-03[d][e]

(5) Methods 25A and 18 of 40 CFR part 60, appendices A-6 and A-7, Method 25A with the use of a hydrocarbon cutter as described in 40 CFR 1065.265, Method 18 of 40 CFR part 60, appendix A-6[c][e], Method 320 of 40 CFR part 63, appendix A[e], or ASTM Method D6348-03[d][e]

According to the following requirements:

(a) Alternatively, for VOC, O<sub>2</sub>, and moisture measurement, ducts =6 inches in diameter may be sampled at a single point located at the duct centroid and ducts >6 and =12 inches in diameter may be sampled at 3 traverse points located at 16.7, 50.0, and 83.3% of the measurement line ('3-point long line'). If the duct is >12 inches in diameter and the sampling port location meets the two and half-diameter criterion of Section 11.1.1 of Method 1 of 40 CFR part 60, Appendix A, the duct may be sampled at '3-point long line'; otherwise, conduct the stratification testing and select sampling points according to Section 8.1.2 of Method 7E of 40 CFR part 60, Appendix A.

(b) Measurements to determine O<sub>2</sub> concentration must be made at the same time as the measurements for VOC concentration.

(c) Measurements to determine the exhaust flowrate must be made (1) at the same time as the measurement for VOC concentration or, alternatively (2) according to the option in Section 11.1.2 of Method 1A of 40 CFR part 60, Appendix A-1, if applicable.

**SECTION D. Source Level Requirements**

(d) Measurements to determine moisture must be made at the same time as the measurement for VOC concentration.

(e) Results of this test consist of the average of the three 1-hour or longer runs.

**Notes:**

[a] Also, you may petition the Administrator for approval to use alternative methods for portable analyzer.

[b] You may use ASME PTC 19.10-1981, Flue and Exhaust Gas Analyses, for measuring the O<sub>2</sub> content of the exhaust gas as an alternative to EPA Method 3B. AMSE PTC 19.10-1981 incorporated by reference, see 40 CFR 60.17

[c] You may use EPA Method 18 of 40 CFR part 60, appendix A-6, provided that you conduct an adequate pre-survey test prior to the emissions test, such as the one described in OTM 11 on EPA's Web site (<http://www.epa.gov/ttn/emc/prelim/otm11.pdf>).

[d] Incorporated by reference; see 40 CFR 60.17.

[e] You must meet the requirements in §60.4245(d).

[85 FR 63408, Oct. 7, 2020]

(b) You may not conduct performance tests during periods of startup, shutdown, or malfunction, as specified in § 60.8(c). If your stationary SI internal combustion engine is non-operational, you do not need to startup the engine solely to conduct a performance test; however, you must conduct the performance test immediately upon startup of the engine.

(c) You must conduct three separate test runs for each performance test required in this section, as specified in § 60.8(f). Each test run must be conducted within 10 percent of 100 percent peak (or the highest achievable) load and last at least 1 hour.

(d) To determine compliance with the NO<sub>x</sub> mass per unit output emission limitation, convert the concentration of NO<sub>x</sub> in the engine exhaust using Equation 1 of this section:

$$ER = (Cd \times 1.912 \times 10^{-3} \times Q \times T) / (HP\text{-hr}) \quad (\text{Eq. 1})$$

Where:

ER = Emission rate of NO<sub>x</sub> in g/HP-hr.

Cd = Measured NO<sub>x</sub> concentration in parts per million by volume (ppmv).

$1.912 \times 10^{-3}$  = Conversion constant for ppm NO<sub>x</sub> to grams per standard cubic meter at 20 degrees Celsius.

Q = Stack gas volumetric flow rate, in standard cubic meter per hour, dry basis.

T = Time of test run, in hours.

HP-hr = Brake work of the engine, horsepower-hour (HP-hr).

(e) To determine compliance with the CO mass per unit output emission limitation, convert the concentration of CO in the engine exhaust using Equation 2 of this section:

$$ER = (Cd \times 1.164 \times 10^{-1} \times Q \times T) / (HP\text{-hr}) \quad (\text{Eq. 2})$$

Where:

ER = Emission rate of CO in g/HP-hr.

Cd = Measured CO concentration in ppmv.

$1.164 \times 10^{-1}$  = Conversion constant for ppm CO to grams per standard cubic meter at 20 degrees Celsius.

Q = Stack gas volumetric flow rate, in standard cubic meters per hour, dry basis.

T = Time of test run, in hours.

HP-hr = Brake work of the engine, in HP-hr.

(f) For purposes of this subpart, when calculating emissions of VOC, emissions of formaldehyde should not be included. To determine compliance with the VOC mass per unit output emission limitation, convert the concentration of VOC in the engine exhaust using Equation 3 of this section:

$$ER = (Cd \times 1.833 \times 10^{-1} \times Q \times T) / (HP\text{-hr}) \quad (\text{Eq. 3})$$

**SECTION D. Source Level Requirements**

Where:

ER = Emission rate of VOC in g/HP-hr.

Cd = VOC concentration measured as propane in ppmv.

$1.833 \times 10^{-3}$  = Conversion constant for ppm VOC measured as propane, to grams per standard cubic meter at 20 degrees Celsius.

Q = Stack gas volumetric flow rate, in standard cubic meters per hour, dry basis.

T = Time of test run, in hours.

HP-hr = Brake work of the engine, in HP-hr.

(g) If the owner/operator chooses to measure VOC emissions using either Method 18 of 40 CFR part 60, appendix A, or Method 320 of 40 CFR part 63, appendix A, then it has the option of correcting the measured VOC emissions to account for the potential differences in measured values between these methods and Method 25A. The results from Method 18 and Method 320 can be corrected for response factor differences using Equations 4 and 5 of this section. The corrected VOC concentration can then be placed on a propane basis using Equation 6 of this section.

$$RF_i = CM_i / CA_i \quad (\text{Eq. 4})$$

Where:

RF<sub>i</sub> = Response factor of compound i when measured with EPA Method 25A.

CM<sub>i</sub> = Measured concentration of compound i in ppmv as carbon.

CA<sub>i</sub> = True concentration of compound i in ppmv as carbon.

$$C_{i\text{corr}} = RF_i \times C_{i\text{meas}} \quad (\text{Eq. 5})$$

Where:

C<sub>i</sub>corr = Concentration of compound i corrected to the value that would have been measured by EPA Method 25A, ppmv as carbon.

C<sub>i</sub>meas = Concentration of compound i measured by EPA Method 320, ppmv as carbon.

$$C_{\text{Peq}} = 0.6098 \times C_{i\text{corr}} \quad (\text{Eq. 6})$$

Where:

C<sub>Peq</sub> = Concentration of compound i in mg of propane equivalent per DSCM.

**III. MONITORING REQUIREMENTS.****# 006 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

(a) Control device monitoring gauges shall be installed. Gauges shall be installed in accessible locations, and shall be maintained in workable, readable condition at all times.

(b) The permittee shall perform a daily operational inspection of the control devices.

[Plan Approval 43-356A, Section D, Condition #008 & 43-356D, Section D, Condition #012(b).]

**IV. RECORDKEEPING REQUIREMENTS.****# 007 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

(a) The permittee shall maintain a record of all preventative maintenance inspections of the control devices. These records shall, at a minimum, contain the dates of the inspections, any problems or defects, the actions taken to correct the problem or defects, and any routine maintenance performed.

(b) The permittee shall maintain records of the following from the daily operational inspections for the scrubber:

(1) Inlet pressure;

**SECTION D. Source Level Requirements**

(2) Pressure drop.

(c) The permittee shall keep all records for a period of five (5) years and make the records available to the DEP upon request.

[Plan Approval 43-356A, Section D, Condition #010(a), (b), & (f)]

**# 008 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4245]**

**Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines**

**What are my notification, reporting, and recordkeeping requirements if I am an owner or operator of a stationary SI internal combustion engine?**

(a) Owners and operators of all stationary SI ICE must keep records of the information in paragraphs (a)(1) through (4) of this section.

(1) All notifications submitted to comply with this subpart and all documentation supporting any notification.

(2) Maintenance conducted on the engine.

(3) [Does not apply]

(4) If the stationary SI internal combustion engine is not a certified engine or is a certified engine operating in a non-certified manner and subject to § 60.4243(a)(2), documentation that the engine meets the emission standards.

(b) [Does not apply]

(c) - (d) [Printed under Reporting Requirements in this section of permit.]

(e) [Does not apply]

(f) - (i) [Printed under Reporting Requirements in this section of permit.]

(j) Any records required to be maintained by this subpart that are submitted electronically via the EPA's CEDRI may be maintained in electronic format. This ability to maintain electronic copies does not affect the requirement for facilities to make records, data, and reports available upon request to a delegated air agency or the EPA as part of an on-site compliance evaluation.

[73 FR 3591, Jan. 18, 2008, as amended at 73 FR 59177, Oct. 8, 2008; 78 FR 6697, Jan. 30, 2013; 81 FR 59809, Aug. 30, 2016; 86 FR 34362, June 29, 2021; 87 FR 48606, Aug. 10, 2022; 89 FR 70514, Aug. 30, 2024]

**V. REPORTING REQUIREMENTS.**

**# 009 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4245]**

**Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines**

**What are my notification, reporting, and recordkeeping requirements if I am an owner or operator of a stationary SI internal combustion engine?**

[40 CFR § 60.4245(c)-(d) & (f)-(i):]

(c) Owners and operators of stationary SI ICE greater than or equal to 500 HP that have not been certified by an engine manufacturer to meet the emission standards in § 60.4231 must submit an initial notification as required in § 60.7(a)(1). The notification must include the information in paragraphs (c)(1) through (5) of this section. Beginning on February 26, 2025 submit the notification electronically according to paragraph (g) of this section.

(1) Name and address of the owner or operator;

(2) The address of the affected source;

**SECTION D. Source Level Requirements**

(3) Engine information including make, model, engine family, serial number, model year, maximum engine power, and engine displacement;

(4) Emission control equipment; and

(5) Fuel used.

(d) Owners and operators of stationary SI ICE that are subject to performance testing must submit a copy of each performance test as conducted in § 60.4244 within 60 days after the test has been completed. Performance test reports using EPA Method 18, EPA Method 320, or ASTM D6348-03 (incorporated by reference—see 40 CFR 60.17) to measure VOC require reporting of all QA/QC data. For Method 18, report results from sections 8.4 and 11.1.1.4; for Method 320, report results from sections 8.6.2, 9.0, and 13.0; and for ASTM D6348-03 report results of all QA/QC procedures in Annexes 1-7. Beginning on February 26, 2025, performance tests must be reported electronically according to paragraph (f) of this section.

(f) Beginning on February 26, 2025, within 60 days after the date of completing each performance test, you must submit the results following the procedures specified in paragraph (g) of this section. Data collected using test methods that are supported by the EPA's Electronic Reporting Tool (ERT) as listed on the EPA's ERT website (<https://www.epa.gov/electronic-reporting-air-emissions/electronic-reporting-tool-ert>) at the time of the test must be submitted in a file format generated using the EPA's ERT. Alternatively, you may submit an electronic file consistent with the extensible markup language (XML) schema listed on the EPA's ERT website. Data collected using test methods that are not supported by the EPA's ERT as listed on the EPA's ERT website at the time of the test must be included as an attachment in the ERT or an alternate electronic file.

(g) If you are required to submit notifications or reports following the procedure specified in this paragraph (g), you must submit notifications or reports to the EPA via the Compliance and Emissions Data Reporting Interface (CEDRI), which can be accessed through the EPA's Central Data Exchange (CDX) (<https://cdx.epa.gov/>). The EPA will make all the information submitted through CEDRI available to the public without further notice to you. Do not use CEDRI to submit information you claim as CBI. Although we do not expect persons to assert a claim of CBI, if you wish to assert a CBI claim for some of the information in the report or notification, you must submit a complete file in the format specified in this subpart, including information claimed to be CBI, to the EPA following the procedures in paragraphs (g)(1) and (2) of this section. Clearly mark the part or all of the information that you claim to be CBI. Information not marked as CBI may be authorized for public release without prior notice. Information marked as CBI will not be disclosed except in accordance with procedures set forth in 40 CFR part 2. All CBI claims must be asserted at the time of submission. Anything submitted using CEDRI cannot later be claimed CBI. Furthermore, under CAA section 114(c), emissions data is not entitled to confidential treatment, and the EPA is required to make emissions data available to the public. Thus, emissions data will not be protected as CBI and will be made publicly available. You must submit the same file submitted to the CBI office with the CBI omitted to the EPA via the EPA's CDX as described earlier in this paragraph (g).

(1) The preferred method to receive CBI is for it to be transmitted electronically using email attachments, File Transfer Protocol, or other online file sharing services. Electronic submissions must be transmitted directly to the OAQPS CBI Office at the email address [oaqpscbi@epa.gov](mailto:oaqpscbi@epa.gov), and as described in paragraph (g) of this section, should include clear CBI markings. ERT files should be flagged to the attention of the Group Leader, Measurement Policy Group; all other files should be flagged to the attention of the Stationary Spark Ignition Internal Combustion Engine Sector Lead. If assistance is needed with submitting large electronic files that exceed the file size limit for email attachments, and if you do not have your own file sharing service, please email [oaqpscbi@epa.gov](mailto:oaqpscbi@epa.gov) to request a file transfer link.

(2) If you cannot transmit the file electronically, you may send CBI information through the postal service to the following address: OAQPS Document Control Officer (C404-02), OAQPS, U.S. Environmental Protection Agency, 109 T.W. Alexander Drive, P.O. Box 12055, Research Triangle Park, North Carolina 27711. ERT files should be sent to the attention of the Group Leader, Measurement Policy Group, and all other files should be sent to the attention of the Stationary Spark Ignition Internal Combustion Engine Sector Lead. The mailed CBI material should be double wrapped and clearly marked. Any CBI markings should not show through the outer envelope.

(h) If you are required to electronically submit a report through CEDRI in the EPA's CDX, you may assert a claim of EPA system outage for failure to timely comply with that reporting requirement. To assert a claim of EPA system outage, you must

**SECTION D. Source Level Requirements**

meet the requirements outlined in paragraphs (h)(1) through (7) of this section.

(1) You must have been or will be precluded from accessing CEDRI and submitting a required report within the time prescribed due to an outage of either the EPA's CEDRI or CDX systems.

(2) The outage must have occurred within the period of time beginning five business days prior to the date that the submission is due.

(3) The outage may be planned or unplanned.

(4) You must submit notification to the Administrator in writing as soon as possible following the date you first knew, or through due diligence should have known, that the event may cause or has caused a delay in reporting.

(5) You must provide to the Administrator a written description identifying:

(i) The date(s) and time(s) when CDX or CEDRI was accessed and the system was unavailable;

(ii) A rationale for attributing the delay in reporting beyond the regulatory deadline to EPA system outage;

(iii) A description of measures taken or to be taken to minimize the delay in reporting; and

(iv) The date by which you propose to report, or if you have already met the reporting requirement at the time of the notification, the date you reported.

(6) The decision to accept the claim of EPA system outage and allow an extension to the reporting deadline is solely within the discretion of the Administrator.

(7) In any circumstance, the report must be submitted electronically as soon as possible after the outage is resolved.

(i) If you are required to electronically submit a report through CEDRI in the EPA's CDX, you may assert a claim of force majeure for failure to timely comply with that reporting requirement. To assert a claim of force majeure, you must meet the requirements outlined in paragraphs (i)(1) through (5) of this section.

(1) You may submit a claim if a force majeure event is about to occur, occurs, or has occurred or there are lingering effects from such an event within the period of time beginning five business days prior to the date the submission is due. For the purposes of this section, a force majeure event is defined as an event that will be or has been caused by circumstances beyond the control of the affected facility, its contractors, or any entity controlled by the affected facility that prevents you from complying with the requirement to submit a report electronically within the time period prescribed. Examples of such events are acts of nature (e.g., hurricanes, earthquakes, or floods), acts of war or terrorism, or equipment failure or safety hazard beyond the control of the affected facility (e.g., large scale power outage).

(2) You must submit notification to the Administrator in writing as soon as possible following the date you first knew, or through due diligence should have known, that the event may cause or has caused a delay in reporting.

(3) You must provide to the Administrator:

(i) A written description of the force majeure event;

(ii) A rationale for attributing the delay in reporting beyond the regulatory deadline to the force majeure event;

(iii) A description of measures taken or to be taken to minimize the delay in reporting; and

(iv) The date by which you propose to report, or if you have already met the reporting requirement at the time of the notification, the date you reported.

(4) The decision to accept the claim of force majeure and allow an extension to the reporting deadline is solely within the

**SECTION D. Source Level Requirements**

discretion of the Administrator.

(5) In any circumstance, the reporting must occur as soon as possible after the force majeure event occurs.

**VI. WORK PRACTICE REQUIREMENTS.****# 010 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

- (a) The flare shall be equipped with a continuous pilot ignition source using an auxiliary fuel.
- (b) The flare shall be operated with a flame present at all times, when the biogas pressure switch is open. The flare shall be equipped with an automatic shut-off mechanism designed to immediately stop the flow of gases when a flameout occurs. During restart or start-up, there shall be sufficient flow of auxiliary fuel to the burners such that unburnt biogas gases are not emitted to the atmosphere.
- (c) The permittee shall maintain a manometer or similar device to measure the pressure drop across the gas absorption media scrubber system.
- (d) The permittee shall maintain a thermocouple or similar device to measure outlet temperature of the gas absorption media scrubber.
- (e) The permittee shall operate the control devices at all times that the source is in operation.
- (f) The permittee shall maintain and operate the source and control devices in accordance with the manufacturers' specifications and in accordance with good air pollution control practices.

[Plan Approval 43-356A, Section D, Condition #013 and 43-356D, Section D, Condition #012(c)-(d) & (f)-(g)]

**# 011 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4234]****Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines****How long must I meet the emission standards if I am an owner or operator of a stationary SI internal combustion engine?**

Owners and operators of stationary SI ICE must operate and maintain stationary SI ICE that achieve the emission standards as required in § 60.4233 over the entire life of the engine.

**# 012 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4243]****Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines****What are my compliance requirements if I am an owner or operator of a stationary SI internal combustion engine?**

- (a) [Does not apply]
- (b) If you are an owner or operator of a stationary SI internal combustion engine and must comply with the emission standards specified in § 60.4233(d) or (e), you must demonstrate compliance according to one of the methods specified in paragraphs (b)(1) and (2) of this section.
- (1) [Does not apply]
- (2) Purchasing a non-certified engine and demonstrating compliance with the emission standards specified in § 60.4233(d) or (e) and according to the requirements specified in § 60.4244, as applicable, and according to paragraphs (b)(2)(i) and (ii) of this section.
- (i) [Does not apply]
- (ii) If you are an owner or operator of a stationary SI internal combustion engine greater than 500 HP, you must keep a maintenance plan and records of conducted maintenance and must, to the extent practicable, maintain and operate the engine in a manner consistent with good air pollution control practice for minimizing emissions. In addition, you must conduct an initial performance test and conduct subsequent performance testing every 8,760 hours or 3 years, whichever

**SECTION D. Source Level Requirements**

comes first, thereafter to demonstrate compliance.

(c) - (i) [Do not apply]

[73 FR 3591, Jan. 18, 2008, as amended at 76 FR 37974, June 28, 2011; 78 FR 6697, Jan. 30, 2013; 86 FR 34362, June 29, 2021; 87 FR 48606, Aug. 10, 2022]

**VII. ADDITIONAL REQUIREMENTS.****# 013 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4230]****Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines****Am I subject to this subpart?**

(a) The provisions of this subpart are applicable to manufacturers, owners, and operators of stationary spark ignition (SI) internal combustion engines (ICE) as specified in paragraphs (a)(1) through (6) of this section. For the purposes of this subpart, the date that construction commences is the date the engine is ordered by the owner or operator.

(1) - (3) [Do not apply]

(4) Owners and operators of stationary SI ICE that commence construction after June 12, 2006, where the stationary SI ICE are manufactured:

(i) [Does not apply]

(ii) on or after January 1, 2008, for lean burn engines with a maximum engine power greater than or equal to 500 HP and less than 1,350 HP;

(iii) - (iv) [Do not apply]

(5) - (6) [Do not apply]

(b) [Does not apply]

(c) If you are an owner or operator of an area source subject to this subpart, you are exempt from the obligation to obtain a permit under 40 CFR part 70 or 40 CFR part 71, provided you are not required to obtain a permit under 40 CFR 70.3(a) or 40 CFR 71.3(a) for a reason other than your status as an area source under this subpart. Notwithstanding the previous sentence, you must continue to comply with the provisions of this subpart as applicable.

(d) - (f) [Do not apply]

[73 FR 3591, Jan. 18, 2008, as amended at 76 FR 37972, June 28, 2011; 86 FR 34360, June 29, 2021]

**# 014 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4246]****Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines****What parts of the General Provisions apply to me?**

(a) Table 3 to this subpart shows which parts of the General Provisions in §§ 60.1 through 60.19 apply to you. [Refer to Table 3 to Subpart JJJJ]

(b) The provisions of 40 CFR 1068.10 and 1068.11 apply for engine manufacturers. For others, the general confidential business information (CBI) provisions apply as described in 40 CFR part 2.

[88 FR 4471, Jan. 24, 2023]

**# 015 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4248]****Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines****What definitions apply to this subpart?**

[Refer to 40 CFR § 60.4248 for definitions applicable to Subpart JJJJ]

**SECTION D. Source Level Requirements**

Source ID: 107

Source Name: 768 BHP VOLVO TAD1631GE EMER GEN ENG SN 2160052565

Source Capacity/Throughput:

38.620 Gal/HR

Diesel Fuel

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.13]****Processes**

No person may permit the emission into the outdoor atmosphere of particulate matter from this process in a manner that the concentration of particulate matter in the effluent gas exceeds .04 grain per dry standard cubic foot, when the effluent gas volume is less than 150,000 dry standard cubic feet per minute.

**# 002 [25 Pa. Code §123.21]****General**

No person may permit the emission into the outdoor atmosphere of sulfur oxides from a source in a manner that the concentration of the sulfur oxides, expressed as SO<sub>2</sub>, in the effluent gas exceeds 500 parts per million, by volume, dry basis.

**Operation Hours Restriction(s).****# 003 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6640]****Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines****How do I demonstrate continuous compliance with the emission limitations, operating limitations, and other requirements?**

[40 CFR § 63.6640(f):]

(f) If you own or operate an emergency stationary RICE, you must operate the emergency stationary RICE according to the requirements in paragraphs (f)(1) through (4) of this section. In order for the engine to be considered an emergency stationary RICE under this subpart, any operation other than emergency operation, maintenance and testing, and operation in non-emergency situations for 50 hours per year, as described in paragraphs (f)(1) through (4), is prohibited. If you do not operate the engine according to the requirements in paragraphs (f)(1) through (4), the engine will not be considered an emergency engine under this subpart and must meet all requirements for non-emergency engines.

(1) There is no time limit on the use of emergency stationary RICE in emergency situations.

(2) You may operate your emergency stationary RICE for the purpose specified in paragraph (f)(2)(i) of this section for a maximum of 100 hours per calendar year. Any operation for non-emergency situations as allowed by paragraphs (f)(3) and (4) of this section counts as part of the 100 hours per calendar year allowed by this paragraph (f)(2).

(i) Emergency stationary RICE may be operated for maintenance checks and readiness testing, provided that the tests are recommended by federal, state or local government, the manufacturer, the vendor, the regional transmission organization or equivalent balancing authority and transmission operator, or the insurance company associated with the engine. The owner or operator may petition the Administrator for approval of additional hours to be used for maintenance checks and readiness testing, but a petition is not required if the owner or operator maintains records indicating that federal, state, or local standards require maintenance and testing of emergency RICE beyond 100 hours per calendar year.

(ii)-(iii) [Reserved]

(3) [Does not apply]



## SECTION D. Source Level Requirements

(4) Emergency stationary RICE located at area sources of HAP may be operated for up to 50 hours per calendar year in non-emergency situations. The 50 hours of operation in non-emergency situations are counted as part of the 100 hours per calendar year for maintenance and testing provided in paragraph (f)(2) of this section. Except as provided in paragraphs (f)(4)(i) and (ii) of this section, the 50 hours per year for non-emergency situations cannot be used for peak shaving or non-emergency demand response, or to generate income for a facility to an electric grid or otherwise supply power as part of a financial arrangement with another entity.

(i) [Does not apply]

(ii) The 50 hours per year for non-emergency situations can be used to supply power as part of a financial arrangement with another entity if all of the following conditions are met:

(A) The engine is dispatched by the local balancing authority or local transmission and distribution system operator.

(B) The dispatch is intended to mitigate local transmission and/or distribution limitations so as to avert potential voltage collapse or line overloads that could lead to the interruption of power supply in a local area or region.

(C) The dispatch follows reliability, emergency operation or similar protocols that follow specific NERC, regional, state, public utility commission or local standards or guidelines.

(D) The power is provided only to the facility itself or to support the local transmission and distribution system.

(E) The owner or operator identifies and records the entity that dispatches the engine and the specific NERC, regional, state, public utility commission or local standards or guidelines that are being followed for dispatching the engine. The local balancing authority or local transmission and distribution system operator may keep these records on behalf of the engine owner or operator.

[69 FR 33506, June 15, 2004, as amended at 71 FR 20467, Apr. 20, 2006; 73 FR 3606, Jan. 18, 2008; 75 FR 9676, Mar. 3, 2010; 75 FR 51591, Aug. 20, 2010; 78 FR 6704, Jan. 30, 2013; 87 FR 48607, Aug. 10, 2022]

### II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

### III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

### IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

### V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION D. Source Level Requirements****VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).



**SECTION E. Source Group Restrictions.**



**SECTION F. Alternative Operation Requirements.**

No Alternative Operations exist for this State Only facility.

**SECTION G. Emission Restriction Summary.**

Source Id	Source Description			
030	START UP BOILER (150 HP)			
<b>Emission Limit</b>				<b>Pollutant</b>
4.000	Lbs/MMBTU	of heat input.		SOX
0.400	Lbs/MMBTU	of heat input.		TSP
031	MISCELLANEOUS NATURAL GAS COMBUSTION			
<b>Emission Limit</b>				<b>Pollutant</b>
4.000	Lbs/MMBTU	over a 1-hour period		SOX
105	EMERGENCY GENERATOR (1474 HP)			
<b>Emission Limit</b>				<b>Pollutant</b>
2.000	GRAMS/HP-Hr			CO
4.000	GRAMS/KW-Hr			NOx+NMHC
500.000	PPMV	dry basis.		SOX
0.200	GRAMS/KW-Hr			TSP
1.000	GRAMS/HP-Hr			VOC
106	COMBINED HEAT & POWER UNIT (CHP) (375-KW)			
<b>Emission Limit</b>				<b>Pollutant</b>
5.000	GRAMS/HP-Hr			CO
610.000	PPMV	15% O2		CO
2.000	GRAMS/HP-Hr			NOX
150.000	PPMV	15% O2		NOX
500.000	PPMV	dry basis		SOX
0.020	gr/DRY FT3	flare emissions		TSP
0.040	gr/DRY FT3			TSP
1.000	GRAMS/HP-Hr	excluding formaldehyde		VOC
80.000	PPMV	15% O2, excluding formaldehyde		VOC
107	768 BHP VOLVO TAD1631GE EMER GEN ENG SN 2160052565			
<b>Emission Limit</b>				<b>Pollutant</b>
500.000	PPMV	dry basis		SOX
0.040	gr/DRY FT3			TSP

**Site Emission Restriction Summary**

Emission Limit	Pollutant
----------------	-----------




**SECTION G. Emission Restriction Summary.**

**SECTION H. Miscellaneous.**

(a) The Capacity/Throughput numbers listed on Page 4 and provided in Section D of this permit for individual sources are for informational purposes only and are not to be considered enforceable limits. Enforceable emission limits are listed in the Restriction section for each source. They are also summarized for informational purposes only in Section G.

(b) The initial operating permit incorporating Plan Approval 43-356D was issued on July 9, 2019.



\*\*\*\*\* End of Report \*\*\*\*\*

---