



COMMONWEALTH OF PENNSYLVANIA
DEPARTMENT OF ENVIRONMENTAL PROTECTION
AIR QUALITY PROGRAM

TITLE V/STATE OPERATING PERMIT

Issue Date: April 8, 2025

Effective Date: May 1, 2025

Expiration Date: April 30, 2030

In accordance with the provisions of the Air Pollution Control Act, the Act of January 8, 1960, P.L. 2119, as amended, and 25 Pa. Code Chapter 127, the Owner, [and Operator if noted] (hereinafter referred to as permittee) identified below is authorized by the Department of Environmental Protection (Department) to operate the air emission source(s) more fully described in this permit. This Facility is subject to all terms and conditions specified in this permit. Nothing in this permit relieves the permittee from its obligations to comply with all applicable Federal, State and Local laws and regulations.

The regulatory or statutory authority for each permit condition is set forth in brackets. All terms and conditions in this permit are federally enforceable applicable requirements unless otherwise designated as "State-Only" or "non-applicable" requirements.

TITLE V Permit No: 06-05160

Federal Tax Id - Plant Code: 47-4511036-12

Owner Information

Name: NEXTERA RENEWABLE FUELS LLC

Mailing Address: PO BOX 39
OREFIELD, PA 18069-0039

Plant Information

Plant: NEXTERA RENEWABLE FUELS LLC/WESTERN BERKS LDFL

Location: 06 Berks County 06928 Cumru Township

SIC Code: 4953 Trans. & Utilities - Refuse Systems

Responsible Official

Name: DANNY SCHEDULE

Title: SR DIR MIDSTRM OPS/CONSTR

Phone: (713) 374 - 1583

Email: danny.schedule@nexteraenergy.com

Permit Contact Person

Name: ROBERT SORENSEN

Title: ENV SPECIALIST

Phone: (570) 225 - 8323

Email: robert.sorensen@nexteraenergy.com

[Signature] _____

WILLIAM R. WEAVER, SOUTH CENTRAL REGION AIR PROGRAM MANAGER



SECTION A. Table of Contents

Section A. Facility/Source Identification

Table of Contents
Site Inventory List

Section B. General Title V Requirements

- #001 Definitions
- #002 Prohibition of Air Pollution
- #003 Property Rights
- #004 Permit Expiration
- #005 Permit Renewal
- #006 Transfer of Ownership or Operational Control
- #007 Inspection and Entry
- #008 Compliance Requirements
- #009 Need to Halt or Reduce Activity Not a Defense
- #010 Duty to Provide Information
- #011 Reopening and Revising the Title V Permit for Cause
- #012 Reopening a Title V Permit for Cause by EPA
- #013 Operating Permit Application Review by the EPA
- #014 Significant Operating Permit Modifications
- #015 Minor Operating Permit Modifications
- #016 Administrative Operating Permit Amendments
- #017 Severability Clause
- #018 Fee Payment
- #019 Authorization for De Minimis Emission Increases
- #020 Reactivation of Sources
- #021 Circumvention
- #022 Submissions
- #023 Sampling, Testing and Monitoring Procedures
- #024 Compliance Certification
- #025 Recordkeeping Requirements
- #026 Reporting Requirements
- #027 Operational Flexibility
- #028 Risk Management
- #029 Approved Economic Incentives and Emission Trading Programs
- #030 Permit Shield
- #031 Reporting
- #032 Report Format

Section C. Site Level Title V Requirements

- C-I: Restrictions
- C-II: Testing Requirements
- C-III: Monitoring Requirements
- C-IV: Recordkeeping Requirements
- C-V: Reporting Requirements
- C-VI: Work Practice Standards
- C-VII: Additional Requirements
- C-VIII: Compliance Certification
- C-IX: Compliance Schedule

Section D. Source Level Title V Requirements

- D-I: Restrictions
- D-II: Testing Requirements
- D-III: Monitoring Requirements
- D-IV: Recordkeeping Requirements
- D-V: Reporting Requirements



SECTION A. Table of Contents

D-VI: Work Practice Standards
D-VII: Additional Requirements

Note: These same sub-sections are repeated for each source!

Section E. Source Group Restrictions

E-I: Restrictions
E-II: Testing Requirements
E-III: Monitoring Requirements
E-IV: Recordkeeping Requirements
E-V: Reporting Requirements
E-VI: Work Practice Standards
E-VII: Additional Requirements

Section F. Alternative Operating Scenario(s)

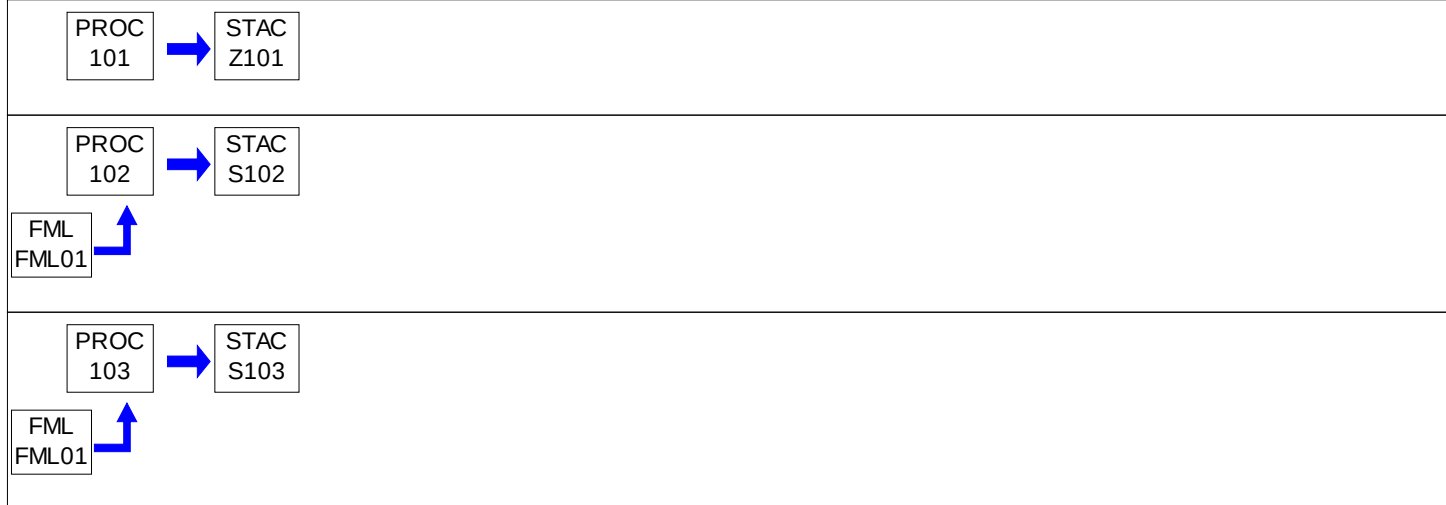
F-I: Restrictions
F-II: Testing Requirements
F-III: Monitoring Requirements
F-IV: Recordkeeping Requirements
F-V: Reporting Requirements
F-VI: Work Practice Standards
F-VII: Additional Requirements

Section G. Emission Restriction Summary

Section H. Miscellaneous

**SECTION A. Site Inventory List**

Source ID	Source Name	Capacity/Throughput	Fuel/Material
101	LANDFILL GAS TREATMENT SYSTEM		
102	CAT G3520C, LFG-FIRED ENGINE GEN SET NO.1	36.000 MCF/HR	TREATED LFG
103	CAT G3520C, LFG-FIRED ENGINE GEN SET NO.2	36.000 MCF/HR	TREATED LFG
FML01	TREATED LANDFILL GAS		
S102	LFG-FIRED ENGINE GEN SET NO.1 STACK		
S103	LFG-FIRED ENGINE GEN SET NO.2 STACK		
Z101	FUGITIVE: TREATMENT SYSTEM		

PERMIT MAPS

**SECTION B. General Title V Requirements****#001 [25 Pa. Code § 121.1]****Definitions**

Words and terms that are not otherwise defined in this permit shall have the meanings set forth in Section 3 of the Air Pollution Control Act (35 P.S. § 4003) and 25 Pa. Code § 121.1.

#002 [25 Pa. Code § 121.7]**Prohibition of Air Pollution**

No person may permit air pollution as that term is defined in the Air Pollution Control Act (35 P.S. §§ 4001-4015).

#003 [25 Pa. Code § 127.512(c)(4)]**Property Rights**

This permit does not convey property rights of any sort, or any exclusive privileges.

#004 [25 Pa. Code § 127.446(a) and (c)]**Permit Expiration**

This operating permit is issued for a fixed term of five (5) years and shall expire on the date specified on Page 1 of this permit. The terms and conditions of the expired permit shall automatically continue pending issuance of a new Title V permit, provided the permittee has submitted a timely and complete application and paid applicable fees required under 25 Pa. Code Chapter 127, Subchapter I and the Department is unable, through no fault of the permittee, to issue or deny a new permit before the expiration of the previous permit. An application is complete if it contains sufficient information to begin processing the application, has the applicable sections completed and has been signed by a responsible official.

#005 [25 Pa. Code §§ 127.412, 127.413, 127.414, 127.446(e), 127.503 & 127.704(b)]**Permit Renewal**

(a) An application for the renewal of the Title V permit shall be submitted to the Department at least six (6) months, and not more than 18 months, before the expiration date of this permit. The renewal application is timely if a complete application is submitted to the Department's Regional Air Manager within the timeframe specified in this permit condition.

(b) The application for permit renewal shall include the current permit number, the appropriate permit renewal fee, a description of any permit revisions and off-permit changes that occurred during the permit term, and any applicable requirements that were promulgated and not incorporated into the permit during the permit term. The fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" and submitted with the fee form to the respective regional office.

(c) The renewal application shall also include submission of proof that the local municipality and county, in which the facility is located, have been notified in accordance with 25 Pa. Code § 127.413. The application for renewal of the Title V permit shall also include submission of compliance review forms which have been used by the permittee to update information submitted in accordance with either 25 Pa. Code § 127.412(b) or § 127.412(j).

(d) The permittee, upon becoming aware that any relevant facts were omitted or incorrect information was submitted in the permit application, shall promptly submit such supplementary facts or corrected information during the permit renewal process. The permittee shall also promptly provide additional information as necessary to address any requirements that become applicable to the source after the date a complete renewal application was submitted but prior to release of a draft permit.

#006 [25 Pa. Code §§ 127.450(a)(4) & 127.464(a)]**Transfer of Ownership or Operational Control**

(a) In accordance with 25 Pa. Code § 127.450(a)(4), a change in ownership or operational control of the source shall be treated as an administrative amendment if:

(1) The Department determines that no other change in the permit is necessary;

(2) A written agreement has been submitted to the Department identifying the specific date of the transfer of permit responsibility, coverage and liability between the current and the new permittee; and,

(3) A compliance review form has been submitted to the Department and the permit transfer has been approved by

**SECTION B. General Title V Requirements**

the Department.

(b) In accordance with 25 Pa. Code § 127.464(a), this permit may not be transferred to another person except in cases of transfer-of-ownership which are documented and approved to the satisfaction of the Department.

#007 [25 Pa. Code § 127.513, 35 P.S. § 4008 and § 114 of the CAA]**Inspection and Entry**

(a) Upon presentation of credentials and other documents as may be required by law for inspection and entry purposes, the permittee shall allow the Department of Environmental Protection or authorized representatives of the Department to perform the following:

(1) Enter at reasonable times upon the permittee's premises where a Title V source is located or emissions related activity is conducted, or where records are kept under the conditions of this permit;

(2) Have access to and copy or remove, at reasonable times, records that are kept under the conditions of this permit;

(3) Inspect at reasonable times, facilities, equipment including monitoring and air pollution control equipment, practices, or operations regulated or required under this permit;

(4) Sample or monitor, at reasonable times, substances or parameters, for the purpose of assuring compliance with the permit or applicable requirements as authorized by the Clean Air Act, the Air Pollution Control Act, or the regulations promulgated under the Acts.

(b) Pursuant to 35 P.S. § 4008, no person shall hinder, obstruct, prevent or interfere with the Department or its personnel in the performance of any duty authorized under the Air Pollution Control Act.

(c) Nothing in this permit condition shall limit the ability of the EPA to inspect or enter the premises of the permittee in accordance with Section 114 or other applicable provisions of the Clean Air Act.

#008 [25 Pa. Code §§ 127.25, 127.444, & 127.512(c)(1)]**Compliance Requirements**

(a) The permittee shall comply with the conditions of this permit. Noncompliance with this permit constitutes a violation of the Clean Air Act and the Air Pollution Control Act and is grounds for one (1) or more of the following:

(1) Enforcement action

(2) Permit termination, revocation and reissuance or modification

(3) Denial of a permit renewal application

(b) A person may not cause or permit the operation of a source, which is subject to 25 Pa. Code Article III, unless the source(s) and air cleaning devices identified in the application for the plan approval and operating permit and the plan approval issued to the source are operated and maintained in accordance with specifications in the applications and the conditions in the plan approval and operating permit issued by the Department. A person may not cause or permit the operation of an air contamination source subject to 25 Pa. Code Chapter 127 in a manner inconsistent with good operating practices.

(c) For purposes of Sub-condition (b) of this permit condition, the specifications in applications for plan approvals and operating permits are the physical configurations and engineering design details which the Department determines are essential for the permittee's compliance with the applicable requirements in this Title V permit.

#009 [25 Pa. Code § 127.512(c)(2)]**Need to Halt or Reduce Activity Not a Defense**

It shall not be a defense for a permittee in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.

**SECTION B. General Title V Requirements****#010 [25 Pa. Code §§ 127.411(d) & 127.512(c)(5)]****Duty to Provide Information**

(a) The permittee shall furnish to the Department, within a reasonable time, information that the Department may request in writing to determine whether cause exists for modifying, revoking and reissuing, or terminating the permit, or to determine compliance with the permit.

(b) Upon request, the permittee shall also furnish to the Department copies of records that the permittee is required to keep by this permit, or for information claimed to be confidential, the permittee may furnish such records directly to the Administrator of EPA along with a claim of confidentiality.

#011 [25 Pa. Code §§ 127.463, 127.512(c)(3) & 127.542]**Reopening and Revising the Title V Permit for Cause**

(a) This Title V permit may be modified, revoked, reopened and reissued or terminated for cause. The filing of a request by the permittee for a permit modification, revocation and reissuance, or termination, or of a notification of planned changes or anticipated noncompliance does not stay a permit condition.

(b) This permit may be reopened, revised and reissued prior to expiration of the permit under one or more of the following circumstances:

(1) Additional applicable requirements under the Clean Air Act or the Air Pollution Control Act become applicable to a Title V facility with a remaining permit term of three (3) or more years prior to the expiration date of this permit. The Department will revise the permit as expeditiously as practicable but not later than 18 months after promulgation of the applicable standards or regulations. No such revision is required if the effective date of the requirement is later than the expiration date of this permit, unless the original permit or its terms and conditions has been extended.

(2) Additional requirements, including excess emissions requirements, become applicable to an affected source under the acid rain program. Upon approval by the Administrator of EPA, excess emissions offset plans for an affected source shall be incorporated into the permit.

(3) The Department or the EPA determines that this permit contains a material mistake or inaccurate statements were made in establishing the emissions standards or other terms or conditions of this permit.

(4) The Department or the Administrator of EPA determines that the permit must be revised or revoked to assure compliance with the applicable requirements.

(c) Proceedings to revise this permit shall follow the same procedures which apply to initial permit issuance and shall affect only those parts of this permit for which cause to revise exists. The revision shall be made as expeditiously as practicable.

(d) Regardless of whether a revision is made in accordance with (b)(1) above, the permittee shall meet the applicable standards or regulations promulgated under the Clean Air Act within the time frame required by standards or regulations.

#012 [25 Pa. Code § 127.543]**Reopening a Title V Permit for Cause by EPA**

As required by the Clean Air Act and regulations adopted thereunder, this permit may be modified, reopened and reissued, revoked or terminated for cause by EPA in accordance with procedures specified in 25 Pa. Code § 127.543.

#013 [25 Pa. Code § 127.522(a)]**Operating Permit Application Review by the EPA**

The applicant may be required by the Department to provide a copy of the permit application, including the compliance plan, directly to the Administrator of the EPA. Copies of title V permit applications to EPA, pursuant to 25 PA Code §127.522(a), shall be submitted, if required, to the following EPA e-mail box:

R3_Air_Apps_and_Notices@epa.gov

Please place the following in the subject line: TV [permit number], [Facility Name].

**SECTION B. General Title V Requirements****#014 [25 Pa. Code § 127.541]****Significant Operating Permit Modifications**

When permit modifications during the term of this permit do not qualify as minor permit modifications or administrative amendments, the permittee shall submit an application for significant Title V permit modifications in accordance with 25 Pa. Code § 127.541. Notifications to EPA, pursuant to 25 PA Code §127.522(a), if required, shall be submitted, to the following EPA e-mail box:

R3_Air_Apps_and_Notices@epa.gov

Please place the following in the subject line: TV [permit number], [Facility Name].

#015 [25 Pa. Code §§ 121.1 & 127.462]**Minor Operating Permit Modifications**

The permittee may make minor operating permit modifications (as defined in 25 Pa. Code §121.1), on an expedited basis, in accordance with 25 Pa. Code §127.462 (relating to minor operating permit modifications). Notifications to EPA, pursuant to 25 PA Code §127.462(c), if required, shall be submitted, to the following EPA e-mail box:

R3_Air_Apps_and_Notices@epa.gov

Please place the following in the subject line: TV [permit number], [Facility Name].

#016 [25 Pa. Code § 127.450]**Administrative Operating Permit Amendments**

(a) The permittee may request administrative operating permit amendments, as defined in 25 Pa. Code §127.450(a). Copies of request for administrative permit amendment to EPA, pursuant to 25 PA Code §127.450(c)(1), if required, shall be submitted to the following EPA e-mail box:

R3_Air_Apps_and_Notices@epa.gov

Please place the following in the subject line: TV [permit number], [Facility Name].

(b) Upon final action by the Department granting a request for an administrative operating permit amendment covered under §127.450(a)(5), the permit shield provisions in 25 Pa. Code § 127.516 (relating to permit shield) shall apply to administrative permit amendments incorporated in this Title V Permit in accordance with §127.450(c), unless precluded by the Clean Air Act or the regulations thereunder.

#017 [25 Pa. Code § 127.512(b)]**Severability Clause**

The provisions of this permit are severable, and if any provision of this permit is determined by the Environmental Hearing Board or a court of competent jurisdiction, or US EPA to be invalid or unenforceable, such a determination will not affect the remaining provisions of this permit.

#018 [25 Pa. Code §§ 127.704, 127.705 & 127.707]**Fee Payment**

(a) The permittee shall pay fees to the Department in accordance with the applicable fee schedules in 25 Pa. Code Chapter 127, Subchapter I (relating to plan approval and operating permit fees). The applicable fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" with the permit number clearly indicated and submitted to the respective regional office.

(b) Emission Fees. The permittee shall, on or before September 1st of each year, pay applicable annual Title V emission fees for emissions occurring in the previous calendar year as specified in 25 Pa. Code § 127.705. The permittee is not required to pay an emission fee for emissions of more than 4,000 tons of each regulated pollutant emitted from the facility.

(c) As used in this permit condition, the term "regulated pollutant" is defined as a VOC, each pollutant regulated under Sections 111 and 112 of the Clean Air Act and each pollutant for which a National Ambient Air Quality Standard has been promulgated, except that carbon monoxide is excluded.

**SECTION B. General Title V Requirements**

(d) Late Payment. Late payment of emission fees will subject the permittee to the penalties prescribed in 25 Pa. Code § 127.707 and may result in the suspension or termination of the Title V permit. The permittee shall pay a penalty of fifty percent (50%) of the fee amount, plus interest on the fee amount computed in accordance with 26 U.S.C.A. § 6621(a)(2) from the date the emission fee should have been paid in accordance with the time frame specified in 25 Pa. Code § 127.705(c).

(e) The permittee shall pay an annual operating permit maintenance fee according to the following fee schedule established in 25 Pa. Code § 127.704(d) on or before December 31 of each year for the next calendar year.

(1) Eight thousand dollars (\$8,000) for calendar years 2021—2025.

(2) Ten thousand dollars (\$10,000) for calendar years 2026—2030.

(3) Twelve thousand five hundred dollars (\$12,500) for the calendar years beginning with 2031.

#019 [25 Pa. Code §§ 127.14(b) & 127.449]**Authorization for De Minimis Emission Increases**

(a) This permit authorizes de minimis emission increases from a new or existing source in accordance with 25 Pa. Code §§ 127.14 and 127.449 without the need for a plan approval or prior issuance of a permit modification. The permittee shall provide the Department with seven (7) days prior written notice before commencing any de minimis emissions increase that would result from either: (1) a physical change of minor significance under § 127.14(c)(1); or (2) the construction, installation, modification or reactivation of an air contamination source. The written notice shall:

(1) Identify and describe the pollutants that will be emitted as a result of the de minimis emissions increase.

(2) Provide emission rates expressed in tons per year and in terms necessary to establish compliance consistent with any applicable requirement.

The Department may disapprove or condition de minimis emission increases at any time.

(b) Except as provided below in (c) and (d) of this permit condition, the permittee is authorized during the term of this permit to make de minimis emission increases (expressed in tons per year) up to the following amounts without the need for a plan approval or prior issuance of a permit modification:

(1) Four tons of carbon monoxide from a single source during the term of the permit and 20 tons of carbon monoxide at the facility during the term of the permit.

(2) One ton of NO_x from a single source during the term of the permit and 5 tons of NO_x at the facility during the term of the permit.

(3) One and six-tenths tons of the oxides of sulfur from a single source during the term of the permit and 8.0 tons of oxides of sulfur at the facility during the term of the permit.

(4) Six-tenths of a ton of PM₁₀ from a single source during the term of the permit and 3.0 tons of PM₁₀ at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act or 25 Pa. Code Article III.

(5) One ton of VOCs from a single source during the term of the permit and 5.0 tons of VOCs at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act or 25 Pa. Code Article III.

(c) In accordance with § 127.14, the permittee may install the following minor sources without the need for a plan approval:

(1) Air conditioning or ventilation systems not designed to remove pollutants generated or released from other sources.

(2) Combustion units rated at 2,500,000 or less Btu per hour of heat input.

**SECTION B. General Title V Requirements**

(3) Combustion units with a rated capacity of less than 10,000,000 Btu per hour heat input fueled by natural gas supplied by a public utility, liquefied petroleum gas or by commercial fuel oils which are No. 2 or lighter, viscosity less than or equal to 5.82 c St, and which meet the sulfur content requirements of 25 Pa. Code § 123.22 (relating to combustion units). For purposes of this permit, commercial fuel oil shall be virgin oil which has no reprocessed, recycled or waste material added.

(4) Space heaters which heat by direct heat transfer.

(5) Laboratory equipment used exclusively for chemical or physical analysis.

(6) Other sources and classes of sources determined to be of minor significance by the Department.

(d) This permit does not authorize de minimis emission increases if the emissions increase would cause one or more of the following:

(1) Increase the emissions of a pollutant regulated under Section 112 of the Clean Air Act except as authorized in Subparagraphs (b)(4) and (5) of this permit condition.

(2) Subject the facility to the prevention of significant deterioration requirements in 25 Pa. Code Chapter 127, Subchapter D and/or the new source review requirements in Subchapter E.

(3) Violate any applicable requirement of the Air Pollution Control Act, the Clean Air Act, or the regulations promulgated under either of the acts.

(4) Changes which are modifications under any provision of Title I of the Clean Air Act and emission increases which would exceed the allowable emissions level (expressed as a rate of emissions or in terms of total emissions) under the Title V permit.

(e) Unless precluded by the Clean Air Act or the regulations thereunder, the permit shield described in 25 Pa. Code § 127.516 (relating to permit shield) shall extend to the changes made under 25 Pa. Code § 127.449 (relating to de minimis emission increases).

(f) Emissions authorized under this permit condition shall be included in the monitoring, recordkeeping and reporting requirements of this permit.

(g) Except for de minimis emission increases allowed under this permit, 25 Pa. Code § 127.449, or sources and physical changes meeting the requirements of 25 Pa. Code § 127.14, the permittee is prohibited from making physical changes or engaging in activities that are not specifically authorized under this permit without first applying for a plan approval. In accordance with § 127.14(b), a plan approval is not required for the construction, modification, reactivation, or installation of the sources creating the de minimis emissions increase.

(h) The permittee may not meet de minimis emission threshold levels by offsetting emission increases or decreases at the same source.

#020 [25 Pa. Code §§ 127.11a & 127.215]**Reactivation of Sources**

(a) The permittee may reactivate a source at the facility that has been out of operation or production for at least one year, but less than or equal to five (5) years, if the source is reactivated in accordance with the requirements of 25 Pa. Code §§ 127.11a and 127.215. The reactivated source will not be considered a new source.

(b) A source which has been out of operation or production for more than five (5) years but less than 10 years may be reactivated and will not be considered a new source if the permittee satisfies the conditions specified in 25 Pa. Code § 127.11a(b).

#021 [25 Pa. Code §§ 121.9 & 127.216]**Circumvention**

(a) The owner of this Title V facility, or any other person, may not circumvent the new source review requirements of 25 Pa. Code Chapter 127, Subchapter E by causing or allowing a pattern of ownership or development, including the

**SECTION B. General Title V Requirements**

phasing, staging, delaying or engaging in incremental construction, over a geographic area of a facility which, except for the pattern of ownership or development, would otherwise require a permit or submission of a plan approval application.

(b) No person may permit the use of a device, stack height which exceeds good engineering practice stack height, dispersion technique or other technique which, without resulting in reduction of the total amount of air contaminants emitted, conceals or dilutes an emission of air contaminants which would otherwise be in violation of this permit, the Air Pollution Control Act or the regulations promulgated thereunder, except that with prior approval of the Department, the device or technique may be used for control of malodors.

#022 [25 Pa. Code §§ 127.402(d) & 127.513(1)]**Submissions**

(a) Reports, test data, monitoring data, notifications and requests for renewal of the permit shall be submitted to the:

Regional Air Program Manager
PA Department of Environmental Protection
(At the address given on the permit transmittal letter, or otherwise notified)

(b) Any report or notification for the EPA Administrator or EPA Region III should be addressed to:

Enforcement & Compliance Assurance Division
Air, RCRA and Toxics Branch (3ED21)
Four Penn Center
1600 John F. Kennedy Boulevard
Philadelphia, PA 19103-2852

The Title V compliance certification shall be emailed to EPA at R3_APD_Permits@epa.gov.

(c) An application, form, report or compliance certification submitted pursuant to this permit condition shall contain certification by a responsible official as to truth, accuracy, and completeness as required under 25 Pa. Code § 127.402(d). Unless otherwise required by the Clean Air Act or regulations adopted thereunder, this certification and any other certification required pursuant to this permit shall state that, based on information and belief formed after reasonable inquiry, the statements and information in the document are true, accurate and complete.

#023 [25 Pa. Code §§ 127.441(c) & 127.463(e); Chapter 139; & 114(a)(3), 504(b) of the CAA]**Sampling, Testing and Monitoring Procedures**

(a) The permittee shall perform the emissions monitoring and analysis procedures or test methods for applicable requirements of this Title V permit. In addition to the sampling, testing and monitoring procedures specified in this permit, the Permittee shall comply with any additional applicable requirements promulgated under the Clean Air Act after permit issuance regardless of whether the permit is revised.

(b) The sampling, testing and monitoring required under the applicable requirements of this permit, shall be conducted in accordance with the requirements of 25 Pa. Code Chapter 139 unless alternative methodology is required by the Clean Air Act (including §§ 114(a)(3) and 504(b)) and regulations adopted thereunder.

#024 [25 Pa. Code § 127.513]**Compliance Certification**

(a) One year after the date of issuance of the Title V permit, and each year thereafter, unless specified elsewhere in the permit, the permittee shall submit to the Department and EPA Region III a certificate of compliance with the terms and conditions in this permit, for the previous year, including the emission limitations, standards or work practices. This certification shall include:

- (1) The identification of each term or condition of the permit that is the basis of the certification.
- (2) The compliance status.
- (3) The methods used for determining the compliance status of the source, currently and over the reporting period.
- (4) Whether compliance was continuous or intermittent.

(b) The compliance certification shall be postmarked or hand-delivered no later than thirty days after each anniversary of

**SECTION B. General Title V Requirements**

the date of issuance of this Title V Operating Permit, or on the submittal date specified elsewhere in the permit, to the Department in accordance with the submission requirements specified in Section B, Condition #022 of this permit. The Title V compliance certification shall be emailed to EPA at R3_APD_Permits@epa.gov.

#025 [25 Pa. Code §§ 127.511 & Chapter 135]**Recordkeeping Requirements**

(a) The permittee shall maintain and make available, upon request by the Department, records of required monitoring information that include the following:

- (1) The date, place (as defined in the permit) and time of sampling or measurements.
- (2) The dates the analyses were performed.
- (3) The company or entity that performed the analyses.
- (4) The analytical techniques or methods used.
- (5) The results of the analyses.
- (6) The operating conditions as existing at the time of sampling or measurement.

(b) The permittee shall retain records of the required monitoring data and supporting information for at least five (5) years from the date of the monitoring sample, measurement, report or application. Supporting information includes the calibration data and maintenance records and original strip-chart recordings for continuous monitoring instrumentation, and copies of reports required by the permit.

(c) The permittee shall maintain and make available to the Department upon request, records including computerized records that may be necessary to comply with the reporting, recordkeeping and emission statement requirements in 25 Pa. Code Chapter 135 (relating to reporting of sources). In accordance with 25 Pa. Code Chapter 135, § 135.5, such records may include records of production, fuel usage, maintenance of production or pollution control equipment or other information determined by the Department to be necessary for identification and quantification of potential and actual air contaminant emissions. If direct recordkeeping is not possible or practical, sufficient records shall be kept to provide the needed information by indirect means.

#026 [25 Pa. Code §§ 127.411(d), 127.442, 127.463(e) & 127.511(c)]**Reporting Requirements**

(a) The permittee shall comply with the reporting requirements for the applicable requirements specified in this Title V permit. In addition to the reporting requirements specified herein, the permittee shall comply with any additional applicable reporting requirements promulgated under the Clean Air Act after permit issuance regardless of whether the permit is revised.

(b) Pursuant to 25 Pa. Code § 127.511(c), the permittee shall submit reports of required monitoring at least every six (6) months unless otherwise specified in this permit. Instances of deviations (as defined in 25 Pa. Code § 121.1) from permit requirements shall be clearly identified in the reports. The reporting of deviations shall include the probable cause of the deviations and corrective actions or preventative measures taken, except that sources with continuous emission monitoring systems shall report according to the protocol established and approved by the Department for the source. The required reports shall be certified by a responsible official.

(c) Every report submitted to the Department under this permit condition shall comply with the submission procedures specified in Section B, Condition #022(c) of this permit.

(d) Any records, reports or information obtained by the Department or referred to in a public hearing shall be made available to the public by the Department except for such records, reports or information for which the permittee has shown cause that the documents should be considered confidential and protected from disclosure to the public under Section 4013.2 of the Air Pollution Control Act and consistent with Sections 112(d) and 114(c) of the Clean Air Act and 25 Pa. Code § 127.411(d). The permittee may not request a claim of confidentiality for any emissions data generated for the Title V facility.

**SECTION B. General Title V Requirements****#027 [25 Pa. Code § 127.3]****Operational Flexibility**

The permittee is authorized to make changes within the Title V facility in accordance with the following provisions in 25 Pa. Code Chapter 127 which implement the operational flexibility requirements of Section 502(b)(10) of the Clean Air Act and Section 6.1(i) of the Air Pollution Control Act:

- (1) Section 127.14 (relating to exemptions)
- (2) Section 127.447 (relating to alternative operating scenarios)
- (3) Section 127.448 (relating to emissions trading at facilities with federally enforceable emissions caps)
- (4) Section 127.449 (relating to de minimis emission increases)
- (5) Section 127.450 (relating to administrative operating permit amendments)
- (6) Section 127.462 (relating to minor operating permit amendments)
- (7) Subchapter H (relating to general plan approvals and operating permits)

#028 [25 Pa. Code §§ 127.441(d), 127.512(i) and 40 CFR Part 68]**Risk Management**

(a) If required by Section 112(r) of the Clean Air Act, the permittee shall develop and implement an accidental release program consistent with requirements of the Clean Air Act, 40 CFR Part 68 (relating to chemical accident prevention provisions) and the Federal Chemical Safety Information, Site Security and Fuels Regulatory Relief Act (P.L. 106-40).

(b) The permittee shall prepare and implement a Risk Management Plan (RMP) which meets the requirements of Section 112(r) of the Clean Air Act, 40 CFR Part 68 and the Federal Chemical Safety Information, Site Security and Fuels Regulatory Relief Act when a regulated substance listed in 40 CFR § 68.130 is present in a process in more than the listed threshold quantity at the Title V facility. The permittee shall submit the RMP to the federal Environmental Protection Agency according to the following schedule and requirements:

- (1) The permittee shall submit the first RMP to a central point specified by EPA no later than the latest of the following:
 - (i) Three years after the date on which a regulated substance is first listed under § 68.130; or,
 - (ii) The date on which a regulated substance is first present above a threshold quantity in a process.

- (2) The permittee shall submit any additional relevant information requested by the Department or EPA concerning the RMP and shall make subsequent submissions of RMPs in accordance with 40 CFR § 68.190.

- (3) The permittee shall certify that the RMP is accurate and complete in accordance with the requirements of 40 CFR Part 68, including a checklist addressing the required elements of a complete RMP.

(c) As used in this permit condition, the term "process" shall be as defined in 40 CFR § 68.3. The term "process" means any activity involving a regulated substance including any use, storage, manufacturing, handling, or on-site movement of such substances or any combination of these activities. For purposes of this definition, any group of vessels that are interconnected, or separate vessels that are located such that a regulated substance could be involved in a potential release, shall be considered a single process.

(d) If the Title V facility is subject to 40 CFR Part 68, as part of the certification required under this permit, the permittee shall:

- (1) Submit a compliance schedule for satisfying the requirements of 40 CFR Part 68 by the date specified in 40 CFR § 68.10(a); or,
- (2) Certify that the Title V facility is in compliance with all requirements of 40 CFR Part 68 including the registration and submission of the RMP.

**SECTION B. General Title V Requirements**

(e) If the Title V facility is subject to 40 CFR Part 68, the permittee shall maintain records supporting the implementation of an accidental release program for five (5) years in accordance with 40 CFR § 68.200.

(f) When the Title V facility is subject to the accidental release program requirements of Section 112(r) of the Clean Air Act and 40 CFR Part 68, appropriate enforcement action will be taken by the Department if:

(1) The permittee fails to register and submit the RMP or a revised plan pursuant to 40 CFR Part 68.

(2) The permittee fails to submit a compliance schedule or include a statement in the compliance certification required under Section B, Condition #026 of this permit that the Title V facility is in compliance with the requirements of Section 112(r) of the Clean Air Act, 40 CFR Part 68, and 25 Pa. Code § 127.512(i).

#029 [25 Pa. Code § 127.512(e)]**Approved Economic Incentives and Emission Trading Programs**

No permit revision shall be required under approved economic incentives, marketable permits, emissions trading and other similar programs or processes for changes that are provided for in this Title V permit.

#030 [25 Pa. Code §§ 127.516, 127.450(d), 127.449(f) & 127.462(g)]**Permit Shield**

(a) The permittee's compliance with the conditions of this permit shall be deemed in compliance with applicable requirements (as defined in 25 Pa. Code § 121.1) as of the date of permit issuance if either of the following applies:

(1) The applicable requirements are included and are specifically identified in this permit.

(2) The Department specifically identifies in the permit other requirements that are not applicable to the permitted facility or source.

(b) Nothing in 25 Pa. Code § 127.516 or the Title V permit shall alter or affect the following:

(1) The provisions of Section 303 of the Clean Air Act, including the authority of the Administrator of the EPA provided thereunder.

(2) The liability of the permittee for a violation of an applicable requirement prior to the time of permit issuance.

(3) The applicable requirements of the acid rain program, consistent with Section 408(a) of the Clean Air Act.

(4) The ability of the EPA to obtain information from the permittee under Section 114 of the Clean Air Act.

(c) Unless precluded by the Clean Air Act or regulations thereunder, final action by the Department incorporating a significant permit modification in this Title V Permit shall be covered by the permit shield at the time that the permit containing the significant modification is issued.

#031 [25 Pa. Code §135.3]**Reporting**

(a) The permittee shall submit by March 1 of each year an annual emissions report for the preceding calendar year. The report shall include information for all active previously reported sources, new sources which were first operated during the preceding calendar year, and sources modified during the same period which were not previously reported. All air emissions from the facility should be estimated and reported.

(b) A source owner or operator may request an extension of time from the Department for the filing of an annual emissions report, and the Department may grant the extension for reasonable cause.

#032 [25 Pa. Code §135.4]**Report Format**

Emissions reports shall contain sufficient information to enable the Department to complete its emission inventory. Emissions reports shall be made by the source owner or operator in a format specified by the Department.

**SECTION C. Site Level Requirements****I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.1]****Prohibition of certain fugitive emissions**

(a) The permittee may not allow the emission into the outdoor atmosphere of a fugitive air contaminant from a source other than the following:

- (1) Construction or demolition of buildings or structures.
- (2) Grading, paving, and maintenance of roads and streets.
- (3) Use of roads and streets. Emissions from material in or on trucks, railroad cars, and other vehicular equipment are not considered as emissions from the use of roads and streets.
- (4) Clearing of land.
- (5) Stockpiling of materials.
- (6) Open burning operations.
- (7) Sources and classes of sources other than those identified in (a)(1)-(a)(6), above, for which the operator has obtained a determination from the Department that fugitive emissions from the source, after appropriate control, meet the following requirements:
 - (i) The emissions are of minor significance with respect to causing air pollution; and
 - (ii) The emissions are not preventing or interfering with the attainment or maintenance of any ambient air quality standard.

002 [25 Pa. Code §123.2]**Fugitive particulate matter**

The permittee may not allow the emission of fugitive particulate matter into the outdoor atmosphere from a source specified in Section C, Condition #001, if the emissions are visible at the point the emissions pass outside the permittee's property.

003 [25 Pa. Code §123.31]**Limitations**

The permittee may not allow the emission into the outdoor atmosphere of any malodorous air contaminants from any source in such a manner that the malodors are detectable outside the permittee's property.

004 [25 Pa. Code §123.41]**Limitations**

The permittee may not allow the emission into the outdoor atmosphere of visible air contaminants in such a manner that the opacity of the emission is either of the following:

- (1) Equal to or greater than 20% for a period or periods aggregating more than three (3) minutes in any one hour.
- (2) Equal to or greater than 60% at any time.

005 [25 Pa. Code §123.42]**Exceptions**

The emission limitation of 25 Pa. Code Section 123.41, shall not apply when:

- (1) The presence of uncombined water is the only reason for failure of the emission to meet the limitations.
- (2) The emission results from the operation of equipment used solely to train and test persons in observing the opacity of visible emissions.
- (3) The emission results from sources specified in Section C, Condition #001, subsections (a)(1)-(a)(7).

**SECTION C. Site Level Requirements****# 006 [25 Pa. Code §129.14]****Open burning operations**

(a) No person may permit the open burning of material in the air basin except where the open burning operations result from the following:

- (1) A fire set to prevent or abate a fire hazard, when approved by the Department and set by or under the supervision of a public official.
- (2) Any fire set for the purpose of instructing personnel in fire fighting, when approved by the Department.
- (3) A fire set for the prevention and control of disease or pests, when approved by the Department.
- (4) A fire set solely for recreational or ceremonial purposes.
- (5) A fire set solely for cooking food.

(b) This permit does not constitute authorization to burn solid waste pursuant to section 610 (3) of the Solid Waste Management Act. 35 PS Section 6018.610 (3) or any other provision of the Solid Waste Management Act.

II. TESTING REQUIREMENTS.**# 007 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

(a) Unless otherwise approved in writing by DEP, the permittee shall:

- (1) Conduct performance tests in accordance with 25 Pa Code Section 139 and the Department's Source Testing Manual and any applicable federal regulations.
- (2) Submit to DEP a test protocol for review and approval within 120 days of commencing an emissions testing program, and not conduct the test that is the subject of the protocol until the protocol has been approved by DEP.
- (3) If DEP finds deficiencies in the protocol, the permittee shall provide a response to DEP addressing the deficiencies within 30 days of being notified of the deficiencies.
- (4) Complete the performance test within 120 days of DEP's approval of the test protocol.

(b) Pursuant to 25 Pa. Code § 139.3 at least 15 calendar days prior to commencing an emission testing program, notification as to the date and time of testing shall be given to the appropriate Regional Office. Notification shall also be sent to the Division of Source Testing and Monitoring. Notification shall not be made without prior receipt of a protocol acceptance letter from the Department.

(c) Pursuant to 25 Pa. Code Section 139.53(a)(3) within 15 calendar days after completion of the on-site testing portion of an emission test program, if a complete test report has not yet been submitted, an electronic mail notification shall be sent to the Department's Division of Source Testing and Monitoring and the appropriate Regional Office indicating the completion date of the on-site testing.

(d) Pursuant to 40 CFR Part 60.8(a), 40 CFR Part 61.13(f) and 40 CFR Part 63.7(g) a complete test report shall be submitted to the Department no later than 60 calendar days after completion of the on-site testing portion of an emission test program. For those tests being conducted pursuant to 40 CFR Part 61, a complete test report shall be submitted within 31 days after completion of the test.

(e) Pursuant to 25 Pa. Code Section 139.53(b) a complete test report shall include a summary of the emission results on the first page of the report indicating if each pollutant measured is within permitted limits and a statement of compliance or non-compliance with all applicable permit conditions. The summary results will include, at a minimum, the following information:

**SECTION C. Site Level Requirements**

(1) A statement that the owner or operator has reviewed the report from the emissions testing body and agrees with the findings.

(2) Permit number(s) and condition(s) which are the basis for the evaluation.

(3) Summary of results with respect to each applicable permit condition.

(4) Statement of compliance or non-compliance with each applicable permit condition.

(f) Pursuant to 25 Pa. Code § 139.3 to all submittals shall meet all applicable requirements specified in the most current version of the Department's Source Testing Manual.

(g) All testing shall be performed in accordance with the provisions of Chapter 139 of the Rules and Regulations of the Department of Environmental Protection.

(h) Pursuant to 25 Pa. Code Section 139.53(a)(1) and 139.53(a)(3) all submittals, besides notifications, shall be accomplished through PSIMS*Online available through <https://www.depgreenport.state.pa.us/ecommm/Login.jsp> when it becomes available. If internet submittal cannot be accomplished, submittal shall be made as follows:

Regional Office:

Digital copy (only): RA-epsctesttesting@pa.gov

Bureau of Air Quality:

Digital copy (only): RA-epstacktesting@pa.gov

(i) The permittee shall ensure all federal reporting requirements contained in the applicable subpart of 40 CFR are followed, including timelines more stringent than those contained herein. In the event of an inconsistency or any conflicting requirements between state and the federal, the most stringent provision, term, condition, method or rule shall be used by default.

008 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The Department reserves the right to require exhaust stack testing of the sources & control devices referenced in this permit to measure emissions for purposes including verification of permit condition compliance and estimation of annual air emissions.

009 [25 Pa. Code §139.1]**Sampling facilities.**

Upon the request of the Department, the permittee shall provide adequate sampling ports, safe sampling platforms and adequate utilities for the performance by the Department of tests on such sources. In the request, the Department will set forth the time period in which the facilities shall be provided as well as the specifications for such facilities.

III. MONITORING REQUIREMENTS.**# 010 [25 Pa. Code §123.43]****Measuring techniques**

Visible emissions may be measured using either of the following:

(1) A device approved by the Department and maintained to provide accurate opacity measurements.

(2) Observers, trained and certified in EPA Method 9 to measure plume opacity with the naked eye or with the aid of any device(s) approved by the Department.

011 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall conduct a weekly inspection around the facility periphery during daylight hours when the sources are in operation, to detect visible emissions, fugitive emissions, and malodorous air contaminants. These inspections are necessary to determine:

(a) The presence of visible emissions. Visible emissions may be measured according to the methods specified in Section



SECTION C. Site Level Requirements

C, Condition #010. Alternately, plant personnel who observe visible emissions may report the incidence of visible emissions to the Department within two (2) hours of the incident and make arrangements for a certified observer to measure the visible emissions.

(b) The presence of fugitive emissions beyond the property boundaries, as stated in Section C, Condition #002.

(c) The presence of odorous air contaminants beyond the property boundaries, as stated in Section C, Condition #003.

IV. RECORDKEEPING REQUIREMENTS.

012 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall maintain records of the weekly inspections referenced in Section C, Condition #011. The records shall include, at a minimum, the following informations:

- (1) The name of the company representative monitoring these instances.
- (2) The date and time of the observation.
- (3) The wind direction during each observation.
- (4) A description of any emissions and/or malodors observed and actions taken to mitigate them. If none are observed, record "NONE."

The permittee shall retain these records for a minimum of five (5) years. The records shall be made available to the Department upon its request.

V. REPORTING REQUIREMENTS.

013 [25 Pa. Code §127.442]

Reporting requirements.

The permittee shall report malfunctions to the Department. A malfunction is any sudden, infrequent, and not reasonably preventable failure of air pollution control equipment, process equipment, or a process to operate in a normal or usual manner that affects the facility's ability to comply with a permit term. Failures that are caused in part by poor maintenance or careless operation are not malfunctions. Malfunctions shall be reported as follows:

(a) Malfunctions which pose an imminent danger to public health, safety, welfare and the environment, shall be immediately reported to the Department by telephone. The telephone report of such malfunctions shall occur no later than two hours after discovery of the incident. Telephone reports can be made to the Reading District Office at (610) 916-0100 during normal business hours, or to the Department's Emergency Hotline at any time. The Emergency Hotline phone number is changed/updated periodically. The current Emergency Hotline phone number can be found at <https://www.dep.pa.gov/About/Regional/SouthcentralRegion/Pages/default.aspx>. The permittee shall submit a written report of instances of such malfunctions to the Department within three (3) days of the telephone report.

(b) Unless otherwise approved by DEP, all malfunctions shall be reported through the Department's Greenport PUP system available through: <https://greenport.pa.gov/ePermitPublicAccess/PublicSubmission/Home>

VI. WORK PRACTICE REQUIREMENTS.

014 [25 Pa. Code §123.1]

Prohibition of certain fugitive emissions

The permittee shall take all reasonable actions to prevent particulate matter from becoming airborne from any source specified in Section C, Condition #001(a)(1)-(a)(7). These actions shall include, but are not limited to the following:

- (1) Use, where possible, of water or chemicals for control of dust in the demolition of buildings or structures, construction operations, the grading of roads, or the clearing of land.
- (2) Application of asphalt, oil, water, or suitable chemicals on dirt roads, material stockpiles, and other surfaces which may give rise to airborne dusts.
- (3) Paving and maintenance of roadways.

**SECTION C. Site Level Requirements**

(4) Prompt removal of earth or other material from paved streets onto which earth or other material has been transported by trucking or earth moving equipment, erosion by water, or other means.

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

VIII. COMPLIANCE CERTIFICATION.

The permittee shall submit within thirty days of 01/01/2026 a certificate of compliance with all permit terms and conditions set forth in this Title V permit as required under condition #026 of section B of this permit, and annually thereafter.

IX. COMPLIANCE SCHEDULE.

No compliance milestones exist.

***** Permit Shield In Effect *****


**SECTION D. Source Level Requirements**

Source ID: 101

Source Name: LANDFILL GAS TREATMENT SYSTEM

Source Capacity/Throughput:

Conditions for this source occur in the following groups: GRP04

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

Pursuant to the Best Available Technology (BAT) provisions of 25 Pa. Code §127.1:

(a) The operation of the treatment system shall not result in visible fugitive emissions.

(b) The permittee shall not allow the emission into the outdoor atmosphere of any landfill gas leaks which result in concentrations of 500 ppmv or more, measured as propane (or 1375 ppmv, or more, measured as methane), at a distance of 0.5 inch from the landfill gas treatment system equipment. Nonrepeatable and momentary readings shall not be considered to be leaks, nor should measurements that have been completed during routine equipment maintenance. Routine equipment maintenance includes, but is not limited to, the following:

- (1) Gas piping repair;
- (2) Condensate trap pump repair or replacement;
- (3) Condensate pump pump-outs;
- (4) Electrical service repairs; and
- (5) Other repairs as determined by the Department.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.**# 002 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall, at a minimum, conduct leak checks weekly on the gas handling and treating equipment, that is part of the treatment system. As an alternative, monitoring of the components may be conducted using optical gas imaging (OGI). All leaks shall be fixed as soon as practical.

IV. RECORDKEEPING REQUIREMENTS.**# 003 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall record all maintenance on the treatment system and any malfunctions. The date, time, nature of the malfunction and any corrective actions shall be recorded.

004 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall record the results of all monitoring conducted on the treatment system. The report shall include at a minimum the following:

- (a) The date and time of monitoring
- (b) Results of the monitoring

**SECTION D. Source Level Requirements**

(c) Any corrective action required

005 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall record the amount of treated gas produced by the system on a monthly and 12-month rolling total basis.

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

006 [25 Pa. Code §127.441]

Operating permit terms and conditions.

(a) The permittee shall install the following measuring devices

- (1) Equipment that shows the pressure of the gas exiting the treatment system.
- (2) Equipment that shows the temperature of the gas exiting the dewatering device.
- (3) Equipment to show the pressure differential across the particulate filter.
- (4) Equipment to measure the amount of treated gas produced by the treatment system.

(b) The equipment shall be maintained at the operating ranges in accordance with the manufacturer's recommendations.

(c) The permittee may request alternative monitoring equipment. All requests shall be submitted to the Department for approval.

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

***** Permit Shield in Effect. *****

**SECTION D. Source Level Requirements**

Source ID: 102

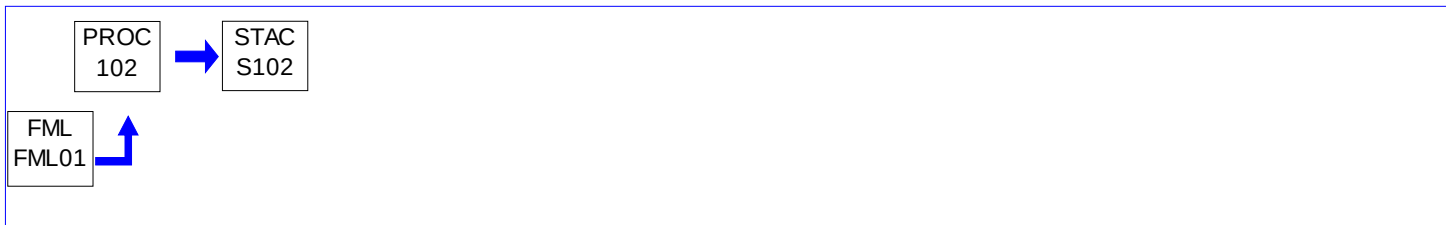
Source Name: CAT G3520C, LFG-FIRED ENGINE GEN SET NO.1

Source Capacity/Throughput:

36.000 MCF/HR

TREATED LFG

Conditions for this source occur in the following groups: GRP01
GRP02
GRP03

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

***** Permit Shield in Effect. *****

**SECTION D. Source Level Requirements**

Source ID: 103

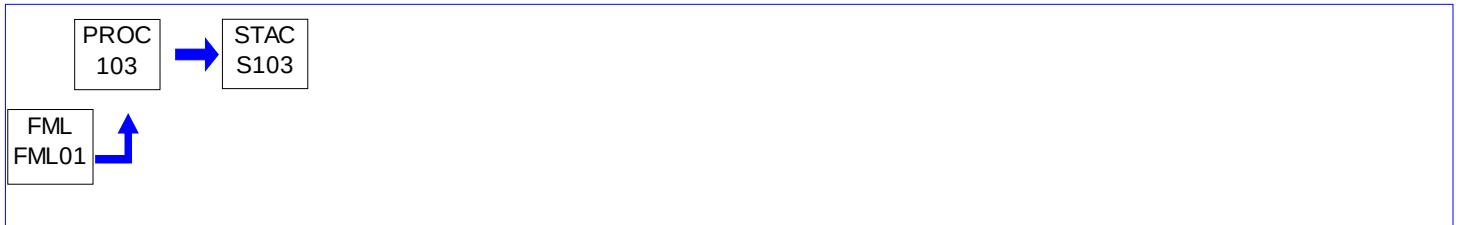
Source Name: CAT G3520C, LFG-FIRED ENGINE GEN SET NO.2

Source Capacity/Throughput:

36.000 MCF/HR

TREATED LFG

Conditions for this source occur in the following groups: GRP01
GRP02
GRP03

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

***** Permit Shield in Effect. *****

**SECTION E. Source Group Restrictions.**

Group Name: GRP01

Group Description: LFG Engine(s) - BAT Requirements

Sources included in this group

ID	Name
102	CAT G3520C, LFG-FIRED ENGINE GEN SET NO.1
103	CAT G3520C, LFG-FIRED ENGINE GEN SET NO.2

I. RESTRICTIONS.**Emission Restriction(s).****# 001 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

(a) Pursuant to the Best Available Technology (BAT) provisions of 25 Pa. Code Section 127.1, the permittee shall not allow the emission of air pollutants into the outdoor atmosphere from each engine in excess of the following limits:

- (1) Nitrogen Oxides (NO_x) - 1.0 g/hp-hr
- (2) Sulfur Oxides (SO_x) - 4.0 lb/hr
- (3) Carbon Monoxide (CO) - 3.1 g/hp-hr
- (4) Volatile Organic Compounds (VOC) - 0.15 g/hp-hr (excluding Formaldehyde)
- (5) Formaldehyde - 0.436 g/hp-hr
- (6) Particulate Matter (PM₁₀) [filterable & condensable] - 0.15 g/hp-hr

(c) Pursuant to the Best Available Technology (BAT) provisions of 25 Pa. Code Section 127.1, each engine shall achieve and maintain the less stringent of:

- (1) A destruction/removal efficiency of at least 98%, by weight, of non-methane organic compounds (NMOC); or
- (2) An outlet NMOC concentration of less than 20 parts per million, by volume, dry basis, as hexane, corrected to 3% oxygen.

(d) The permittee shall limit the visible emissions to the following:

- (1) Normal operation: 0 percent
- (2) Start-up, shutdown and malfunction:
 - (i) 20 percent or less for a period or periods aggregating more than three minutes in any one hour.
 - (ii) Less than 60 percent at any time.

II. TESTING REQUIREMENTS.**# 002 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

(a) If the permittee wishes to operate the above engine at a rate below 80 percent capacity, then the permittee shall conduct the emissions testing described in Section C, Condition #007, at the lower operating load(s) to determine compliance with Condition #001, above.

(b) The permittee may operate the engine(s) at the reduced capacity outlined in paragraph (a), upon successful demonstration of compliance with Condition #001, of this section and upon Department approval by following the procedures of Section C, Condition #007.

[NOTE: PER EMAIL DATED 6/17/24, THE FACILITY WAS APPROVED BY DEP TO OPERATE AT THE FOLLOWING REDUCED CAPACITIES AS DETERMINED BY TESTING ON 4/9/24 THRU 4/12/24: 1) Source ID 102 - 1,006 kW & 2) Source ID 103 - 1,103 kW]

III. MONITORING REQUIREMENTS.**# 003 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall, at a minimum, conduct weekly leak checks on the treated landfill gas handling and processing

**SECTION E. Source Group Restrictions.**

equipment, that is part of the facility. No leaks shall exceed 500 ppmv as propane or 1375 ppmv as methane at a distance of 0.5 inch. Non-repeatable and momentary readings shall not be considered to be leaks, nor should measurements taken during routine equipment maintenance. As an alternative, monitoring of the components may be conducted using optical gas imaging (OGI). All leaks shall be fixed as soon as practical.

IV. RECORDKEEPING REQUIREMENTS.**# 004 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

(a) The permittee shall record the following:

- (1) Monthly amount of treated landfill gas fired in the engines.
- (2) 12-month rolling total amount of treated landfill gas fired in the engines.
- (3) Monthly hours of operation.
- (4) Monthly emissions of particulate, NO_x, SO_x, CO, VOC and formaldehyde.
- (5) 12-month rolling total emissions of particulate, NO_x, SO_x, CO, VOC and formaldehyde.

(b) The permittee shall maintain the following records and make them available to the Department when requested:

- (1) The maintenance schedule.
- (2) The date of each maintenance procedures conducted on the engines.
- (3) The name of the service company and technicians for each procedure.
- (4) Any other information required by this permit.

(c) The permittee shall calculate the emissions from the above engine using the emission rates determined during the most recent performance test.

(d) The permittee shall retain these records for a minimum of five (5) years. The records shall be made available to the Department upon its request.

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

VII. ADDITIONAL REQUIREMENTS.**# 005 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

Pursuant to the Best Available Technology (BAT) provisions of 25 Pa. Code Section 127.1, the engine shall be constructed with low NO_x-emitting technology implementing lean burn combustion with automatic air to fuel (A/F) ratio control.

***** Permit Shield in Effect. *****

**SECTION E. Source Group Restrictions.**

Group Name: GRP02

Group Description: 40 CFR 60, Subpart JJJJ Engine(s)

Sources included in this group

ID	Name
102	CAT G3520C, LFG-FIRED ENGINE GEN SET NO.1
103	CAT G3520C, LFG-FIRED ENGINE GEN SET NO.2

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

VII. ADDITIONAL REQUIREMENTS.

001 [25 Pa. Code §127.441]

Operating permit terms and conditions.

Regulatory Changes

Individual sources within this source group that are subject to 40 CFR Part 60 Subpart JJJJ shall comply with all applicable requirements of the Subpart. 40 CFR 60.4(a) requires submission of copies of all requests, reports and other communications to both the Department and the EPA. The EPA copies shall be forwarded to:

Associate Director
United States Environmental Protection Agency
Region III, Enforcement & Compliance Assurance Division
Air, RCRA and Toxics Branch (3ED21)
Four Penn Center
1600 John F. Kennedy Boulevard
Philadelphia, Pennsylvania 19103-2852

Unless otherwise approved by DEP, the DEP copies shall be reported through the Department's Greenport PUP system available through: <https://greenport.pa.gov/ePermitPublicAccess/PublicSubmission/Home>

In the event that the Federal Subpart that is the subject of this Source Group is revised, the permittee shall comply with the revised version of the subpart, and shall not be required to comply with any provisions in this permit designated as having

**SECTION E. Source Group Restrictions.**

the subpart as their authority, to the extent that such permit provisions would be inconsistent with the applicable provisions of the revised subpart.

**# 002 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4230]
Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines
Am I subject to this subpart?**

60.4230(a) The provisions of this subpart are applicable to manufacturers, owners, and operators of stationary spark ignition (SI) internal combustion engines (ICE) as specified in paragraphs (a)(1) through (6) of this section. For the purposes of this subpart, the date that construction commences is the date the engine is ordered by the owner or operator.

60.4230(a)(1) - (3) [NA - NOT AN ENGINE MANUFACTURER]

60.4230(a)(4) Owners and operators of stationary SI ICE that commence construction after June 12, 2006, where the stationary SI ICE are manufactured:

60.4230(a)(4)(i) On or after July 1, 2007, for engines with a maximum engine power greater than or equal to 500 HP (except lean burn engines with a maximum engine power greater than or equal to 500 HP and less than 1,350 HP);

60.4230(a)(4)(ii) - (iii) [NA - ENGINES > 1,350 HP]

60.4230(a)(4)(iv) [NA - NOT EMERGENCY ENGINES]

60.4230(a)(5) [NA - ENGINES ARE NEW UNITS]

60.4230(a)(6) The provisions of § 60.4236 of this subpart are applicable to all owners and operators of stationary SI ICE that commence construction after June 12, 2006.

60.4230(b) [NA - ENGINES ARE NOT BEING TESTED AT AN ENGINE TEST CELL/STAND]

60.4230(c) [NA - FACILITY IS A MAJOR SOURCE]

60.4230(d) [NA - ENGINES FIRED ON LANDFILL GAS (LFG) ONLY]

60.4230(e) Stationary SI ICE may be eligible for exemption from the requirements of this subpart as described in 40 CFR part 1068, subpart C (or the exemptions described in 40 CFR parts 1048 and 1054, for engines that would need to be certified to standards in those parts), except that owners and operators, as well as manufacturers, may be eligible to request an exemption for national security.

60.4230(f) [NA - ENGINES ARE NOT A TEMPORARY REPLACEMENT UNIT]

[73 FR 3591, Jan. 18, 2008, as amended at 76 FR 37972, June 28, 2011; 86 FR 34360, June 29, 2021]

**# 003 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4231]
Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines
stationary SI internal combustion engines or equipment containing such engines?**

[NA - NOT AN ENGINE MANUFACTURER]

**# 004 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4232]
Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines
How long must my engines meet the emission standards if I am a manufacturer of stationary SI internal combustion engines?**

[NA - NOT AN ENGINE MANUFACTURER]

**# 005 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4233]
Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines
What emission standards must I meet if I am an owner or operator of a stationary SI internal combustion engine?**

60.4233(a) [NA - ENGINES > 19 KW (25 HP)]

**SECTION E. Source Group Restrictions.**

60.4233(b) - (c) [NA - STATIONARY SI ICE IS LFG FIRED]

60.4233(d) [NA - ENGINES > 75 KW (100 HP)]

60.4233(e) Owners and operators of stationary SI ICE with a maximum engine power greater than or equal to 75 KW (100 HP) (except gasoline and rich burn engines that use LPG) must comply with the emission standards in Table 1 to this subpart for their stationary SI ICE. For owners and operators of stationary SI ICE with a maximum engine power greater than or equal to 100 HP (except gasoline and rich burn engines that use LPG) manufactured prior to January 1, 2011 that were certified to the certification emission standards in 40 CFR part 1048 applicable to engines that are not severe duty engines, if such stationary SI ICE was certified to a carbon monoxide (CO) standard above the standard in Table 1 to this subpart, then the owners and operators may meet the CO certification (not field testing) standard for which the engine was certified.

TABLE 1 EMISSION STANDARDS:

Landfill/Digester Gas > 500 HP:

- (i) NO_x - 3.0 g/hp-hr (220 ppmvd at 15%O₂)
- (ii) CO - 5.0 g/hp-hr (610 ppmvd at 15%O₂)
- (iii) VOC - 1.0 g/hp-hr (80 ppmvd at 15%O₂)

END OF TABLE 1 REQUIREMENTS

60.4233(f) [NA - ENGINES ARE DEFINED AS NEW UNITS]

60.4233(g) [NA - ENGINES ARE FIRED ON LFG]

60.4233(h) [NA - NOT SUBJECT TO THE STANDARDS OF 40 CFR §1048.101]

[Amended at 76 FR page 37973, June 28, 2011]

006 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4234]
Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines
How long must I meet the emission standards if I am an owner or operator of a stationary SI internal combustion engine?

Owners and operators of stationary SI ICE must operate and maintain stationary SI ICE that achieve the emission standards as required in § 60.4233 over the entire life of the engine.

007 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4235]
Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines
What fuel requirements must I meet if I am an owner or operator of a stationary SI gasoline fired internal combustion engine subject to this subpart?

[NA - UNITS DO NOT BURN GASOLINE]

008 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4236]
Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines
What is the deadline for importing or installing stationary SI ICE produced in the previous model year?

60.4236(a) [NA - ENGINES > 500 HP]

60.4236(b) After July 1, 2009, owners and operators may not install stationary SI ICE with a maximum engine power of greater than or equal to 500 HP that do not meet the applicable requirements in § 60.4233, except that lean burn engines with a maximum engine power greater than or equal to 500 HP and less than 1,350 HP that do not meet the applicable requirements in § 60.4233 may not be installed after January 1, 2010.

60.4236(c) [NA - NOT EMERGENCY ENGINES]

60.4236(d) [NA - ENGINES > 25 HP]

60.4236(e) [NA - ENGINES NOT MODIFIED OR RECONSTRUCTED]

**SECTION E. Source Group Restrictions.**

009 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4237]
Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines
What are the monitoring requirements if I am an owner or operator of an emergency stationary SI internal combustion engine?

[NA - NOT EMERGENCY ENGINES]

010 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4243]
Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines
What are my compliance requirements if I am an owner or operator of a stationary SI internal combustion engine?

60.4243(a) [NA - ENGINES NOT SUBJECT TO THE EMISSION STANDARDS SPECIFIED IN 40 CFR §60.4233(a) THROUGH (c)]

60.4243(b) If you are an owner or operator of a stationary SI internal combustion engine and must comply with the emission standards specified in § 60.4233(d) or (e), you must demonstrate compliance according to one of the methods specified in paragraphs (b)(1) and (2) of this section.

60.4243(b)(1) [NA - STATIONARY SI ICE ARE NON-CERTIFIED ENGINES]

60.4243(b)(2) Purchasing a non-certified engine and demonstrating compliance with the emission standards specified in § 60.4233(d) or (e) and according to the requirements specified in § 60.4244, as applicable, and according to paragraphs (b)(2)(i) and (ii) of this section.

60.4243(b)(2)(i) [NA - ENGINES > 500 HP]

60.4243(b)(2)(ii) If you are an owner or operator of a stationary SI internal combustion engine greater than 500 HP, you must keep a maintenance plan and records of conducted maintenance and must, to the extent practicable, maintain and operate the engine in a manner consistent with good air pollution control practice for minimizing emissions. In addition, you must conduct an initial performance test and conduct subsequent performance testing every 8,760 hours or 3 years, whichever comes first, thereafter to demonstrate compliance.

60.4243(c) [NA - NOT SUBJECT TO § 60.4233(f)]

60.4243(d) [NA - ENGINES NOT EMERGENCY STATIONARY SI ICE]

60.4243(e) [NA - ENGINES FIRED ON LFG ONLY]

60.4243(f) [NA - ENGINES > 500 HP]

60.4243(g) [NA - ENGINES NOT EQUIPPED WITH 3-WAY CATALYST/NSCR]

60.4243(h) [NA - ENGINES MFG AFTER 7/1/08]

60.4243(i) [NA - ENGINES ARE NEW UNITS]

[73 FR 3591, Jan. 18, 2008, as amended at 76 FR 37974, June 28, 2011; 78 FR 6697, Jan. 30, 2013; 86 FR 34362, June 29, 2021]

011 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4244]
Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines
What test methods and other procedures must I use if I am an owner or operator of a stationary SI internal combustion engine?

Owners and operators of stationary SI ICE who conduct performance tests must follow the procedures in paragraphs (a) through (f) of 40 CFR §60.4244, below.

60.4244(a) Each performance test must be conducted within 10 percent of 100 percent peak (or the highest achievable) load and according to the requirements in 40 CFR §60.8 and under the specific conditions that are specified by Table 2 to 40 CFR Part 60, Subpart JJJJ.

**SECTION E. Source Group Restrictions.**

60.4244(b) You may not conduct performance tests during periods of startup, shutdown, or malfunction, as specified in 40 CFR §60.8(c). If your stationary SI internal combustion engine is non-operational, you do not need to startup the engine solely to conduct a performance test; however, you must conduct the performance test immediately upon startup of the engine.

60.4244(c) You must conduct three separate test runs for each performance test required in this section, as specified in 40 CFR §60.8(f). Each test run must be conducted within 10 percent of 100 percent peak (or the highest achievable) load and last at least 1 hour.

60.4244(d) To determine compliance with the NO_x mass per unit output emission limitation, convert the concentration of NO_x in the engine exhaust using Equation 1 of 40 CFR §60.4244, below:

$$ER = \frac{Cd \times 0.001912 \times Q \times T}{HP-hr} \quad \{\text{Equation 1}\}$$

Where:

ER = Emission rate of NO_x in g/HP-hr;

Cd = Measured NO_x concentration in parts per million by volume (ppmv);

0.001912 = Conversion constant for ppm NO_x to grams per standard cubic meter (g/scm) at 20 degrees Celsius;

Q = Stack gas volumetric flow rate, in standard cubic meter per hour, dry basis (dscm/hr);

T = Time of test run, in hours (hr); and

HP-hr = Brake work of the engine, horsepower-hour (HP-hr).

60.4244(e) To determine compliance with the CO mass per unit output emission limitation, convert the concentration of CO in the engine exhaust using Equation 2 of 40 CFR §60.4244, below:

$$ER = \frac{Cd \times 0.001164 \times Q \times T}{HP-hr} \quad \{\text{Equation 2}\}$$

Where:

ER = Emission rate of CO in g/HP-hr;

Cd = Measured CO concentration in ppmv;

0.001164 = Conversion constant for ppm CO to grams per standard cubic meter (g/scm) at 20 degrees Celsius;

Q = Stack gas volumetric flow rate, in standard cubic meters per hour, dry basis (dscm/hr);

T = Time of test run, in hours (hr); and

HP-hr = Brake work of the engine, in HP-hr.

60.4244(f) For purposes of 40 CFR Part 60, Subpart JJJJ, when calculating emissions of VOC, emissions of formaldehyde should not be included. To determine compliance with the VOC mass per unit output emission limitation, convert the concentration of VOC in the engine exhaust using Equation 3 of 40 CFR §60.4244, below:

$$ER = \frac{Cd \times 0.001833 \times Q \times T}{HP-hr} \quad \{\text{Equation 3}\}$$

Where:

ER = Emission rate of VOC in g/HP-hr;

Cd = VOC concentration measured as propane in ppmv;

0.001833 = Conversion constant for ppm VOC measured as propane, to grams per standard cubic meter (g/scm) at 20 degrees Celsius;

Q = Stack gas volumetric flow rate, in standard cubic meters per hour (scm/hr), dry basis;

T = Time of test run, in hours (hr); and

HP-hr = Brake work of the engine, in HP-hr.

60.4244(g) If the owner/operator chooses to measure VOC emissions using either Method 18 of 40 CFR Part 60, Appendix

**SECTION E. Source Group Restrictions.**

A, or Method 320 of 40 CFR Part 63, Appendix A, then it has the option of correcting the measured VOC emissions to account for the potential differences in measured values between these methods and Method 25A. The results from Method 18 and Method 320 can be corrected for response factor differences using Equations 4 and 5 of 40 CFR §60.4244, below. The corrected VOC concentration can then be placed on a propane basis using Equation 6 of 40 CFR §60.4244, below.

$$RF_i = \frac{C_{mi}}{C_{ai}} \quad \{\text{Equation 4}\}$$

Where:

RF_i = Response factor of compound i when measured with EPA Method 25A;

C_{mi} = Measured concentration of compound i, in ppmv as carbon; and

C_{ai} = True concentration of compound i, in ppmv as carbon.

$$C_{icorr} = RF_i \times C_{imeas} \quad \{\text{Equation 5}\}$$

Where:

C_{icorr} = Concentration of compound i corrected to the value that would have been measured by EPA Method 25A, in ppmv as carbon; and

C_{imeas} = Concentration of compound i measured by EPA Method 320, in ppmv as carbon.

$$C_{Peq} = 0.6098 \times C_{icorr} \quad \{\text{Equation 6}\}$$

Where:

C_{Peq} = Concentration of compound i, in mg of propane equivalent/dscm.

012 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4245]

Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines

What are my notification, reporting, and recordkeeping requirements if I am an owner or operator of a stationary SI internal combustion engine?

Owners or operators of stationary SI ICE must meet the following notification, reporting and recordkeeping requirements.

60.4245(a) Owners and operators of all stationary SI ICE must keep records of the information in paragraphs (a)(1) through (4) of this section.

60.4245(a)(1) All notifications submitted to comply with this subpart and all documentation supporting any notification.

60.4245(a)(2) Maintenance conducted on the engine.

60.4245(a)(3) [NA - ENGINES ARE NON-CERTIFIED ENGINES]

60.4245(a)(4) If the stationary SI internal combustion engine is not a certified engine or is a certified engine operating in a non-certified manner and subject to § 60.4243(a)(2), documentation that the engine meets the emission standards.

60.4245(b) [NA - NOT EMERGENCY ENGINES]

60.4245(c) [NA - INITIAL NOTIFICATION SUBMITTED 12/5/23]

60.4245(d) Owners and operators of stationary SI ICE that are subject to performance testing must submit a copy of each performance test as conducted in § 60.4244 within 60 days after the test has been completed. Performance test reports using EPA Method 18, EPA Method 320, or ASTM D6348-03 (incorporated by reference - see 40 CFR 60.17) to measure VOC require reporting of all QA/QC data. For Method 18, report results from sections 8.4 and 11.1.1.4; for Method 320, report results from sections 8.6.2, 9.0, and 13.0; and for ASTM D6348-03 report results of all QA/QC procedures in Annexes 1-7.

60.4245(e) [NA - NOT EMERGENCY ENGINES]

**SECTION E. Source Group Restrictions.**

60.4245(f) Beginning on February 26, 2025, within 60 days after the date of completing each performance test, you must submit the results following the procedures specified in paragraph (g) of this section. Data collected using test methods that are supported by the EPA's Electronic Reporting Tool (ERT) as listed on the EPA's ERT website (<https://www.epa.gov/electronic-reporting-air-emissions/electronic-reporting-tool-ert>) at the time of the test must be submitted in a file format generated using the EPA's ERT. Alternatively, you may submit an electronic file consistent with the extensible markup language (XML) schema listed on the EPA's ERT website. Data collected using test methods that are not supported by the EPA's ERT as listed on the EPA's ERT website at the time of the test must be included as an attachment in the ERT or an alternate electronic file.

60.4245(g) If you are required to submit notifications or reports following the procedure specified in this paragraph (g), you must submit notifications or reports to the EPA via the Compliance and Emissions Data Reporting Interface (CEDRI), which can be accessed through the EPA's Central Data Exchange (CDX) (<https://cdx.epa.gov/>). The EPA will make all the information submitted through CEDRI available to the public without further notice to you. Do not use CEDRI to submit information you claim as CBI. Although we do not expect persons to assert a claim of CBI, if you wish to assert a CBI claim for some of the information in the report or notification, you must submit a complete file in the format specified in this subpart, including information claimed to be CBI, to the EPA following the procedures in paragraphs (g)(1) and (2) of this section. Clearly mark the part or all of the information that you claim to be CBI. Information not marked as CBI may be authorized for public release without prior notice. Information marked as CBI will not be disclosed except in accordance with procedures set forth in 40 CFR part 2. All CBI claims must be asserted at the time of submission. Anything submitted using CEDRI cannot later be claimed CBI. Furthermore, under CAA section 114(c), emissions data is not entitled to confidential treatment, and the EPA is required to make emissions data available to the public. Thus, emissions data will not be protected as CBI and will be made publicly available. You must submit the same file submitted to the CBI office with the CBI omitted to the EPA via the EPA's CDX as described earlier in this paragraph (g).

60.4245(g)(1) The preferred method to receive CBI is for it to be transmitted electronically using email attachments, File Transfer Protocol, or other online file sharing services. Electronic submissions must be transmitted directly to the OAQPS CBI Office at the email address oaqpscbi@epa.gov, and as described in paragraph (g) of this section, should include clear CBI markings. ERT files should be flagged to the attention of the Group Leader, Measurement Policy Group; all other files should be flagged to the attention of the Stationary Spark Ignition Internal Combustion Engine Sector Lead. If assistance is needed with submitting large electronic files that exceed the file size limit for email attachments, and if you do not have your own file sharing service, please email oaqpscbi@epa.gov to request a file transfer link.

60.4245(g)(2) If you cannot transmit the file electronically, you may send CBI information through the postal service to the following address: OAQPS Document Control Officer (C404-02), OAQPS, U.S. Environmental Protection Agency, 109 T.W. Alexander Drive, P.O. Box 12055, Research Triangle Park, North Carolina 27711. ERT files should be sent to the attention of the Group Leader, Measurement Policy Group, and all other files should be sent to the attention of the Stationary Spark Ignition Internal Combustion Engine Sector Lead. The mailed CBI material should be double wrapped and clearly marked. Any CBI markings should not show through the outer envelope.

60.4245(h) If you are required to electronically submit a report through CEDRI in the EPA's CDX, you may assert a claim of EPA system outage for failure to timely comply with that reporting requirement. To assert a claim of EPA system outage, you must meet the requirements outlined in paragraphs (h)(1) through (7) of this section.

60.4245(h)(1) You must have been or will be precluded from accessing CEDRI and submitting a required report within the time prescribed due to an outage of either the EPA's CEDRI or CDX systems.

60.4245(h)(2) The outage must have occurred within the period of time beginning five business days prior to the date that the submission is due.

60.4245(h)(3) The outage may be planned or unplanned.

60.4245(h)(4) You must submit notification to the Administrator in writing as soon as possible following the date you first knew, or through due diligence should have known, that the event may cause or has caused a delay in reporting.

60.4245(h)(5) You must provide to the Administrator a written description identifying:

60.4245(h)(5)(i) The date(s) and time(s) when CDX or CEDRI was accessed and the system was unavailable;

**SECTION E. Source Group Restrictions.**

60.4245(h)(5)(ii) A rationale for attributing the delay in reporting beyond the regulatory deadline to EPA system outage;

60.4245(h)(5)(iii) A description of measures taken or to be taken to minimize the delay in reporting; and

60.4245(h)(5)(iv) The date by which you propose to report, or if you have already met the reporting requirement at the time of the notification, the date you reported.

60.4245(h)(6) The decision to accept the claim of EPA system outage and allow an extension to the reporting deadline is solely within the discretion of the Administrator.

60.4245(h)(7) In any circumstance, the report must be submitted electronically as soon as possible after the outage is resolved.

60.4245(i) If you are required to electronically submit a report through CEDRI in the EPA's CDX, you may assert a claim of force majeure for failure to timely comply with that reporting requirement. To assert a claim of force majeure, you must meet the requirements outlined in paragraphs (i)(1) through (5) of this section.

60.4245(i)(1) You may submit a claim if a force majeure event is about to occur, occurs, or has occurred or there are lingering effects from such an event within the period of time beginning five business days prior to the date the submission is due. For the purposes of this section, a force majeure event is defined as an event that will be or has been caused by circumstances beyond the control of the affected facility, its contractors, or any entity controlled by the affected facility that prevents you from complying with the requirement to submit a report electronically within the time period prescribed. Examples of such events are acts of nature (e.g., hurricanes, earthquakes, or floods), acts of war or terrorism, or equipment failure or safety hazard beyond the control of the affected facility (e.g., large scale power outage).

60.4245(i)(2) You must submit notification to the Administrator in writing as soon as possible following the date you first knew, or through due diligence should have known, that the event may cause or has caused a delay in reporting.

60.4245(i)(3) You must provide to the Administrator:

60.4245(i)(3)(i) A written description of the force majeure event;

60.4245(i)(3)(ii) A rationale for attributing the delay in reporting beyond the regulatory deadline to the force majeure event;

60.4245(i)(3)(iii) A description of measures taken or to be taken to minimize the delay in reporting; and

60.4245(i)(3)(iv) The date by which you propose to report, or if you have already met the reporting requirement at the time of the notification, the date you reported.

60.4245(i)(4) The decision to accept the claim of force majeure and allow an extension to the reporting deadline is solely within the discretion of the Administrator.

60.4245(i)(5) In any circumstance, the reporting must occur as soon as possible after the force majeure event occurs.

60.4245(j) Any records required to be maintained by this subpart that are submitted electronically via the EPA's CEDRI may be maintained in electronic format. This ability to maintain electronic copies does not affect the requirement for facilities to make records, data, and reports available upon request to a delegated air agency or the EPA as part of an on-site compliance evaluation.

[73 FR 3591, Jan. 18, 2008, as amended at 73 FR 59177, Oct. 8, 2008; 78 FR 6697, Jan. 30, 2013; 81 FR 59809, Aug. 30, 2016; 86 FR 34362, June 29, 2021; 87 FR 48606, Aug. 10, 2022; 89 FR 70514, Aug. 30, 2024]

013 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4246]
Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines
What parts of the General Provisions apply to me?

60.4246(a) Table 3 to this subpart shows which parts of the General Provisions in §§ 60.1 through 60.19 apply to you.

**SECTION E. Source Group Restrictions.**

60.4246(b) The provisions of 40 CFR 1068.10 and 1068.11 apply for engine manufacturers. For others, the general confidential business information (CBI) provisions apply as described in 40 CFR part 2.

[88 FR 4471, Jan. 24, 2023]

***** Permit Shield in Effect. *****

**SECTION E. Source Group Restrictions.**

Group Name: GRP03

Group Description: 40 CFR 63, Subpart ZZZZ Engine(s)

Sources included in this group

ID	Name
102	CAT G3520C, LFG-FIRED ENGINE GEN SET NO.1
103	CAT G3520C, LFG-FIRED ENGINE GEN SET NO.2

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

VII. ADDITIONAL REQUIREMENTS.**# 001 [25 Pa. Code §127.441]****Operating permit terms and conditions.****Regulatory Changes**

Individual sources within this source group that are subject to 40 CFR Part 63 Subpart ZZZZ shall comply with all applicable requirements of the Subpart. 40 CFR 63.13(a) requires submission of copies of all requests, reports and other communications to both the Department and the EPA. The EPA copies shall be forwarded to:

Associate Director
United States Environmental Protection Agency
Region III, Enforcement & Compliance Assurance Division
Air, RCRA and Toxics Branch (3ED21)
Four Penn Center
1600 John F. Kennedy Boulevard
Philadelphia, Pennsylvania 19103-2852

Unless otherwise approved by DEP, the DEP copies shall be reported through the Department's Greenport PUP system available through: <https://greenport.pa.gov/ePermitPublicAccess/PublicSubmission/Home>

In the event that the Federal Subpart that is the subject of this Source Group is revised, the permittee shall comply with the revised version of the subpart, and shall not be required to comply with any provisions in this permit designated as having

**SECTION E. Source Group Restrictions.**

the subpart as their authority, to the extent that such permit provisions would be inconsistent with the applicable provisions of the revised subpart.

002 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6590]**Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines****What parts of my plant does this subpart cover?**

63.6590(b)(2) A new or reconstructed stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions which combusts landfill or digester gas equivalent to 10 percent or more of the gross heat input on an annual basis must meet the initial notification requirements of § 63.6645(f) and the requirements of §§ 63.6625(c), 63.6650(g), and 63.6655(c). These stationary RICE do not have to meet the emission limitations and operating limitations of this subpart.

[69 FR 33506, June 15, 2004, as amended at 73 FR 3604, Jan. 18, 2008; 75 FR 9674, Mar. 3, 2010; 75 FR 37733, June 30, 2010; 75 FR 51588, Aug. 20, 2010; 78 FR 6700, Jan. 30, 2013; 87 FR 48607, Aug. 10, 2022]

003 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6625]**Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines****What are my monitoring, installation, operation, and maintenance requirements?**

63.6625(c) If you are operating a new or reconstructed stationary RICE which fires landfill gas or digester gas equivalent to 10 percent or more of the gross heat input on an annual basis, you must monitor and record your fuel usage daily with separate fuel meters to measure the volumetric flow rate of each fuel. In addition, you must operate your stationary RICE in a manner which reasonably minimizes HAP emissions.

[69 FR 33506, June 15, 2004, as amended at 73 FR 3606, Jan. 18, 2008; 75 FR 9676, Mar. 3, 2010; 75 FR 51589, Aug. 20, 2010; 76 FR 12866, Mar. 9, 2011; 78 FR 6703, Jan. 30, 2013; 89 FR 70516, Aug. 30, 2024]

004 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6645]**Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines****What notifications must I submit and when?**

63.6645(f) [NA - INITIAL NOTIFICATION SUBMITTED 12/5/23]

005 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6650]**Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines****What reports must I submit and when?**

63.6650(g) If you are operating as a new or reconstructed stationary RICE which fires landfill gas or digester gas equivalent to 10 percent or more of the gross heat input on an annual basis, you must submit an annual report according to Table 7 of this subpart by the date specified unless the Administrator has approved a different schedule, according to the information described in paragraphs (b)(1) through (b)(5) of this section. You must report the data specified in (g)(1) through (g)(3) of this section.

63.6650(g)(1) Fuel flow rate of each fuel and the heating values that were used in your calculations. You must also demonstrate that the percentage of heat input provided by landfill gas or digester gas is equivalent to 10 percent or more of the total fuel consumption on an annual basis.

63.6650(g)(2) The operating limits provided in your federally enforceable permit, and any deviations from these limits.

63.6650(g)(3) Any problems or errors suspected with the meters.

[69 FR 33506, June 15, 2004, as amended at 75 FR 9677, Mar. 3, 2010; 78 FR 6705, Jan. 30, 2013; 87 FR 48607, Aug. 10, 2022; 89 FR 70517, Aug. 30, 2024]

006 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6655]**Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines**

**SECTION E. Source Group Restrictions.****What records must I keep?**

63.6655(c) If you are operating a new or reconstructed stationary RICE which fires landfill gas or digester gas equivalent to 10 percent or more of the gross heat input on an annual basis, you must keep the records of your daily fuel usage monitors.

[69 FR 33506 preview citation details, June 15, 2004, as amended at 75 FR 9678, Mar. 3, 2010; 75 FR 51592, Aug. 20, 2010; 78 FR 6706, Jan. 30, 2013; 87 FR 48607, Aug. 10, 2022; 89 FR 70518, Aug. 30, 2024]

***** Permit Shield in Effect. *****

**SECTION E. Source Group Restrictions.**

Group Name: GRP04

Group Description: 40 CFR 63, Subpart AAAA Sources

Sources included in this group

ID	Name
101	LANDFILL GAS TREATMENT SYSTEM

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

VII. ADDITIONAL REQUIREMENTS.**# 001 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

Individual sources within this source group that are subject to 40 CFR 63 Subpart AAAA - National Emission Standards for Hazardous Air Pollutants: Municipal Solid Waste Landfills shall comply with all applicable requirements of the Subpart. 40 CFR 63.13(a) requires submission of copies of all requests, reports and other communications to both the Department and the EPA. The EPA copies shall be forwarded to:

Associate Director
United States Environmental Protection Agency
Region III, Enforcement & Compliance Assurance Division
Air, RCRA and Toxics Branch (3ED21)
Four Penn Center
1600 John F. Kennedy Boulevard
Philadelphia, Pennsylvania 19103-2852

Unless otherwise approved by DEP, the DEP copies shall be reported through the Department's Greenport PUP system available through: <https://greenport.pa.gov/ePermitPublicAccess/PublicSubmission/Home>

In the event that the Federal Subpart that is the subject of this Source Group is revised, the permittee shall comply with the revised version of the subpart, and shall not be required to comply with any provisions in this permit designated as having the subpart as their authority, to the extent that such permit provisions would be inconsistent with the applicable provisions

**SECTION E. Source Group Restrictions.**

of the revised subpart.

002 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.1959]**Subpart AAAA - National Emission Standards for Hazardous Air Pollutants: Municipal Solid Waste Landfills NMOC calculation procedures.**

63.1959(b) Each owner or operator of an affected source having a design capacity equal to or greater than 2.5 million Mg and 2.5 million m³ must either comply with paragraph (b)(2) of this section or calculate an NMOC emission rate for the landfill using the procedures specified in paragraph (a) of this section. The NMOC emission rate must be recalculated annually, except as provided in § 63.1981(c)(1)(ii)(A). [FACILITY ONLY REQUIRED TO COMPLY WITH TREATMENT AND CONTROL SYSTEM REQUIREMENTS]

63.1959(b)(1) [NA - LANDFILL SUPPLYING LFG IS > 50 Mg/yr]

63.1959(b)(2) If the calculated NMOC emission rate is equal to or greater than 50 Mg/yr using Tier 1, 2, or 3 procedures, the owner or operator must either: [FACILITY OPERATES TREATMENT SYSTEM AND NOT THE LANDFILL/ENCLOSED FLARE]

63.1959(b)(2)(i)-(ii) [NA - FACILITY DOES NOT OPERATE THE COLLECTION SYSTEM]

63.1959(b)(2)(iii) Control system. Route all the collected gas to a control system that complies with the requirements in either paragraph (b)(2)(iii)(A), (B), or (C) of this section.

63.1959(b)(2)(iii)(A) [FACILITY OPERATES TREATMENT SYSTEM AND NOT THE LANDFILL/ENCLOSED FLARE]

63.1959(b)(2)(iii)(B) A control system designed and operated to reduce NMOC by 98 weight-percent, or, when an enclosed combustion device is used for control, to either reduce NMOC by 98 weight-percent or reduce the outlet NMOC concentration to less than 20 ppmv, dry basis as hexane at 3-percent oxygen. The reduction efficiency or ppmv must be established by an initial performance test to be completed no later than 180 days after the initial startup of the approved control system using the test methods specified in paragraph (e) of this section. The performance test is not required for boilers and process heaters with design heat input capacities equal to or greater than 44 megawatts that burn landfill gas for compliance with this subpart. [CONTROL SYSTEM OWNED AND OPERATED BY WESTERN BERKS LANDFILL UNDER TV 06-05112]

63.1959(b)(2)(iii)(C) A treatment system that processes the collected gas for subsequent sale or beneficial use such as fuel for combustion, production of vehicle fuel, production of high-British thermal unit (Btu) gas for pipeline injection, or use as a raw material in a chemical manufacturing process. Venting of treated landfill gas to the ambient air is not allowed. If the treated landfill gas cannot be routed for subsequent sale or beneficial use, then the treated landfill gas must be controlled according to either paragraph (b)(2)(iii)(A) or (B) of this section.

63.1959(b)(2)(iii)(D) All emissions from any atmospheric vent from the gas treatment system are subject to the requirements of paragraph (b)(2)(iii)(A) or (B) of this section. For purposes of this subpart, atmospheric vents located on the condensate storage tank are not part of the treatment system and are exempt from the requirements of paragraph (b)(2)(iii)(A) or (B) of this section.

[85 FR 17261, Mar. 26, 2020, as amended at 85 FR 64400, Oct. 13, 2020]

003 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.1961]**Subpart AAAA - National Emission Standards for Hazardous Air Pollutants: Municipal Solid Waste Landfills Monitoring of operations.**

63.1961(g) Each owner or operator seeking to demonstrate compliance with § 63.1959(b)(2)(iii)(C) using a landfill gas treatment system must calibrate, maintain, and operate according to the manufacturer's specifications a device that records flow to the treatment system and bypass of the treatment system (if applicable). Beginning no later than September 27, 2021, each owner or operator must maintain and operate all monitoring systems associated with the treatment system in accordance with the site-specific treatment system monitoring plan required in § 63.1983(b)(5)(ii). The owner or operator must:

**SECTION E. Source Group Restrictions.**

63.1961(g)(1) Install, calibrate, and maintain a gas flow rate measuring device that records the flow to the treatment system at least every 15 minutes; and

63.1961(g)(2) Secure the bypass line valve in the closed position with a car-seal or a lock-and-key type configuration. A visual inspection of the seal or closure mechanism must be performed at least once every month to ensure that the valve is maintained in the closed position and that the gas flow is not diverted through the bypass line.

63.1961(h) The monitoring requirements of paragraphs (a), (b), (c), (d), and (g) of this section apply at all times the affected source is operating, except for periods of monitoring system malfunctions, repairs associated with monitoring system malfunctions, and required monitoring system quality assurance or quality control activities. A monitoring system malfunction is any sudden, infrequent, not reasonably preventable failure of the monitoring system to provide valid data. Monitoring system failures that are caused in part by poor maintenance or careless operation are not malfunctions. You are required to complete monitoring system repairs in response to monitoring system malfunctions and to return the monitoring system to operation as expeditiously as practicable. Where an owner or operator subject to the provisions of this subpart seeks to demonstrate compliance with the temperature and nitrogen or oxygen operational standards in introductory paragraph § 63.1958(c)(1), (d)(2), and (e)(1), the standards apply at all times.

[85 FR 17261, Mar. 26, 2020, as amended at 85 FR 64401, Oct. 13, 2020; 87 FR 8203, Feb. 14, 2022]

004 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.1981]

Subpart AAAA - National Emission Standards for Hazardous Air Pollutants: Municipal Solid Waste Landfills
What reports must I submit?

63.1981(h) Semi-annual report. The owner or operator of a landfill seeking to comply with § 63.1959(b)(2) using an active collection system designed in accordance with § 63.1959(b)(2)(ii) must submit to the Administrator semi-annual reports. Beginning no later than September 27, 2021, you must submit the report, following the procedure specified in paragraph (l) of this section. The initial report must be submitted within 180 days of installation and startup of the collection and control system and must include the initial performance test report required under § 63.7 of subpart A, as applicable. In the initial report, the process unit(s) tested, the pollutant(s) tested, and the date that such performance test was conducted may be submitted in lieu of the performance test report if the report has been previously submitted to the EPA's CDX. For enclosed combustion devices and flares, reportable exceedances are defined under § 63.1983(c). The semi-annual reports must contain the information in paragraphs (h)(1) through (8) of this section.

63.1981(h)(1) Number of times that applicable parameters monitored under § 63.1958(b), (c), and (d) were exceeded and when the gas collection and control system was not operating under § 63.1958(e), including periods of SSM. For each instance, report the date, time, and duration of each exceedance.

63.1981(h)(1)(i) - (ii) [NA - APPLIES TO COLLECTION & CONTROL SYSTEM]

63.1981(h)(1)(iii) Beginning no later than September 27, 2021, number of times the parameters for the site-specific treatment system in § 63.1961(g) were exceeded.

63.1981(h)(2) Description and duration of all periods when the gas stream was diverted from the control device or treatment system through a bypass line or the indication of bypass flow as specified under § 63.1961.

63.1981(h)(3) Description and duration of all periods when the control device or treatment system was not operating and length of time the control device or treatment system was not operating.

63.1981(h)(4)-(8) [NA - FACILITY DOES NOT OPERATE THE COLLECTION SYSTEM]

63.1981(l) Electronic reporting. Beginning no later than September 27, 2021, the owner or operator must submit reports electronically according to paragraphs (l)(1) and (2) of this section.

63.1981(l)(1) Within 60 days after the date of completing each performance test required by this subpart, you must submit the results of the performance test following the procedures specified in paragraphs (l)(1)(i) through (iii) of this section.

63.1981(l)(1)(i) Data collected using test methods supported by the EPA's Electronic Reporting Tool (ERT) as listed on the EPA's ERT website (<https://www.epa.gov/electronic-reporting-air-emissions/electronic-reporting-tool-ert>) at the time of

**SECTION E. Source Group Restrictions.**

the test. Submit the results of the performance test to the EPA via the Compliance and Emissions Data Reporting Interface (CEDRI), which can be accessed through the EPA's CDX (<https://cdx.epa.gov/>). The data must be submitted in a file format generated through the use of the EPA's ERT. Alternatively, you may submit an electronic file consistent with the extensible markup language (XML) schema listed on the EPA's ERT website.

63.1981(l)(1)(ii) Data collected using test methods that are not supported by the EPA's ERT as listed on the EPA's ERT website at the time of the test. The results of the performance test must be included as an attachment in the ERT or an alternate electronic file consistent with the XML schema listed on the EPA's ERT website. Submit the ERT generated package or alternative file to the EPA via CEDRI.

63.1981(l)(1)(iii) Confidential business information (CBI). If you claim some of the information submitted under paragraph (a) of this section is CBI, you must submit a complete file, including information claimed to be CBI, to the EPA. The file must be generated through the use of the EPA's ERT or an alternate electronic file consistent with the XML schema listed on the EPA's ERT website. Submit the file on a compact disc, flash drive, or other commonly used electronic storage medium and clearly mark the medium as CBI. Mail the electronic medium to U.S. EPA/OAQPS/CORE CBI Office, Attention: Group Leader, Measurement Policy Group, MD C404-02, 4930 Old Page Rd., Durham, NC 27703. The same file with the CBI omitted must be submitted to the EPA via the EPA's CDX as described in paragraph (l)(1)(i) of this section.

63.1981(l)(2) Each owner or operator required to submit reports following the procedure specified in this paragraph must submit reports to the EPA via CEDRI. CEDRI can be accessed through the EPA's CDX. The owner or operator must use the appropriate electronic report in CEDRI for this subpart or an alternate electronic file format consistent with the XML schema listed on the CEDRI website (<https://www.epa.gov/electronic-reporting-air-emissions/compliance-and-emissions-data-reporting-interface-cedri>). Once the spreadsheet template upload/forms for the reports have been available in CEDRI for 90 days, the owner or operator must begin submitting all subsequent reports via CEDRI. The reports must be submitted by the deadlines specified in this subpart, regardless of the method in which the reports are submitted. The NMOC emission rate reports, semi-annual reports, and bioreactor 40-percent moisture reports should be electronically reported as a spreadsheet template upload/form to CEDRI. If the reporting forms specific to this subpart are not available in CEDRI at the time that the reports are due, the owner or operator must submit the reports to the Administrator at the appropriate address listed in § 63.13 of subpart A.

63.1981(m) Claims of EPA system outage. Beginning no later than September 27, 2021, if you are required to electronically submit a report through CEDRI in the EPA's CDX, you may assert a claim of EPA system outage for failure to comply timely with the reporting requirement. To assert a claim of EPA system outage, you must meet the following requirements:

63.1981(m)(1) You must have been or will be precluded from accessing CEDRI and submitting a required report within the time prescribed due to an outage of either the EPA's CEDRI or CDX systems.

63.1981(m)(2) The outage must have occurred within the period of time beginning 5 business days prior to the date that the submission is due.

63.1981(m)(3) The outage may be planned or unplanned.

63.1981(m)(4) You must submit notification to the Administrator in writing as soon as possible following the date you first knew, or through due diligence should have known, that the event may cause or has caused a delay in reporting.

63.1981(m)(5) You must provide to the Administrator a written description identifying:

63.1981(m)(5)(i) The date(s) and time(s) when CDX or CEDRI was accessed and the system was unavailable;

63.1981(m)(5)(ii) A rationale for attributing the delay in reporting beyond the regulatory deadline to EPA system outage;

63.1981(m)(5)(iii) Measures taken or to be taken to minimize the delay in reporting; and

63.1981(m)(5)(iv) The date by which you propose to report, or if you have already met the reporting requirement at the time of the notification, the date you reported.

63.1981(m)(6) The decision to accept the claim of EPA system outage and allow an extension to the reporting deadline is

**SECTION E. Source Group Restrictions.**

solely within the discretion of the Administrator.

63.1981(m)(7) In any circumstance, the report must be submitted electronically as soon as possible after the outage is resolved.

63.1981(n) Claims of force majeure. Beginning no later than September 27, 2021, if you are required to electronically submit a report through CEDRI in the EPA's CDX, you may assert a claim of force majeure for failure to comply timely with the reporting requirement. To assert a claim of force majeure, you must meet the following requirements:

63.1981(n)(1) You may submit a claim if a force majeure event is about to occur, occurs, or has occurred or there are lingering effects from such an event within the period of time beginning 5 business days prior to the date the submission is due. For the purposes of this section, a force majeure event is defined as an event that will be or has been caused by circumstances beyond the control of the affected facility, its contractors, or any entity controlled by the affected facility that prevents you from complying with the requirement to submit a report electronically within the time period prescribed. Examples of such events are acts of nature (e.g., hurricanes, earthquakes, or floods), acts of war or terrorism, or equipment failure or safety hazard beyond the control of the affected facility (e.g., large scale power outage).

63.1981(n)(2) You must submit notification to the Administrator in writing as soon as possible following the date you first knew, or through due diligence should have known, that the event may cause or has caused a delay in reporting.

63.1981(n)(3) You must provide to the Administrator:

63.1981(n)(3)(i) A written description of the force majeure event;

63.1981(n)(3)(ii) A rationale for attributing the delay in reporting beyond the regulatory deadline to the force majeure event;

63.1981(n)(3)(iii) Measures taken or to be taken to minimize the delay in reporting; and

63.1981(n)(3)(iv) The date by which you propose to report, or if you have already met the reporting requirement at the time of the notification, the date you reported.

63.1981(n)(4) The decision to accept the claim of force majeure and allow an extension to the reporting deadline is solely within the discretion of the Administrator.

63.1981(n)(5) In any circumstance, the reporting must occur as soon as possible after the force majeure event occurs.

[85 FR 17261, Mar. 26, 2020, as amended at 87 FR 8204, Feb. 14, 2022]

005 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.1983]

Subpart AAAA - National Emission Standards for Hazardous Air Pollutants: Municipal Solid Waste Landfills

What records must I keep?

63.1983(b)(5) Where an owner or operator subject to the provisions of this subpart seeks to demonstrate compliance with § 63.1959(b)(2)(iii)(C) through use of a landfill gas treatment system:

63.1983(b)(5)(i) Bypass records. Records of the flow of landfill gas to, and bypass of, the treatment system.

63.1983(b)(5)(ii) Site-specific treatment monitoring plan. Beginning no later than September 27, 2021, the owner or operator must prepare a site-specific treatment monitoring plan to include:

63.1983(b)(5)(ii)(A) Monitoring records of parameters that are identified in the treatment system monitoring plan and that ensure the treatment system is operating properly for each intended end use of the treated landfill gas. At a minimum, records should include records of filtration, de-watering, and compression parameters that ensure the treatment system is operating properly for each intended end use of the treated landfill gas.

63.1983(b)(5)(ii)(B) Monitoring methods, frequencies, and operating ranges for each monitored operating parameter based on manufacturer's recommendations or engineering analysis for each intended end use of the treated landfill gas.

**SECTION E. Source Group Restrictions.**

63.1983(b)(5)(ii)(C) Documentation of the monitoring methods and ranges, along with justification for their use.

63.1983(b)(5)(ii)(D) List of responsible staff (by job title) for data collection.

63.1983(b)(5)(ii)(E) Processes and methods used to collect the necessary data.

63.1983(b)(5)(ii)(F) Description of the procedures and methods that are used for quality assurance, maintenance, and repair of all continuous monitoring systems (CMS).

[85 FR 17261, Mar. 26, 2020, as amended at 85 FR 64401, Oct. 13, 2020]

006 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.1985]

Subpart AAAA - National Emission Standards for Hazardous Air Pollutants: Municipal Solid Waste Landfills
Who enforces this subpart?

63.1985(a) This subpart can be implemented and enforced by the EPA, or a delegated authority such as the applicable state, local, or tribal agency. If the EPA Administrator has delegated authority to a state, local, or tribal agency, then that agency as well as the EPA has the authority to implement and enforce this subpart. Contact the applicable EPA Regional office to find out if this subpart is delegated to a state, local, or tribal agency.

63.1985(b) In delegating implementation and enforcement authority of this subpart to a state, local, or tribal agency under subpart E of this part, the authorities contained in paragraph (c) of this section are retained by the EPA Administrator and are not transferred to the state, local, or tribal agency.

63.1985(c) The authorities that will not be delegated to state, local, or tribal agencies are as follows. Approval of alternatives to the emission standards in §§ 63.1955 through 63.1962. Where this subpart references part 60, subpart WWW of this subchapter, the cited provisions will be delegated according to the delegation provisions of part 60, subpart WWW of this subchapter. For this subpart, the EPA also retains the authority to approve methods for determining the NMOC concentration in § 63.1959(a)(3) and the method for determining the site-specific methane generation rate constant k in § 63.1959(a)(4).

[85 FR 17261, Mar. 26, 2020, as amended at 87 FR 8204, Feb. 14, 2022]

***** Permit Shield in Effect. *****

**SECTION F. Alternative Operation Requirements.**

No Alternative Operations exist for this Title V facility.

**SECTION G. Emission Restriction Summary.**

No emission restrictions listed in this section of the permit.

**SECTION H. Miscellaneous.**

#001

This permit includes the sources, conditions and operating requirements of Plan Approval No. 06-05160A. This permit supersedes that permit.

#002

Source ID 102, CAT G3520C, LFG-Fired Engine Gen Set No.1, consists of a 2,233 bhP (1,500 kW) Caterpillar C3520C engine. The engine was derated to 1,500 kW.

#003

Source ID 103, CAT G3520C, LFG-Fired Engine Gen Set No.2, consists of a 2,233 bhP (1,500 kW) Caterpillar C3520C engine. The engine was derated to 1,500 kW.



***** End of Report *****
