



SECTION A. Table of Contents

Section A. Facility/Source Identification

Table of Contents
Site Inventory List

Section B. General State Only Requirements

- #001 Definitions.
- #002 Operating Permit Duration.
- #003 Permit Renewal.
- #004 Operating Permit Fees under Subchapter I.
- #005 Transfer of Operating Permits.
- #006 Inspection and Entry.
- #007 Compliance Requirements.
- #008 Need to Halt or Reduce Activity Not a Defense.
- #009 Duty to Provide Information.
- #010 Revising an Operating Permit for Cause.
- #011 Operating Permit Modifications
- #012 Severability Clause.
- #013 De Minimis Emission Increases.
- #014 Operational Flexibility.
- #015 Reactivation of Sources
- #016 Health Risk-based Emission Standards and Operating Practice Requirements.
- #017 Circumvention.
- #018 Reporting Requirements.
- #019 Sampling, Testing and Monitoring Procedures.
- #020 Recordkeeping.
- #021 Property Rights.
- #022 Alternative Operating Scenarios.
- #023 Prohibition of Air Pollution
- #024 Reporting
- #025 Report Format

Section C. Site Level State Only Requirements

- C-I: Restrictions
- C-II: Testing Requirements
- C-III: Monitoring Requirements
- C-IV: Recordkeeping Requirements
- C-V: Reporting Requirements
- C-VI: Work Practice Standards
- C-VII: Additional Requirements
- C-VIII: Compliance Certification
- C-IX: Compliance Schedule

Section D. Source Level State Only Requirements

- D-I: Restrictions
- D-II: Testing Requirements
- D-III: Monitoring Requirements
- D-IV: Recordkeeping Requirements
- D-V: Reporting Requirements
- D-VI: Work Practice Standards
- D-VII: Additional Requirements

Note: These same sub-sections are repeated for each source!

Section E. Source Group Restrictions



SECTION A. Table of Contents

- E-I: Restrictions
- E-II: Testing Requirements
- E-III: Monitoring Requirements
- E-IV: Recordkeeping Requirements
- E-V: Reporting Requirements
- E-VI: Work Practice Standards
- E-VII: Additional Requirements

Section F. Alternative Operating Scenario(s)

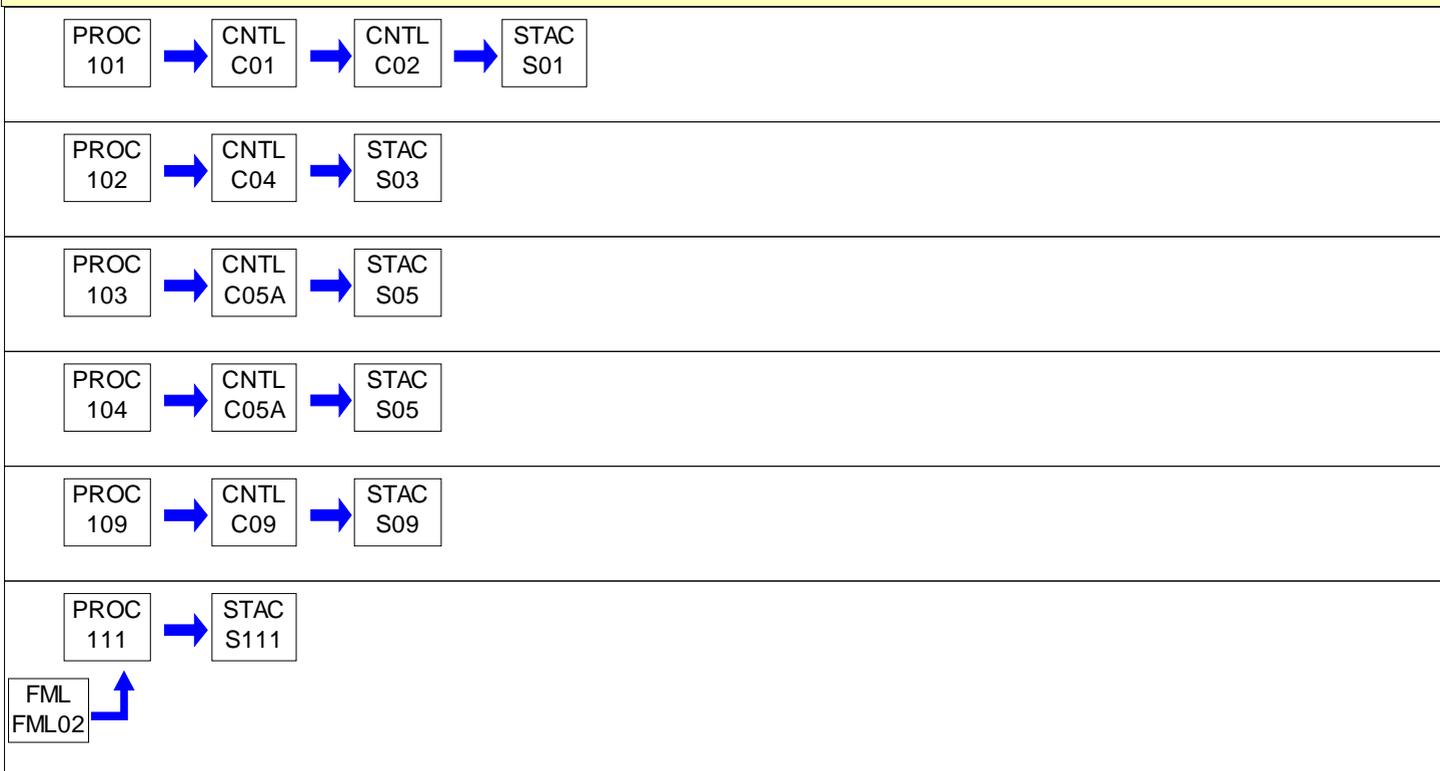
- F-I: Restrictions
- F-II: Testing Requirements
- F-III: Monitoring Requirements
- F-IV: Recordkeeping Requirements
- F-V: Reporting Requirements
- F-VI: Work Practice Standards
- F-VII: Additional Requirements

Section G. Emission Restriction Summary

Section H. Miscellaneous


**SECTION A. Site Inventory List**

Source ID	Source Name	Capacity/Throughput	Fuel/Material
101	PRIMARY CLARIFIERS		
102	SLUDGE DIGESTION		
103	SOLIDS HOLDING TANKS		
104	SOLIDS HANDLING BUILDING		
109	INFLUENT JUNCTION BOX		
111	2005 EMERGENCY GENERATOR ENGINES		
111A	NEW EMERGENCY GENERATOR ENGINES		
C01	#1 SCRUBBER PRIMARY CLARIFIER		
C02	#2 SCRUBBER PRIMARY CLARIFIER		
C04	DIGESTER ENCLOSED FLARE		
C05A	CARBON ADSORPTION UNITS (2)		
C09	DRY MEDIA SCRUBBER		
FML02	DIESEL TANKS		
S01	STACK: PRIMARY CLARIFIER		
S03	STACK: DIGESTER FLARE		
S05	SOLIDS HANDLING BLDG STACKS (2)		
S09	STACK: INFLUENT JUNCTION BOX		
S111	EMERGENCY GENERATOR ENGINE STACKS		

PERMIT MAPS



PERMIT MAPS



**SECTION B. General State Only Requirements****#001 [25 Pa. Code § 121.1]****Definitions.**

Words and terms that are not otherwise defined in this permit shall have the meanings set forth in Section 3 of the Air Pollution Control Act (35 P.S. § 4003) and in 25 Pa. Code § 121.1.

#002 [25 Pa. Code § 127.446]**Operating Permit Duration.**

(a) This operating permit is issued for a fixed term of five (5) years and shall expire on the date specified on Page 1 of this permit.

(b) The terms and conditions of the expired permit shall automatically continue pending issuance of a new operating permit, provided the permittee has submitted a timely and complete application and paid applicable fees required under 25 Pa. Code Chapter 127, Subchapter I and the Department is unable, through no fault of the permittee, to issue or deny a new permit before the expiration of the previous permit.

#003 [25 Pa. Code §§ 127.412, 127.413, 127.414, 127.446 & 127.703(b)]**Permit Renewal.**

(a) The permittee shall submit a timely and complete application for renewal of the operating permit to the appropriate Regional Air Program Manager. The application for renewal of the operating permit shall be submitted at least six (6) months and not more than 18 months before the expiration date of this permit.

(b) The application for permit renewal shall include the current permit number, a description of any permit revisions that occurred during the permit term, and any applicable requirements that were promulgated and not incorporated into the permit during the permit term. An application is complete if it contains sufficient information to begin processing the application, has the applicable sections completed and has been signed by a responsible official.

(c) The permittee shall submit with the renewal application a fee for the processing of the application as specified in 25 Pa. Code § 127.703(b). The fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" and submitted with the fee form to the respective regional office.

(d) The renewal application shall also include submission of proof that the local municipality and county, in which the facility is located, have been notified in accordance with 25 Pa. Code § 127.413.

(e) The application for renewal of the operating permit shall also include submission of supplemental compliance review forms in accordance with the requirements of 25 Pa. Code § 127.412(b) and § 127.412(j).

(f) The permittee, upon becoming aware that any relevant facts were omitted or incorrect information was submitted in the permit application, shall promptly submit such supplementary facts or corrected information as necessary to address any requirements that become applicable to the source after the permittee submits a complete application, but prior to the date the Department takes action on the permit application.

#004 [25 Pa. Code § 127.703]**Operating Permit Fees under Subchapter I.**

(a) The permittee shall pay the annual operating permit maintenance fee according to the following fee schedule in either paragraph (1) or (2) in accordance with 25 Pa. Code § 127.703(d) on or before December 31 of each year for the next calendar year.

(1) For a synthetic minor facility, a fee equal to:

(i) Four thousand dollars (\$4,000) for calendar years 2021—2025.

(ii) Five thousand dollars (\$5,000) for calendar years 2026—2030.

(iii) Six thousand three hundred dollars (\$6,300) for the calendar years beginning with 2031.

(2) For a facility that is not a synthetic minor, a fee equal to:

**SECTION B. General State Only Requirements**

- (i) Two thousand dollars (\$2,000) for calendar years 2021—2025.
- (ii) Two thousand five hundred dollars (\$2,500) for calendar years 2026—2030.
- (iii) Three thousand one hundred dollars (\$3,100) for the calendar years beginning with 2031.

(b) The applicable fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" with the permit number clearly indicated and submitted to the respective regional office.

#005 [25 Pa. Code §§ 127.450 (a)(4) and 127.464]**Transfer of Operating Permits.**

(a) This operating permit may not be transferred to another person, except in cases of transfer-of-ownership that are documented and approved by the Department.

(b) In accordance with 25 Pa. Code § 127.450(a)(4), a change in ownership of the source shall be treated as an administrative amendment if the Department determines that no other change in the permit is required and a written agreement has been submitted to the Department identifying the specific date of the transfer of permit responsibility, coverage and liability between the current and the new permittee and a compliance review form has been submitted to, and the permit transfer has been approved by, the Department.

(c) This operating permit is valid only for those specific sources and the specific source locations described in this permit.

#006 [25 Pa. Code § 127.441 and 35 P.S. § 4008]**Inspection and Entry.**

(a) Upon presentation of credentials and other documents as may be required by law, the permittee shall allow the Department or authorized representatives of the Department to perform the following:

(1) Enter at reasonable times upon the permittee's premises where a source is located or emissions related activity is conducted, or where records are kept under the conditions of this permit;

(2) Have access to and copy, at reasonable times, any records that are kept under the conditions of this permit;

(3) Inspect at reasonable times, any facilities, equipment including monitoring and air pollution control equipment, practices, or operations regulated or required under this permit;

(4) Sample or monitor, at reasonable times, any substances or parameters, for the purpose of assuring compliance with the permit or applicable requirements as authorized by the Clean Air Act, the Air Pollution Control Act, or the regulations promulgated under the Acts.

(b) Pursuant to 35 P.S. § 4008, no person shall hinder, obstruct, prevent or interfere with the Department or its personnel in the performance of any duty authorized under the Air Pollution Control Act or regulations adopted thereunder including denying the Department access to a source at this facility. Refusal of entry or access may constitute grounds for permit revocation and assessment of criminal and/or civil penalties.

(c) Nothing in this permit condition shall limit the ability of the EPA to inspect or enter the premises of the permittee in accordance with Section 114 or other applicable provisions of the Clean Air Act.

#007 [25 Pa. Code §§ 127.441 & 127.444]**Compliance Requirements.**

(a) The permittee shall comply with the conditions of this operating permit. Noncompliance with this permit constitutes a violation of the Clean Air Act and the Air Pollution Control Act and is grounds for one or more of the following:

- (1) Enforcement action

**SECTION B. General State Only Requirements**

(2) Permit termination, revocation and reissuance or modification

(3) Denial of a permit renewal application

(b) A person may not cause or permit the operation of a source which is subject to 25 Pa. Code Article III unless the source(s) and air cleaning devices identified in the application for the plan approval and operating permit and the plan approval issued for the source is operated and maintained in accordance with specifications in the applications and the conditions in the plan approval and operating permit issued by the Department. A person may not cause or permit the operation of an air contamination source subject to 25 Pa. Code Chapter 127 in a manner inconsistent with good operating practices.

(c) For purposes of Sub-condition (b) of this permit condition, the specifications in applications for plan approvals and operating permits are the physical configurations and engineering design details which the Department determines are essential for the permittee's compliance with the applicable requirements in this State-Only permit. Nothing in this sub-condition shall be construed to create an independent affirmative duty upon the permittee to obtain a predetermination from the Department for physical configuration or engineering design detail changes made by the permittee.

#008 [25 Pa. Code § 127.441]**Need to Halt or Reduce Activity Not a Defense.**

It shall not be a defense for the permittee in an enforcement action that it was necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.

#009 [25 Pa. Code §§ 127.442(a) & 127.461]**Duty to Provide Information.**

(a) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of each source at the facility.

(b) The permittee shall furnish to the Department, in writing, information that the Department may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit, or to determine compliance with the permit. Upon request, the permittee shall also furnish to the Department copies of records that the permittee is required to maintain in accordance with this permit.

#010 [25 Pa. Code § 127.461]**Revising an Operating Permit for Cause.**

This operating permit may be terminated, modified, suspended or revoked and reissued if one or more of the following applies:

(1) The permittee constructs or operates the source subject to the operating permit so that it is in violation of the Air Pollution Control Act, the Clean Air Act, the regulations thereunder, a plan approval, a permit or in a manner that causes air pollution.

(2) The permittee fails to properly or adequately maintain or repair an air pollution control device or equipment attached to or otherwise made a part of the source.

(3) The permittee has failed to submit a report required by the operating permit or an applicable regulation.

(4) The EPA determines that the permit is not in compliance with the Clean Air Act or the regulations thereunder.

#011 [25 Pa. Code §§ 127.450, 127.462, 127.465 & 127.703]**Operating Permit Modifications**

(a) The permittee is authorized to make administrative amendments, minor operating permit modifications and significant operating permit modifications, under this permit, as outlined below:

(b) Administrative Amendments. The permittee shall submit the application for administrative operating permit amendments (as defined in 25 Pa. Code § 127.450(a)), according to procedures specified in § 127.450 unless

**SECTION B. General State Only Requirements**

precluded by the Clean Air Act or its regulations.

(c) Minor Operating Permit Modifications. The permittee shall submit the application for minor operating permit modifications (as defined 25 Pa. Code § 121.1) in accordance with 25 Pa. Code § 127.462.

(d) Significant Operating Permit Modifications. The permittee shall submit the application for significant operating permit modifications in accordance with 25 Pa. Code § 127.465.

(e) The applicable fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" with the permit number clearly indicated and submitted to the respective regional office.

#012 [25 Pa. Code § 127.441]**Severability Clause.**

The provisions of this permit are severable, and if any provision of this permit is determined by a court of competent jurisdiction to be invalid or unenforceable, such a determination will not affect the remaining provisions of this permit.

#013 [25 Pa. Code § 127.449]**De Minimis Emission Increases.**

(a) This permit authorizes de minimis emission increases in accordance with 25 Pa. Code § 127.449 so long as the permittee provides the Department with seven (7) days prior written notice before commencing any de minimis emissions increase. The written notice shall:

(1) Identify and describe the pollutants that will be emitted as a result of the de minimis emissions increase.

(2) Provide emission rates expressed in tons per year and in terms necessary to establish compliance consistent with any applicable requirement.

(b) The Department may disapprove or condition de minimis emission increases at any time.

(c) Except as provided below in (d), the permittee is authorized to make de minimis emission increases (expressed in tons per year) up to the following amounts without the need for a plan approval or prior issuance of a permit modification:

(1) Four tons of carbon monoxide from a single source during the term of the permit and 20 tons of carbon monoxide at the facility during the term of the permit.

(2) One ton of NO_x from a single source during the term of the permit and 5 tons of NO_x at the facility during the term of the permit.

(3) One and six-tenths tons of the oxides of sulfur from a single source during the term of the permit and 8.0 tons of oxides of sulfur at the facility during the term of the permit.

(4) Six-tenths of a ton of PM₁₀ from a single source during the term of the permit and 3.0 tons of PM₁₀ at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(5) One ton of VOCs from a single source during the term of the permit and 5.0 tons of VOCs at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(6) Other sources and classes of sources determined to be of minor significance by the Department.

(d) In accordance with § 127.14, the permittee is authorized to install the following minor sources without the need for a plan approval or permit modification:

(1) Air conditioning or ventilation systems not designed to remove pollutants generated or released from other sources.

**SECTION B. General State Only Requirements**

(2) Combustion units rated at 2,500,000 or less Btu per hour of heat input.

(3) Combustion units with a rated capacity of less than 10,000,000 Btu per hour heat input fueled by natural gas supplied by a public utility or by commercial fuel oils which are No. 2 or lighter, viscosity less than or equal to 5.82 c St, and which meet the sulfur content requirements of 25 Pa. Code §123.22 (relating to combustion units). For purposes of this permit, commercial fuel oil shall be virgin oil which has no reprocessed, recycled or waste material added.

(4) Space heaters which heat by direct heat transfer.

(5) Laboratory equipment used exclusively for chemical or physical analysis.

(6) Other sources and classes of sources determined to be of minor significance by the Department.

(e) This permit does not authorize de minimis emission increases if the emissions increase would cause one or more of the following:

(1) Increase the emissions of a pollutant regulated under Section 112 of the Clean Air Act except as authorized in Subparagraphs (c)(4) and (5) of this permit condition.

(2) Subject the facility to the prevention of significant deterioration requirements in 25 Pa. Code Chapter 127, Subchapter D and/or the new source review requirements in Subchapter E.

(3) Violate any applicable requirement of this permit, the Air Pollution Control Act, the Clean Air Act, or the regulations promulgated under either of the acts.

(f) Emissions authorized under this permit condition shall be included in the monitoring, recordkeeping and reporting requirements of this permit.

(g) Except for de minimis emission increases, installation of minor sources made pursuant to this permit condition and Plan Approval Exemptions under 25 Pa. Code § 127.14 (relating to exemptions), the permittee is prohibited from making changes or engaging in activities that are not specifically authorized under this permit without first applying for a plan approval. In accordance with § 127.14(b), a plan approval is not required for the construction, modification, reactivation, or installation of the sources creating the de minimis emissions increase.

(h) The permittee may not meet de minimis emission threshold levels by offsetting emission increases or decreases at the same source.

#014 [25 Pa. Code § 127.3]**Operational Flexibility.**

The permittee is authorized to make changes within the facility in accordance with the regulatory provisions outlined in 25 Pa. Code § 127.3 (relating to operational flexibility) to implement the operational flexibility requirements provisions authorized under Section 6.1(i) of the Air Pollution Control Act and the operational flexibility terms and conditions of this permit. The provisions in 25 Pa. Code Chapter 127 which implement the operational flexibility requirements include the following:

(1) Section 127.14 (relating to exemptions)

(2) Section 127.447 (relating to alternative operating scenarios)

(3) Section 127.448 (relating to emissions trading at facilities with Federally enforceable emissions caps)

(4) Section 127.449 (relating to de minimis emission increases)

(5) Section 127.450 (relating to administrative operating permit amendments)

(6) Section 127.462 (relating to minor operating permit modifications)

(7) Subchapter H (relating to general plan approvals and general operating permits)

**SECTION B. General State Only Requirements****#015 [25 Pa. Code § 127.11a]****Reactivation of Sources**

- (a) The permittee may not reactivate a source that has been out of operation or production for at least one year unless the reactivation is conducted in accordance with a plan approval granted by the Department or in accordance with reactivation and maintenance plans developed and approved by the Department in accordance with 25 Pa. Code § 127.11a(a).
- (b) A source which has been out of operation or production for more than five (5) years but less than 10 years may be reactivated and will not be considered a new source if the permittee satisfies the conditions specified in 25 Pa. Code § 127.11a(b).

#016 [25 Pa. Code § 127.36]**Health Risk-based Emission Standards and Operating Practice Requirements.**

- (a) When needed to protect public health, welfare and the environment from emissions of hazardous air pollutants from new and existing sources, the permittee shall comply with the health risk-based emission standards or operating practice requirements imposed by the Department, except as precluded by §§ 6.6(d)(2) and (3) of the Air Pollution Control Act [35 P.S. § 4006.6(d)(2) and (3)].
- (b) A person challenging a performance or emission standard established by the Department has the burden to demonstrate that performance or emission standard does not meet the requirements of Section 112 of the Clean Air Act.

#017 [25 Pa. Code § 121.9]**Circumvention.**

No person may permit the use of a device, stack height which exceeds good engineering practice stack height, dispersion technique or other technique which, without resulting in reduction of the total amount of air contaminants emitted, conceals or dilutes an emission of air contaminants which would otherwise be in violation of 25 Pa. Code Article III, except that with prior approval of the Department, the device or technique may be used for control of malodors.

#018 [25 Pa. Code §§ 127.402(d) & 127.442]**Reporting Requirements.**

- (a) The permittee shall comply with the applicable reporting requirements of the Clean Air Act, the regulations thereunder, the Air Pollution Control Act and 25 Pa. Code Article III including Chapters 127, 135 and 139.
- (b) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of any air contamination source.
- (c) Reports, test data, monitoring data, notifications and requests for renewal of the permit shall be submitted to the:
- Regional Air Program Manager
PA Department of Environmental Protection
(At the address given in the permit transmittal letter, or otherwise notified)
- (d) Any records or information including applications, forms, or reports submitted pursuant to this permit condition shall contain a certification by a responsible official as to truth, accuracy and completeness. The certifications submitted under this permit shall require a responsible official of the facility to certify that based on information and belief formed after reasonable inquiry, the statements and information in the documents are true, accurate and complete.
- (e) Any records, reports or information submitted to the Department shall be available to the public except for such records, reports or information which meet the confidentiality requirements of § 4013.2 of the Air Pollution Control Act and §§ 112(d) and 114(c) of the Clean Air Act. The permittee may not request a claim of confidentiality for any emissions data generated for the facility.

**SECTION B. General State Only Requirements****#019 [25 Pa. Code §§ 127.441(c) & 135.5]****Sampling, Testing and Monitoring Procedures.**

(a) The permittee shall comply with the monitoring, recordkeeping or reporting requirements of 25 Pa. Code Chapter 139 and the other applicable requirements of 25 Pa. Code Article III and additional requirements related to monitoring, reporting and recordkeeping required by the Clean Air Act and the regulations thereunder including the Compliance Assurance Monitoring requirements of 40 CFR Part 64, where applicable.

(b) Unless alternative methodology is required by the Clean Air Act and regulations adopted thereunder, sampling, testing and monitoring required by or used by the permittee to demonstrate compliance with any applicable regulation or permit condition shall be conducted in accordance with the requirements of 25 Pa. Code Chapter 139.

#020 [25 Pa. Code §§ 127.441(c) and 135.5]**Recordkeeping.**

(a) The permittee shall maintain and make available, upon request by the Department, the following records of monitored information:

- (1) The date, place (as defined in the permit) and time of sampling or measurements.
- (2) The dates the analyses were performed.
- (3) The company or entity that performed the analyses.
- (4) The analytical techniques or methods used.
- (5) The results of the analyses.
- (6) The operating conditions as existing at the time of sampling or measurement.

(b) The permittee shall retain records of any required monitoring data and supporting information for at least five (5) years from the date of the monitoring, sample, measurement, report or application. Supporting information includes the calibration data and maintenance records and original strip-chart recordings for continuous monitoring instrumentation, and copies of reports required by the permit.

(c) The permittee shall maintain and make available to the Department upon request, records including computerized records that may be necessary to comply with the reporting, recordkeeping and emission statement requirements in 25 Pa. Code Chapter 135 (relating to reporting of sources). In accordance with 25 Pa. Code Chapter 135, § 135.5, such records may include records of production, fuel usage, maintenance of production or pollution control equipment or other information determined by the Department to be necessary for identification and quantification of potential and actual air contaminant emissions.

#021 [25 Pa. Code § 127.441(a)]**Property Rights.**

This permit does not convey any property rights of any sort, or any exclusive privileges.

#022 [25 Pa. Code § 127.447]**Alternative Operating Scenarios.**

The permittee is authorized to make changes at the facility to implement alternative operating scenarios identified in this permit in accordance with 25 Pa. Code § 127.447.

#023 [25 Pa. Code § 121.7]**Prohibition of Air Pollution**

No person may permit air pollution as that term is defined in the Air Pollution Control Act (35 P.S. §§ 4001-4015).

**SECTION B. General State Only Requirements****#024 [25 Pa. Code §135.3]****Reporting**

(a) If the facility is a Synthetic Minor Facility, the permittee shall submit by March 1 of each year an annual emissions report for the preceding calendar year. The report shall include information for all active previously reported sources, new sources which were first operated during the preceding calendar year, and sources modified during the same period which were not previously reported. All air emissions from the facility should be estimated and reported.

(b) A source owner or operator of a Synthetic Minor Facility may request an extension of time from the Department for the filing of an annual emissions report, and the Department may grant the extension for reasonable cause.

#025 [25 Pa. Code §135.4]**Report Format**

If applicable, the emissions reports shall contain sufficient information to enable the Department to complete its emission inventory. Emissions reports shall be made by the source owner or operator in a format specified by the Department.



SECTION C. Site Level Requirements

I. RESTRICTIONS.

Emission Restriction(s).

001 [25 Pa. Code §123.1]

Prohibition of certain fugitive emissions

(a) No person may permit the emission into the outdoor atmosphere of fugitive air contaminants from a source other than the following:

- (1) Construction or demolition of buildings or structures.
- (2) Grading, paving and maintenance of roads and streets.
- (3) Use of roads and streets. Emissions from material in or on trucks, railroad cars and other vehicular equipment are not considered as emissions from use of roads and streets.
- (4) Clearing of land.
- (5) Stockpiling of materials.
- (6) Sources and classes of sources other than those identified in (a)(1)-(a)(5), above, for which the operator has obtained a determination from the Department that fugitive emissions from the source, after appropriate control, meet the following requirements:
 - (i) The emissions are of minor significance with respect to causing air pollution; and
 - (ii) The emissions are not preventing or interfering with the attainment or maintenance of any ambient air quality standard.

002 [25 Pa. Code §123.2]

Fugitive particulate matter

No person shall permit fugitive particulate matter to be emitted into the outdoor atmosphere from a source specified in the preceding permit Condition #001, Section C, if such emissions are visible at the point the emissions pass outside the person's property.

003 [25 Pa. Code §123.31]

Limitations

No person shall emit any malodorous air contaminants into the outdoor atmosphere from any source in such a manner that the malodors are detectable outside the property of the person on whose land the source is being operated.

004 [25 Pa. Code §123.41]

Limitations

No person shall emit visible air contaminants into the outdoor atmosphere in such a manner that the opacity of the emission is either of the following:

- (1) Equal to or greater than 20 percent for a period or periods aggregating more than three minutes in any one hour.
- (2) Equal to or greater than 60 percent at any time.

II. TESTING REQUIREMENTS.

005 [25 Pa. Code §123.43]

Measuring techniques

Visible emissions may be measured by using either of the following:

- (1) A device approved by the Department and maintained to provide accurate opacity measurements.
- (2) Observers, trained and qualified to measure plume opacity with the naked eye or with the aid of any devices approved by the Department.

**SECTION C. Site Level Requirements****# 006 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The Department reserves the right to require exhaust stack testing of any source as necessary during the permit term to verify emissions for purposes including emission fees, malfunctions or permit condition violations.

007 [25 Pa. Code §139.1]**Sampling facilities.**

Upon the request of the Department, the permittee shall provide adequate sampling ports, safe sampling platforms and adequate utilities for the performance by the Department of tests on such source. The Department will set forth, in the request, the time period in which the facilities shall be provided as well as the specifications for such facilities.

III. MONITORING REQUIREMENTS.**# 008 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

(a) The permittee shall conduct a weekly inspection around the facility periphery during the daylight hours when the facility is in production to detect visible emissions, fugitive emissions and malodors as follows:

(1) Visible emissions in excess of the limits states in Condition #004, Section C. Visible emissions may be measured according to the methods specified in Condition #005, Section C. As an alternative, facility personnel who observe such visible emissions shall report each incident to the Department within two hours of each occurrence and make arrangements for a certified observer to read the visible emissions.

(2) Presence of visible fugitive emissions and fugitive particulate matter beyond the plant property boundaries, as stated in Condition #002, Section C.

(3) Presence of odors beyond the facility property boundaries that have the potential to be malodorous as stated in Condition #003, Section C.

IV. RECORDKEEPING REQUIREMENTS.**# 009 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall maintain records of the weekly inspections referenced in Section C, Condition #008. The records shall include, at a minimum, the following informations:

- (1) The name of the company representative doing the observation.
- (2) The date and time of the monitoring.
- (3) The wind direction.
- (4) A description of any emissions and/or malodors observed and actions taken to mitigate them. If none, record "NONE."

The permittee shall retain these records for a minimum of five (5) years. The records shall be made available to the Department upon its request.

V. REPORTING REQUIREMENTS.**# 010 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall report malfunctions to the Department. A malfunction is any sudden, infrequent, and not reasonably preventable failure of air pollution control equipment, process equipment, or a process to operate in a normal or usual manner that affects the facility's ability to comply with a permit term. Failures that are caused in part by poor maintenance or careless operation are not malfunctions. Malfunctions shall be reported as follows:

(a) Malfunctions which pose an imminent danger to public health, safety, welfare and the environment, shall be immediately reported to the Department by telephone. The telephone report of such malfunctions shall occur no later than two hours after discovery of the incident. Telephone reports can be made to the Reading District Office at (610) 916-0100 during normal business hours, or to the Department's Emergency Hotline at any time. The Emergency Hotline phone number is changed/updated periodically. The current Emergency Hotline phone number can be found at

**SECTION C. Site Level Requirements**

<https://www.dep.pa.gov/About/Regional/SouthcentralRegion/Pages/default.aspx>. The permittee shall submit a written report of instances of such malfunctions to the Department within three (3) days of the telephone report.

(b) Unless otherwise required by this permit, any other malfunction that is not subject to the reporting requirement of subsection (a) above, shall be reported to the Department, in writing, within five (5) days of malfunction discovery.

VI. WORK PRACTICE REQUIREMENTS.**# 011 [25 Pa. Code §123.1]****Prohibition of certain fugitive emissions**

The permittee shall take all reasonable actions to prevent particulate matter from the sources identified in Condition #001, Section C from becoming airborne. These actions shall include, but not be limited to, the following:

- (1) Use, where possible, of water or chemicals for control of dust in the demolition of buildings or structures, construction operations, the grading of roads or the clearing of land.
- (2) Application of asphalt, oil, water or suitable chemicals on dirt roads, material stockpiles and other surfaces which may give rise to airborne dusts.
- (3) Paving and maintenance of roadways.
- (4) Prompt removal of earth or other material from paved streets onto which earth or other material has been transported by trucking or other earth moving equipment, erosion by water or other means.

VII. ADDITIONAL REQUIREMENTS.**# 012 [25 Pa. Code §123.42]****Exceptions**

The limitations of 25 Pa. Code Section 123.41 (relating to limitations) do not apply to a visible emission in any of the following instances:

- (1) When the presence of uncombined water is the only reason for failure of the emission to meet the limitations.
- (2) When the emission results from the operation of equipment used solely to train and test persons in observing the opacity of visible emissions.
- (3) When the emission results from sources specified in Condition #001, Section C (relating to prohibition of certain fugitive emissions).

013 [25 Pa. Code §129.14]**Open burning operations**

(a) No person may permit the open burning of material in the air basin except where the open burning operations result from the following:

- (1) A fire set to prevent or abate a fire hazard, when approved by the Department and set by or under the supervision of a public officer.
- (2) Any fire set for the propose of instructing personnel in fire fighting, when approved by the Department.
- (3) A fire set for the prevention and control of disease or pests, when approved by the Department.
- (4) A fire set in conjunction with the production of agricultural commodities in their unmanufactured state on the premises of the farm operation.
- (5) A fire set solely for recreational or ceremonial purposes.
- (6) A fire set solely for cooking food.

**SECTION C. Site Level Requirements**

(b) This permit does not constitute authorization to burn solid waste pursuant to Section 610(3) of the Solid Waste Management Act, 35 P. S. Section 6018.610(3), or any other provision of the Solid Waste Management Act.

VIII. COMPLIANCE CERTIFICATION.

No additional compliance certifications exist except as provided in other sections of this permit including Section B (relating to State Only General Requirements).

IX. COMPLIANCE SCHEDULE.

No compliance milestones exist.


**SECTION D. Source Level Requirements**

Source ID: 101

Source Name: PRIMARY CLARIFIERS

Source Capacity/Throughput:

Conditions for this source occur in the following groups: SG01

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**

Source ID: 102

Source Name: SLUDGE DIGESTION

Source Capacity/Throughput:

**I. RESTRICTIONS.****Emission Restriction(s).**

001 [25 Pa. Code §123.13]

Processes

The permittee shall limit the emissions of particulate matter to the outdoor atmosphere from the source in a manner that the concentration of particulate matter in the effluent gas does not exceed 0.04 grain per dry standard cubic foot.

002 [25 Pa. Code §123.21]

General

The permittee may not permit the emission into the outdoor atmosphere of sulfur oxides from a source in a manner that the concentration of sulfur oxides, expressed as SO₂, in the effluent gas exceeds 500 parts per million, by volume, dry basis.

II. TESTING REQUIREMENTS.

003 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall sample the inlet gas to the flare once per calendar year for total sulfur. These sampling results shall be used to determine the emissions of sulfur oxides as sulfur dioxide (SO₂), using a mass balance calculation. If during the calendar year the permittee has conducted a source test for SO_x and hydrogen sulfide, this sampling will not be required.

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

004 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall record the temperature of the enclosed flare at the mid-point once per shift when the flare is in operation.

005 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall record the results of any inspections, flare malfunctions and deviations from the "Waste Gas Flare Best Management Practices." The permittee shall record any corrective actions taken.

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

006 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall install and maintain equipment to measure the temperature at the mid-point of the flare.

**SECTION D. Source Level Requirements****# 007 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall operate the waste gas flare in accordance with the permittee's "Waste Gas Flare Best Management Practices." The permittee shall maintain a copy of the practices at the facility. The document shall be made available to the Department upon request. The permittee shall submit to the Department a copy of the document whenever changes have been made.

VII. ADDITIONAL REQUIREMENTS.**# 008 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall maintain a pilot ignition system and provide a reliable fueled source for the flare's pilot system.

**SECTION D. Source Level Requirements**

Source ID: 103

Source Name: SOLIDS HOLDING TANKS

Source Capacity/Throughput:

Conditions for this source occur in the following groups: SG02

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**

Source ID: 104

Source Name: SOLIDS HANDLING BUILDING

Source Capacity/Throughput:

Conditions for this source occur in the following groups: SG02

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.


No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**

Source ID: 109

Source Name: INFLUENT JUNCTION BOX

Source Capacity/Throughput:

**I. RESTRICTIONS.****Emission Restriction(s).**

001 [25 Pa. Code §123.13]

Processes

The permittee shall limit the emissions of particulate matter to the outdoor atmosphere from the source in a manner that the concentration of particulate matter in the effluent gas does not exceed 0.04 grain per dry standard cubic foot.

002 [25 Pa. Code §123.21]

General

The permittee may not permit the emission into the outdoor atmosphere of sulfur oxides from a source in a manner that the concentration of sulfur oxides, expressed as SO₂, in the effluent gas exceeds 500 parts per million, by volume, dry basis.

003 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall limit the emissions of hydrogen sulfide to the following:

- (1) 0.2 ppmv when the inlet concentration is 20 ppmv or less,
- (2) 99 percent removal efficiency when the inlet concentration is greater than 20 ppmv.

[Additional authority for this permit condition is derived from PA 06-03102B]

II. TESTING REQUIREMENTS.

004 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall once per shift sample the inlet and outlet air streams for hydrogen sulfide (H₂S). From this sampling the permittee shall determine the removal efficiency of the scrubbing system.

[Additional authority for this permit condition is derived from PA 06-03102B]

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

005 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall record the pressure drop across the scrubber a minimum of once per day.

[Additional authority for this permit condition is derived from PA 06-03102B]

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION D. Source Level Requirements****VI. WORK PRACTICE REQUIREMENTS.****# 006 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall maintain the enclosure on the influent junction box in good working order and Source 109 shall be exhausted through the dry media scrubber (C09) at all times unless otherwise approved in writing by DEP.

[Additional authority for this permit condition is derived from PA 06-03102B]

007 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall maintain equipment on the scrubber to measure the pressure drop across the scrubber (C09), utilizing a differential manometer, or equivalent.

[Additional authority for this permit condition is derived from PA 06-03102B]

008 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

Scrubber C09 shall be maintained and operated in a good pollution control manner.

[Additional authority for this permit condition is derived from PA 06-03102B]

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

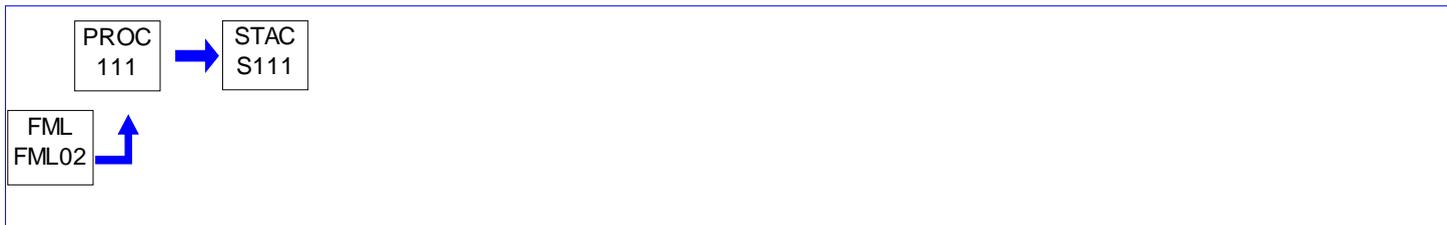
**SECTION D. Source Level Requirements**

Source ID: 111

Source Name: 2005 EMERGENCY GENERATOR ENGINES

Source Capacity/Throughput:

Conditions for this source occur in the following groups: SG03

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**

Source ID: 111A

Source Name: NEW EMERGENCY GENERATOR ENGINES

Source Capacity/Throughput:

Conditions for this source occur in the following groups: SG04

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION E. Source Group Restrictions.**

Group Name: SG01

Group Description: Primary Treatment

Sources included in this group

ID	Name
101	PRIMARY CLARIFIERS

I. RESTRICTIONS.**Emission Restriction(s).****# 001 [25 Pa. Code §123.13]****Processes**

The permittee shall limit the emissions of particulate matter to the outdoor atmosphere from the source in a manner that the concentration of particulate matter in the effluent gas does not exceed 0.04 grain per dry standard cubic foot.

002 [25 Pa. Code §123.21]**General**

The permittee may not permit the emission into the outdoor atmosphere of sulfur oxides from a source in a manner that the concentration of sulfur oxides, expressed as SO₂, in the effluent gas exceeds 500 parts per million, by volume, dry basis.

003 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall limit the emissions of hydrogen sulfide to the following:

- (a) 0.2 ppmv when the inlet concentration is 20 ppmv or less,
- (b) 99 percent removal efficiency when the inlet concentration is greater than 20 ppmv.

II. TESTING REQUIREMENTS.**# 004 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall once per shift sample the inlet and outlet air streams for hydrogen sulfide (H₂S). From this sampling the permittee shall determine the removal efficiency of the scrubbing system.

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.**# 005 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall record the following on each scrubber a minimum of once per day:

- (a) Pressure drop across each scrubber,
- (b) Water flow rate to each scrubber, and
- (c) pH of the scrubber water in each scrubber.

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION E. Source Group Restrictions.****VI. WORK PRACTICE REQUIREMENTS.****# 006 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall maintain the enclosures on the primary diversion box and primary settling tanks in good working order. The sources shall be exhausted to the dual wetted packed bed scrubbers at all times. The permittee shall limit the number of openings in the covers when the tanks are in service. During periods of cleaning and/or maintenance of the scrubbers, the sources shall continue to be exhausted through at least one scrubber.

007 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall maintain equipment on each scrubber to measure the following at all times:

- (a) Pressure drop across the scrubber, utilizing a differential manometer, or equivalent,
- (b) Water flow rate to the scrubber, utilizing a rotameter, or equivalent, and
- (c) pH of the scrubber water applied to the scrubber.

008 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The dual wetted packed bed scrubbers shall be maintained and operated in a good pollution control manner.

009 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall maintain each wetted packed bed scrubber so that either or both sodium hypochlorite and sodium hydroxide can be added to the scrubbing water. The permittee shall determine which chemical or both shall be used to control emissions.

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION E. Source Group Restrictions.**

Group Name: SG02

Group Description: Solids Handling

Sources included in this group

ID	Name
103	SOLIDS HOLDING TANKS
104	SOLIDS HANDLING BUILDING

I. RESTRICTIONS.**Emission Restriction(s).****# 001 [25 Pa. Code §123.13]****Processes**

The permittee shall limit the emissions of particulate matter to the outdoor atmosphere from the source in a manner that the concentration of particulate matter in the effluent gas does not exceed 0.04 grain per dry standard cubic foot.

002 [25 Pa. Code §123.21]**General**

No person may permit the emission into the outdoor atmosphere of sulfur oxides from a source in a manner that the concentration of the sulfur oxides, expressed as SO₂, in the effluent gas exceeds 500 parts per million, by volume, dry basis.

003 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall limit the emissions of hydrogen sulfide to the following:

(a) 1.0 ppmv when the inlet concentration is 10 ppmv or less.

(b) 90 percent removal efficiency when the inlet concentration is greater than 10 ppmv.

II. TESTING REQUIREMENTS.**# 004 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall once per shift sample the inlet and outlet air streams for hydrogen sulfide (H₂S). From this sampling the permittee shall determine the removal efficiency of the carbon adsorption system.

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.**# 005 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall maintain the existing cover over the solids mixing/holding tank. The tank shall be exhausted to the carbon adsorption system, except during maintenance on the carbon adsorption system.

**SECTION E. Source Group Restrictions.****# 006 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall maintain the existing enclosures around the various sources in the solids handling building. The enclosures shall be exhausted to the carbon adsorption system, except during maintenance of the carbon adsorption system.

007 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The Carbon Adsorption Units (C05A) shall be maintained and operated in accordance with manufacturer recommendations.

[Additional authority for this permit condition is derived from PA 06-03102B]

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION E. Source Group Restrictions.**

Group Name: SG03

Group Description: 40 CFR 63, Subpart ZZZZ Engine(s)

Sources included in this group

ID	Name
111	2005 EMERGENCY GENERATOR ENGINES

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.**# 001 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

Regulatory Changes

Individual sources within this source group that are subject to 40 CFR Part 63 Subpart ZZZZ -National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines shall comply with all applicable requirements of the Subpart. 40 CFR 63.13(a) requires submission of copies of all requests, reports and other communications to both the Department and the EPA. The EPA copies shall be forwarded to:

Associate Director
 United States Environmental Protection Agency
 Region III, Enforcement & Compliance Assurance Division
 Air, RCRA and Toxics Branch (3ED21)
 Four Penn Center
 1600 John F. Kennedy Boulevard
 Philadelphia, Pennsylvania 19103-2852

Unless otherwise approved by DEP, the DEP copies shall be reported through the Department's Greenport PUP system available through: <https://greenport.pa.gov/ePermitPublicAccess/PublicSubmission/Home>

In the event that the Federal Subpart that is the subject of this Source Group is revised, the permittee shall comply with the

**SECTION E. Source Group Restrictions.**

revised version of the subpart, and shall not be required to comply with any provisions in this permit designated as having the subpart as their authority, to the extent that such permit provisions would be inconsistent with the applicable provisions of the revised subpart.

002 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6585]**Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines****Am I subject to this subpart?**

You are subject to this subpart if you own or operate a stationary RICE at a major or area source of HAP emissions, except if the stationary RICE is being tested at a stationary RICE test cell/stand.

63.6585(a) A stationary RICE is any internal combustion engine which uses reciprocating motion to convert heat energy into mechanical work and which is not mobile. Stationary RICE differ from mobile RICE in that a stationary RICE is not a non-road engine as defined at 40 CFR 1068.30, and is not used to propel a motor vehicle or a vehicle used solely for competition.

63.6585(b) A major source of HAP emissions is a plant site that emits or has the potential to emit any single HAP at a rate of 10 tons (9.07 megagrams) or more per year or any combination of HAP at a rate of 25 tons (22.68 megagrams) or more per year, except that for oil and gas production facilities, a major source of HAP emissions is determined for each surface site.

63.6585(c) An area source of HAP emissions is a source that is not a major source.

63.6585(d) If you are an owner or operator of an area source subject to this subpart, your status as an entity subject to a standard or other requirements under this subpart does not subject you to the obligation to obtain a permit under 40 CFR part 70 or 71, provided you are not required to obtain a permit under 40 CFR 70.3(a) or 40 CFR 71.3(a) for a reason other than your status as an area source under this subpart. Notwithstanding the previous sentence, you must continue to comply with the provisions of this subpart as applicable.

63.6585(e) [NA – NOT USED FOR NATIONAL SECURITY PURPOSES]

63.6585(f) [NA – RICE NOT RESIDENTIAL, COMMERCIAL OR INSTITUTIONAL]

[69 FR 33506, June 15, 2004, as amended at 73 FR 3603, Jan. 18, 2008; 78 FR 6700, Jan. 30, 2013; 87 FR 48607, Aug. 10, 2022]

003 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6590]**Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines****What parts of my plant does this subpart cover?**

This subpart applies to each affected source.

63.6590(a) Affected source.

An affected source is any existing, new, or reconstructed stationary RICE located at a major or area source of HAP emissions, excluding stationary RICE being tested at a stationary RICE test cell/stand.

63.6590(a)(1) Existing stationary RICE.

63.6590(a)(1)(i) [NA – NOT A MAJOR HAP SOURCE]

63.6590(a)(1)(ii) [NA – NOT A MAJOR HAP SOURCE]

63.6590(a)(1)(iii) For stationary RICE located at an area source of HAP emissions, a stationary RICE is existing if you commenced construction or reconstruction of the stationary RICE before June 12, 2006.

63.6590(a)(1)(iv) A change in ownership of an existing stationary RICE does not make that stationary RICE a new or reconstructed stationary RICE.

**SECTION E. Source Group Restrictions.**

63.6590(a)(2) [NA – NOT A NEW RICE]

63.6590(a)(3) [NA – NOT A RECONSTRUCTED RICE]

63.6590(b) Stationary RICE subject to limited requirements.

63.6590(b)(1) An affected source which meets either of the criteria in paragraphs (b)(1)(i) through (ii) of this section does not have to meet the requirements of this subpart and of subpart A of this part except for the initial notification requirements of § 63.6645(f).

63.6590(b)(1)(i) [NA – NOT A MAJOR HAP SOURCE]

63.6590(b)(1)(ii) [NA – NOT A MAJOR HAP SOURCE]

63.6590(b)(2) [NA – NOT A MAJOR HAP SOURCE AND DOES NOT COMBUST LFG]

63.6590(b)(3) The following stationary RICE do not have to meet the requirements of this subpart and of subpart A of this part, including initial notification requirements:

63.6590(b)(3)(i) - (iv) [NA – NOT A MAJOR HAP SOURCE]

63.6590(b)(3)(v) [NA – NOT A MAJOR HAP SOURCE AND DOES NOT COMBUST LFG]

63.6590(c) [NA – NOT SUBJECT TO SUBPARTS IIII OR JJJJ]

[69 FR 33506, June 15, 2004, as amended at 73 FR 3604, Jan. 18, 2008; 75 FR 9674, Mar. 3, 2010; 75 FR 37733, June 30, 2010; 75 FR 51588, Aug. 20, 2010; 78 FR 6700, Jan. 30, 2013; 87 FR 48607, Aug. 10, 2022]

004 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6595]

Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines

When do I have to comply with this subpart?

63.6595(a) Affected Sources.

63.6595(a)(1) If you have an existing stationary RICE, excluding existing non-emergency CI stationary RICE, with a site rating of more than 500 brake HP located at a major source of HAP emissions, you must comply with the applicable emission limitations, operating limitations and other requirements no later than June 15, 2007. If you have an existing non-emergency CI stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions, an existing stationary CI RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions, or an existing stationary CI RICE located at an area source of HAP emissions, you must comply with the applicable emission limitations, operating limitations, and other requirements no later than May 3, 2013. If you have an existing stationary SI RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions, or an existing stationary SI RICE located at an area source of HAP emissions, you must comply with the applicable emission limitations, operating limitations, and other requirements no later than October 19, 2013.

63.6595(a)(2) - (5) [NA – NOT A MAJOR HAP SOURCE]

63.6595(a)(6) [NA – NOT SUBJECT TO EMISSION OR OPERATING LIMITATIONS]

63.6595(a)(7) [NA – NOT SUBJECT TO EMISSION OR OPERATING LIMITATIONS]

63.6595(b) Area sources that become major sources.

If you have an area source that increases its emissions or its potential to emit such that it becomes a major source of HAP, the compliance dates in paragraphs (b)(1) and (2) of this section apply to you.

63.6595(b)(1) Any stationary RICE for which construction or reconstruction is commenced after the date when your area

**SECTION E. Source Group Restrictions.**

source becomes a major source of HAP must be in compliance with this subpart upon startup of your affected source.

63.6595(b)(2) Any stationary RICE for which construction or reconstruction is commenced before your area source becomes a major source of HAP must be in compliance with the provisions of this subpart that are applicable to RICE located at major sources within 3 years after your area source becomes a major source of HAP.

63.6595(c) If you own or operate an affected source, you must meet the applicable notification requirements in § 63.6645 and in 40 CFR part 63, subpart A.

[69 FR page 33506, June 15, 2004, as amended at 73 FR page 3604, Jan. 18, 2008; 75 FR page 9675, Mar. 3, 2010; 75 FR page 51589, Aug. 20, 2010; 78 FR page 6701, Jan. 30, 2013]

005 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6600]

Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines

What emission limitations and operating limitations must I meet if I own or operate a stationary RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions?

[NA – FACILITY IS AN AREA SOURCE OF HAP EMISSIONS]

006 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6601]

Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines

What emission limitations must I meet if I own or operate a new or reconstructed 4SLB stationary RICE with a site rating of greater than or equal to 250 brake HP and less than or equal to 500 brake HP located at a major source of HAP emissions?

[NA – ENGINES > 500 HP AND FACILITY IS AN AREA SOURCE OF HAP EMISSIONS]

007 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6602]

Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines

What emission limitations must I meet if I own or operate an existing stationary RICE with a site rating of equal to or less than 500 brake HP located at a major source of HAP emissions?

[NA – FACILITY IS AN AREA SOURCE OF HAP EMISSIONS]

008 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6603]

Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines

What emission limitations, operating limitations, and other requirements must I meet if I own or operate an existing stationary RICE located at an area source of HAP emissions?

Compliance with the numerical emission limitations established in this subpart is based on the results of testing the average of three 1-hour runs using the testing requirements and procedures in § 63.6620 and Table 4 to this subpart.

63.6603(a) If you own or operate an existing stationary RICE located at an area source of HAP emissions, you must comply with the requirements in Table 2d to this subpart and the operating limitations in Table 2b to this subpart that apply to you.

TABLE 2d REQUIREMENTS:

ITEM 5: Emergency stationary CI RICE and black start stationary CI RICE.- SEE NOTE (2):

- (a) Change oil and filter every 500 hours of operation or annually, whichever comes first - SEE NOTE (1);
 - (b) Inspect spark plugs every 1,000 hours of operation or annually, whichever comes first, and replace as necessary;
- and
- (c). Inspect all hoses and belts every 500 hours of operation or annually, whichever comes first, and replace as necessary

NOTE (1): Sources have the option to utilize an oil analysis program as described in § 63.6625(i) in order to extend the specified oil change requirement in Table 2d of this subpart.

**SECTION E. Source Group Restrictions.**

NOTE (2): If an emergency engine is operating during an emergency and it is not possible to shut down the engine in order to perform the management practice requirements on the schedule required in Table 2d of this subpart, or if performing the management practice on the required schedule would otherwise pose an unacceptable risk under Federal, State, or local law, the management practice can be delayed until the emergency is over or the unacceptable risk under Federal, State, or local law has abated. The management practice should be performed as soon as practicable after the emergency has ended or the unacceptable risk under Federal, State, or local law has abated. Sources must report any failure to perform the management practice on the schedule required and the Federal, State or local law under which the risk was deemed unacceptable.

[END OF TABLE 2d REQUIREMENTS]

63.6603(b) - (f) [NA – EMERGENCY ENGINES]

[75 FR page 9675, Mar. 3, 2010, as amended at 75 FR page 51589, Aug. 20, 2010; 76 FR page 12866, Mar. 9, 2011; 78 FR page 6701, Jan. 30, 2013]

009 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6604]

Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines

What fuel requirements must I meet if I own or operate an existing stationary CI RICE?

[NA – EXISTING EMERGENCY ENGINES ARE NOT SUBJECT TO FUEL REQUIREMENTS]

010 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6605]

Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines

What are my general requirements for complying with this subpart?

63.6605(a) You must be in compliance with the emission limitations, operating limitations, and other requirements in this subpart that apply to you at all times.

63.6605(b) At all times you must operate and maintain any affected source, including associated air pollution control equipment and monitoring equipment, in a manner consistent with safety and good air pollution control practices for minimizing emissions. The general duty to minimize emissions does not require you to make any further efforts to reduce emissions if levels required by this standard have been achieved. Determination of whether such operation and maintenance procedures are being used will be based on information available to the Administrator which may include, but is not limited to, monitoring results, review of operation and maintenance procedures, review of operation and maintenance records, and inspection of the source.

[69 FR page 33506, June 15, 2004, as amended at 75 FR page 9675, Mar. 3, 2010; 78 FR page 6702, Jan. 30, 2013]

011 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6610]

Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines

By what date must I conduct the initial performance tests or other initial compliance demonstrations?

[NA – NOT A MAJOR HAP SOURCE]

012 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6611]

Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines

By what date must I conduct the initial performance tests or other initial compliance demonstrations if I own or operate a new or reconstructed 4SLB SI stationary RICE with a site rating (please see below)

[NA – NOT A MAJOR HAP SOURCE]

013 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6612]

Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines

By what date must I conduct the initial performance tests or other initial compliance demonstrations if I own or operate an existing stationary RICE with a site rating of less than or equal to 500 brake (please see below)

[NA – NO PERFORMANCE TESTING REQUIRED]

**SECTION E. Source Group Restrictions.**

014 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6615]

Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines

When must I conduct subsequent performance tests?

[NA – NOT SUBJECT TO EMISSION OR OPERATING LIMITATIONS]

015 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6620]

Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines

What performance tests and other procedures must I use?

[NA – NO PERFORMANCE TESTING REQUIRED]

016 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6625]

Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines

What are my monitoring, installation, operation, and maintenance requirements?

63.6625(a) [NA – CEMS NOT REQUIRED]

63.6625(b) [NA – CPMS NOT REQUIRED]

63.6625(c) [NA – LFG NOT USED]

63.6625(d) [NA – NOT A MAJOR HAP SOURCE]

63.6625(e) If you own or operate any of the following stationary RICE, you must operate and maintain the stationary RICE and after-treatment control device (if any) according to the manufacturer's emission-related written instructions or develop your own maintenance plan which must provide to the extent practicable for the maintenance and operation of the engine in a manner consistent with good air pollution control practice for minimizing emissions:

63.6625(e)(1) - (2) [NA – NOT A MAJOR HAP SOURCE]

63.6625(e)(3) An existing emergency or black start stationary RICE located at an area source of HAP emissions;

63.6625(e)(4) - (10) [NA – EMERGENCY ENGINE]

63.6625(f) If you own or operate an existing emergency stationary RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions or an existing emergency stationary RICE located at an area source of HAP emissions, you must install a non-resettable hour meter if one is not already installed.

63.6625(g) [NA – EMERGENCY ENGINE(S)]

63.6625(h) If you operate a new, reconstructed, or existing stationary engine, you must minimize the engine's time spent at idle during startup and minimize the engine's startup time to a period needed for appropriate and safe loading of the engine, not to exceed 30 minutes, after which time the emission standards applicable to all times other than startup in Tables 1a, 2a, 2c, and 2d to this subpart apply.

63.6625(i) If you own or operate a stationary CI engine that is subject to the work, operation or management practices in items 1 or 2 of table 2c to this subpart or in items 1 or 4 of table 2d to this subpart, you have the option of utilizing an oil analysis program in order to extend the specified oil and filter change requirement in tables 2c and 2d to this subpart. The oil analysis must be performed at the same frequency specified for changing the oil and filter in table 2c or 2d to this subpart. The analysis program must at a minimum analyze the following three parameters: Total Base Number, viscosity, and percent water content. The condemning limits for these parameters are as follows: Total Base Number is less than 30 percent of the Total Base Number of the oil when new; viscosity of the oil has changed by more than 20 percent from the viscosity of the oil when new; or percent water content (by volume) is greater than 0.5. If all of these condemning limits are not exceeded, the engine owner or operator is not required to change the oil and filter. If any of the limits are exceeded, the engine owner or operator must change the oil and filter within 2 business days of receiving the results of the analysis; if the engine is not in operation when the results of the analysis are received, the engine owner or operator must change the oil

**SECTION E. Source Group Restrictions.**

and filter within 2 business days or before commencing operation, whichever is later. The owner or operator must keep records of the parameters that are analyzed as part of the program, the results of the analysis, and the oil and filter changes for the engine. The analysis program must be part of the maintenance plan for the engine.

63.6625(j) [NA - ENGINES ARE DIESEL FUELED]

[69 FR page 33506, June 15, 2004, as amended at 73 FR page 3606, Jan. 18, 2008; 75 FR page 9676, Mar. 3, 2010; 75 FR page 51589, Aug. 20, 2010; 76 FR page 12866, Mar. 9, 2011; 78 FR page 6703, Jan. 30, 2013]

017 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6630]

Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines

How do I demonstrate initial compliance with the emission limitations and operating limitations?

63.6630(a) You must demonstrate initial compliance with each emission limitation, operating limitation, and other requirement that applies to you according to Table 5 of this subpart. [NA – NONE OF THE CATEGORIES IN TABLE 5 APPLY TO EMERGENCY ENGINES]

63.6630(b) [NA – PERFORMANCE TESTING NOT REQUIRED]

63.6630(c) [NA – NOCS NOT REQUIRED FOR EXISTING EMERGENCY RICE]

63.6630(d) - (e) [NA – EMERGENCY ENGINE]

[Amended at 78 FR page 6704, Jan. 30, 2013]

018 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6635]

Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines

How do I monitor and collect data to demonstrate continuous compliance?

[NA – NOT SUBJECT TO EMISSION OR OPERATING LIMITATIONS]

019 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6640]

Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines

How do I demonstrate continuous compliance with the emission limitations, operating limitations, and other requirements?

63.6640(a) You must demonstrate continuous compliance with each emission limitation, operating limitation, and other requirements in Tables 1a and 1b, Tables 2a and 2b, Table 2c, and Table 2d to this subpart that apply to you according to methods specified in Table 6 to this subpart.

TABLE 6 REQUIREMENTS

ITEM 9. FOR EACH existing emergency and black start stationary RICE ≤ 500 HP located at a major source of HAP, existing nonemergency stationary RICE < 100 HP located at a major source of HAP, EXISTING EMERGENCY and black start STATIONARY RICE LOCATED AT AN AREA SOURCE OF HAP, existing non-emergency stationary CI RICE ≤ 300 HP located at an area source of HAP, existing non-emergency 2SLB stationary RICE located at an area source of HAP, existing non-emergency stationary SI RICE located at an area source of HAP which combusts landfill or digester gas equivalent to 10 percent or more of the gross heat input on an annual basis, existing non-emergency 4SLB and 4SRB stationary RICE ≤ 500 HP located at an area source of HAP, existing non-emergency 4SLB and 4SRB stationary RICE > 500 HP located at an area source of HAP that operate 24 hours or less per calendar year, and existing non-emergency 4SLB and 4SRB stationary RICE > 500 HP located at an area source of HAP that are remote stationary RICE, complying with the requirement to "Work or Management practices", you must demonstrate continuous compliance by:

i. Operating and maintaining the stationary RICE according to the manufacturer's emission-related operation and maintenance instructions; or

ii. Develop and follow your own maintenance plan which must provide to the extent practicable for the maintenance and operation of the engine in a manner consistent with good air pollution control practice for minimizing emissions.

**SECTION E. Source Group Restrictions.**

[END OF TABLE 6 REQUIREMENTS]

63.6640(b) [NA – NOT SUBJECT TO EMISSION OR OPERATING LIMITATIONS]

63.6640(c) [NA – ANNUAL COMPLIANCE DEMONSTRATION NOT REQUIRED]

63.6640(d) [NA – NOT SUBJECT TO EMISSION OR OPERATING LIMITATIONS]

63.6640(e) You must also report each instance in which you did not meet the requirements in Table 8 to this subpart that apply to you. If you own or operate a new or reconstructed stationary RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions (except new or reconstructed 4SLB engines greater than or equal to 250 and less than or equal to 500 brake HP), a new or reconstructed stationary RICE located at an area source of HAP emissions, or any of the following RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions, you do not need to comply with the requirements in Table 8 to this subpart: An existing 2SLB stationary RICE, an existing 4SLB stationary RICE, an existing emergency stationary RICE, an existing limited use stationary RICE, or an existing stationary RICE which fires landfill gas or digester gas equivalent to 10 percent or more of the gross heat input on an annual basis. If you own or operate any of the following RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions, you do not need to comply with the requirements in Table 8 to this subpart, except for the initial notification requirements: a new or reconstructed stationary RICE that combusts landfill gas or digester gas equivalent to 10 percent or more of the gross heat input on an annual basis, a new or reconstructed emergency stationary RICE, or a new or reconstructed limited use stationary RICE. [EXISTING EMERGENCY RICE AT AREA HAP SOURCES ARE NOT AMONG THOSE EXEMPTED FROM THIS SECTION]

63.6640(f) If you own or operate an emergency stationary RICE, you must operate the emergency stationary RICE according to the requirements in paragraphs (f)(1) through (4) of this section. In order for the engine to be considered an emergency stationary RICE under this subpart, any operation other than emergency operation, maintenance and testing, emergency demand response, and operation in non-emergency situations for 50 hours per year, as described in paragraphs (f)(1) through (4) of this section, is prohibited. If you do not operate the engine according to the requirements in paragraphs (f)(1) through (4) of this section, the engine will not be considered an emergency engine under this subpart and must meet all requirements for non-emergency engines.

63.6640(f)(1) There is no time limit on the use of emergency stationary RICE in emergency situations.

63.6640(f)(2) You may operate your emergency stationary RICE for any combination of the purposes specified in paragraphs (f)(2)(i) through (iii) of this section for a maximum of 100 hours per calendar year. Any operation for nonemergency situations as allowed by paragraphs (f)(3) and (4) of this section counts as part of the 100 hours per calendar year allowed by this paragraph (f)(2).

63.6640(f)(2)(i) Emergency stationary RICE may be operated for maintenance checks and readiness testing, provided that the tests are recommended by federal, state or local government, the manufacturer, the vendor, the regional transmission organization or equivalent balancing authority and transmission operator, or the insurance company associated with the engine. The owner or operator may petition the Administrator for approval of additional hours to be used for maintenance checks and readiness testing, but a petition is not required if the owner or operator maintains records indicating that federal, state, or local standards require maintenance and testing of emergency RICE beyond 100 hours per calendar year.

63.6640(f)(2)(ii) - (iii) [Reserved]

63.6640(f)(3) [NA – NOT A MAJOR HAP SOURCE]

63.6640(f)(4) Emergency stationary RICE located at area sources of HAP may be operated for up to 50 hours per calendar year in non-emergency situations. The 50 hours of operation in non-emergency situations are counted as part of the 100 hours per calendar year for maintenance and testing and emergency demand response provided in paragraph (f)(2) of this section. Except as provided in paragraphs (f)(4)(i) and (ii) of this section, the 50 hours per year for nonemergency situations cannot be used for peak shaving or non-emergency demand response, or to generate income for a facility to an electric grid or otherwise supply power as part of a financial arrangement with another entity.

**SECTION E. Source Group Restrictions.**

63.6640(f)(4)(i) [NA - NOT USED FOR PEAK SHAVING OR NON-EMERGENCY DEMAND RESPONSE]

63.6640(f)(4)(ii) [NA - NO FINANCIAL ARRANGEMENT WITH ANOTHER ENTITY]

[69 FR 33506, June 15, 2004, as amended at 71 FR 20467, Apr. 20, 2006; 73 FR 3606, Jan. 18, 2008; 75 FR 9676, Mar. 3, 2010; 75 FR 51591, Aug. 20, 2010; 78 FR 6704, Jan. 30, 2013; 87 FR 48607, Aug. 10, 2022]

020 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6645]

Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines

What notifications must I submit and when?

63.6645(a) You must submit all of the notifications in § 63.7(b) and (c), 63.8(e), (f)(4) and (f)(6), 63.9(b) through (e), and (g) and (h) that apply to you by the dates specified if you own or operate any of the following;

63.6645(a)(1) [NA – NOT A MAJOR HAP SOURCE]

63.6645(a)(2) [NA - PER 63.6645(a)(5)]

63.6645(a)(3) [NA – NOT A MAJOR HAP SOURCE]

63.6645(a)(4) [NA – NOT A MAJOR HAP SOURCE]

63.6645(a)(5) This requirement does not apply if you own or operate an existing stationary RICE less than 100 HP, an existing stationary emergency RICE, or an existing stationary RICE that is not subject to any numerical emission standards.

63.6645(b) - (e) [NA – NOT A MAJOR HAP SOURCE]

63.6645(f) [NA – 63.6590(b) DOES NOT APPLY]

63.6645(g) [NA – PERFORMANCE TEST NOT REQUIRED]

63.6645(h) [NA – PERFORMANCE TEST NOT REQUIRED]

63.6645(i) [NA – EMERGENCY ENGINE]

[73 FR 3606, Jan. 18, 2008, as amended at 75 FR 9677, Mar. 3, 2010; 75 FR 51591, Aug. 20, 2010; 78 FR 6705, Jan. 30, 2013; 85 FR 73912, Nov. 19, 2020]

021 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6650]

Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines

What reports must I submit and when?

[NA - EXCEPT FOR FOOTNOTE 1 OF TABLE 2c, FACILITY IS NOT SUBJECT TO ANY REPORTING REQUIREMENTS IN TABLE 7]

022 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6655]

Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines

What records must I keep?

63.6655(a) [NA – NOT SUBJECT TO EMISSION OR OPERATING LIMITATIONS]

63.6655(b) [NA – NO CEMS OR CPMS]

63.6655(c) [NA – LFG NOT USED]

63.6655(d) [NA – NOT SUBJECT TO EMISSION OR OPERATING LIMITATIONS]

63.6655(e) You must keep records of the maintenance conducted on the stationary RICE in order to demonstrate that you

**SECTION E. Source Group Restrictions.**

operated and maintained the stationary RICE and after-treatment control device (if any) according to your own maintenance plan if you own or operate any of the following stationary RICE;

63.6655(e)(1) [NA – NOT A MAJOR HAP SOURCE]

63.6655(e)(2) An existing stationary emergency RICE.

63.6655(e)(3) An existing stationary RICE located at an area source of HAP emissions subject to management practices as shown in Table 2d to this subpart.

63.6655(f) If you own or operate any of the stationary RICE in paragraphs (f)(1) through (2) of this section, you must keep records of the hours of operation of the engine that is recorded through the non-resettable hour meter. The owner or operator must document how many hours are spent for emergency operation, including what classified the operation as emergency and how many hours are spent for non-emergency operation. If the engine is used for the purposes specified in § 63.6640(f)(2)(ii) or (iii) or § 63.6640(f)(4)(ii), the owner or operator must keep records of the notification of the emergency situation, and the date, start time, and end time of engine operation for these purposes.

63.6655(f)(1) [NA – NOT A MAJOR HAP SOURCE]

63.6655(f)(2) An existing emergency stationary RICE located at an area source of HAP emissions that does not meet the standards applicable to non-emergency engines.

[69 FR 33506, June 15, 2004, as amended at 75 FR 9678, Mar. 3, 2010; 75 FR 51592, Aug. 20, 2010; 78 FR 6706, Jan. 30, 2013; 87 FR 48607, Aug. 10, 2022]

023 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6660]

Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines

In what form and how long must I keep my records?

63.6660(a) Your records must be in a form suitable and readily available for expeditious review according to § 63.10(b)(1).

63.6660(b) As specified in § 63.10(b)(1), you must keep each record for 5 years following the date of each occurrence, measurement, maintenance, corrective action, report, or record.

63.6660(c) You must keep each record readily accessible in hard copy or electronic form for at least 5 years after the date of each occurrence, measurement, maintenance, corrective action, report, or record, according to § 63.10(b)(1).

[69 FR page 33506, June 15, 2004, as amended at 75 FR page 9678, Mar. 3, 2010]

024 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6665]

Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines

What parts of the General Provisions apply to me?

Table 8 to this subpart shows which parts of the General Provisions in § 63.1 through 63.15 apply to you. If you own or operate a new or reconstructed stationary RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions (except new or reconstructed 4SLB engines greater than or equal to 250 and less than or equal to 500 brake HP), a new or reconstructed stationary RICE located at an area source of HAP emissions, or any of the following RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions, you do not need to comply with any of the requirements of the General Provisions specified in Table 8: An existing 2SLB stationary RICE, an existing 4SLB stationary RICE, an existing stationary RICE that combusts landfill or digester gas equivalent to 10 percent or more of the gross heat input on an annual basis, an existing emergency stationary RICE, or an existing limited use stationary RICE. If you own or operate any of the following RICE with a site rating of more than 500 brake HP located at a major source of HAP emissions, you do not need to comply with the requirements in the General Provisions specified in Table 8 except for the initial notification requirements: A new stationary RICE that combusts landfill gas or digester gas equivalent to 10 percent or more of the gross heat input on an annual basis, a new emergency stationary RICE, or a new limited use stationary RICE.

[EXCEPT PER 63.6645(a)(5), THE FOLLOWING DO NOT APPLY: 63.7(b) AND (c), 63.8(e), (f)(4) AND (f)(6), AND 63.9(b)-(e), (g) AND (h)]



SECTION E. Source Group Restrictions.

[75 FR page 9678, Mar. 3, 2010]

**SECTION E. Source Group Restrictions.**

Group Name: SG04

Group Description: 40 CFR 60, Subpart III Engine(s)

Sources included in this group

ID	Name
111A	NEW EMERGENCY GENERATOR ENGINES

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.**# 001 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

Regulatory Changes

Individual sources within this source group that are subject to 40 CFR Part 60 Subpart III shall comply with all applicable requirements of the Subpart. 40 CFR 60.4 requires submission of copies of all requests, reports and other communications to both the Department and the EPA. The EPA copies shall be forwarded to:

Associate Director
 United States Environmental Protection Agency
 Region III, Enforcement & Compliance Assurance Division
 Air, RCRA and Toxics Branch (3ED21)
 Four Penn Center
 1600 John F. Kennedy Boulevard
 Philadelphia, Pennsylvania 19103-2852

Unless otherwise approved by DEP, the DEP copies shall be reported through the Department's Greenport PUP system available through: <https://greenport.pa.gov/ePermitPublicAccess/PublicSubmission/Home>

In the event that the Federal Subpart that is the subject of this Source Group is revised, the permittee shall comply with the revised version of the subpart, and shall not be required to comply with any provisions in this permit designated as having

**SECTION E. Source Group Restrictions.**

the subpart as their authority, to the extent that such permit provisions would be inconsistent with the applicable provisions of the revised subpart.

002 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4200]**Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines****Am I subject to this subpart?**

60.4200(a) The provisions of this subpart are applicable to manufacturers, owners, and operators of stationary compression ignition (CI) internal combustion engines (ICE) and other persons as specified in paragraphs (a)(1) through (4) of this section. For the purposes of this subpart, the date that construction commences is the date the engine is ordered by the owner or operator.

60.4200(a)(1) [NA - NOT AN ENGINE MANUFACTURER]

60.4200(a)(2) Owners and operators of stationary CI ICE that commence construction after July 11, 2005, where the stationary CI ICE are:

60.4200(a)(2)(i) Manufactured after April 1, 2006, and are not fire pump engines, or

60.4200(a)(2)(ii) [NA - NOT A FIRE PUMP ENGINE]

60.4200(a)(3) [NA - NOT MODIFIED OR RECONSTRUCTED]

60.4200(a)(4) The provisions of § 60.4208 of this subpart are applicable to all owners and operators of stationary CI ICE that commence construction after July 11, 2005.

60.4200(b) [NA - TEST CELL NOT INVOLVED]

60.4200(c) If you are an owner or operator of an area source subject to this subpart, you are exempt from the obligation to obtain a permit under 40 CFR part 70 or 40 CFR part 71, provided you are not required to obtain a permit under 40 CFR 70.3(a) or 40 CFR 71.3(a) for a reason other than your status as an area source under this subpart. Notwithstanding the previous sentence, you must continue to comply with the provisions of this subpart applicable to area sources.

60.4200(d) Stationary CI ICE may be eligible for exemption from the requirements of this subpart as described in 40 CFR part 1068, subpart C, except that owners and operators, as well as manufacturers, may be eligible to request an exemption for national security.

60.4200(e) [NA - NOT A TEMPORARY REPLACEMENT UNIT]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37967, June 28, 2011; 86 FR 34357, June 29, 2021]

003 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4201]**Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines****What emission standards must I meet for non-emergency engines if I am a stationary CI internal combustion engine manufacturer?**

[NA - NOT AN ENGINE MANUFACTURER]

004 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4202]**Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines****What emission standards must I meet for emergency engines if I am a stationary CI internal combustion engine manufacturer?**

[NA - NOT AN ENGINE MANUFACTURER]

005 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4203]**Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines****How long must my engines meet the emission standards if I am a stationary CI internal combustion engine manufacturer?**

[NA - NOT AN ENGINE MANUFACTURER]

**SECTION E. Source Group Restrictions.**

**# 006 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4204]
Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines
What emission standards must I meet for non-emergency engines if I am an owner or operator of a stationary CI internal combustion engine?**

[NA - UNIT(S) ARE EMERGENCY]

**# 007 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4205]
Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines
What emission standards must I meet for emergency engines if I am an owner or operator of a stationary CI internal combustion engine?**

60.4205(a) [NA - ENGINES 2007 MODEL YEAR OR LATER]

60.4205(b) Owners and operators of 2007 model year and later emergency stationary CI ICE with a displacement of less than 30 liters per cylinder that are not fire pump engines must comply with the emission standards for new nonroad CI engines in § 60.4202, for all pollutants, for the same model year and maximum engine power for their 2007 model year and later emergency stationary CI ICE.

60.4202 REQUIREMENTS

60.4202(a) Stationary CI internal combustion engine manufacturers must certify their 2007 model year and later emergency stationary CI ICE with a maximum engine power less than or equal to 2,237 KW (3,000 HP) and a displacement of less than 10 liters per cylinder that are not fire pump engines to the emission standards specified in paragraphs (a)(1) through (2) of this section.

60.4202(a)(1) [NA - UNIT(S) > 37 KW (50 HP)]

60.4202(a)(2) For engines with a rated power greater than or equal to 37 KW (50 HP), the Tier 2 or Tier 3 emission standards for new nonroad CI engines for the same rated power as described in 40 CFR part 1039, appendix I, for all pollutants and the smoke standards as specified in 40 CFR 1039.105 beginning in model year 2007 [CONSTANT SPEED ENGINES NOT SUBJECT TO SMOKE STANDARDS PER 40 CFR 1039.105(a)(2)].

NOTE 1: 2006 MODEL YEAR STANDARDS FOR TIER 2 ENGINES WHERE THE KW>560 ARE AS FOLLOWS:

NMHC + NOX: 6.4 g/kW-hr

CO: 3.5 g/kW-hr

PM: 0.20 g/kW-hr

FROM 89.113

(a) Exhaust opacity from compression-ignition nonroad engines for which this subpart is applicable must not exceed:

- (1) 20 percent during the acceleration mode;
- (2) 15 percent during the lugging mode; and
- (3) 50 percent during the peaks in either the acceleration or lugging modes.

END OF 60.4202 REQUIREMENTS

60.4205(c) [NA - NOT FIRE PUMP ENGINES]

60.4205(d) [NA - UNITS < 30 L/CYL]

60.4205(e) [NA - DOES NOT CONDUCT PERFORMANCE TESTS IN USE]

60.4205(f) [NA - NOT MODIFIED OR RECONSTRUCTED]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011; 86 FR 34358, June 29, 2021]

**# 008 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4206]
Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines
How long must I meet the emission standards if I am an owner or operator of a stationary CI internal combustion engine?**

**SECTION E. Source Group Restrictions.**

Owners and operators of stationary CI ICE must operate and maintain stationary CI ICE that achieve the emission standards as required in § § 60.4204 and 60.4205 over the entire life of the engine.

[76 FR page 37969, June 28, 2011]

009 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4207]

Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines

What fuel requirements must I meet if I am an owner or operator of a stationary CI internal combustion engine subject to this subpart?

60.4207(a) [Reserved]

60.4207(b) Beginning October 1, 2010, owners and operators of stationary CI ICE subject to this subpart with a displacement of less than 30 liters per cylinder that use diesel fuel must use diesel fuel that meets the requirements of 40 CFR 1090.305 for nonroad diesel fuel, except that any existing diesel fuel purchased (or otherwise obtained) prior to October 1, 2010, may be used until depleted.

§1090.305: ULSD standards:

- (a) Overview. Except as specified in § 1090.300(a), diesel fuel must meet the ULSD per-gallon standards of this section.
- (b) Sulfur content. Maximum sulfur content of 15 ppm.
- (c) Cetane index or aromatic content. Diesel fuel must meet one of the following standards:
 - (1) Minimum cetane index of 40;
 - (2) Maximum aromatic content of 35 volume percent.

60.4207(c) [RESERVED]

60.4207(d) [NA - UNITS < 30 L/CYL]

60.4207(e) [NA - NO NATIONAL SECURITY EXEMPTION]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011; 78 FR 6695, Jan. 30, 2013; 85 FR 78463, Dec. 4, 2020]

010 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4208]

Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines

What is the deadline for importing or installing stationary CI ICE produced in the previous model year?

60.4208(a) After December 31, 2008, owners and operators may not install stationary CI ICE (excluding fire pump engines) that do not meet the applicable requirements for 2007 model year engines.

60.4208(b) [NA - UNITS >25 HP AND NOT FIRE PUMP ENGINE]

60.4208(c)-(g) [NA - NO NON-EMERGENCY UNITS]

60.4208(h) [NA - IMPORTATION NOT RELEVANT IN THIS CASE]

60.4208(i) The requirements of this section do not apply to owners or operators of stationary CI ICE that have been modified, reconstructed, and do not apply to engines that were removed from one existing location and reinstalled at a new location.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011]

011 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4209]

Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines

What are the monitoring requirements if I am an owner or operator of a stationary CI internal combustion engine?

If you are an owner or operator, you must meet the monitoring requirements of this section. In addition, you must also meet the monitoring requirements specified in § 60.4211.

60.4209(a) If you are an owner or operator of an emergency stationary CI internal combustion engine that does not meet the standards applicable to non-emergency engines, you must install a non-resettable hour meter prior to startup of the

**SECTION E. Source Group Restrictions.**

engine.

60.4209(b) [NA - FILTER NOT INSTALLED TO COMPLY WITH REGULATION]

[Amended at 76 FR page 37969, June 28, 2011]

012 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4210]

Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines

What are my compliance requirements if I am a stationary CI internal combustion engine manufacturer?

[NA - NOT AN ENGINE MANUFACTURER]

013 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4211]

Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines

What are my compliance requirements if I am an owner or operator of a stationary CI internal combustion engine?

60.4211(a) If you are an owner or operator and must comply with the emission standards specified in this subpart, you must do all of the following, except as permitted under paragraph (g) of this section:

60.4211(a)(1) Operate and maintain the stationary CI internal combustion engine and control device according to the manufacturer's emission-related written instructions;

60.4211(a)(2) Change only those emission-related settings that are permitted by the manufacturer; and

60.4211(a)(3) Meet the requirements of 40 CFR part 1068, as they apply to you.

60.4211(b) [NA - ENGINES ARE 2007 MODEL YEAR OR LATER]

60.4211(c) If you are an owner or operator of a 2007 model year and later stationary CI internal combustion engine and must comply with the emission standards specified in § 60.4204(b) or § 60.4205(b), or if you are an owner or operator of a CI fire pump engine that is manufactured during or after the model year that applies to your fire pump engine power rating in table 3 to this subpart and must comply with the emission standards specified in § 60.4205(c), you must comply by purchasing an engine certified to the emission standards in § 60.4204(b), or § 60.4205(b) or (c), as applicable, for the same model year and maximum (or in the case of fire pumps, NFPA nameplate) engine power. The engine must be installed and configured according to the manufacturer's emission-related specifications, except as permitted in paragraph (g) of this section.

60.4211(d) [NA - NOT SUBJECT TO § 60.4204(c) OR § 60.4205(d)]

60.4211(e) [NA - NOT MODIFIED OR RECONSTRUCTED]

60.4211(f) If you own or operate an emergency stationary ICE, you must operate the emergency stationary ICE according to the requirements in paragraphs (f)(1) through (3) of this section. In order for the engine to be considered an emergency stationary ICE under this subpart, any operation other than emergency operation, maintenance and testing, and operation in non-emergency situations for 50 hours per year, as described in paragraphs (f)(1) through (3), is prohibited. If you do not operate the engine according to the requirements in paragraphs (f)(1) through (3), the engine will not be considered an emergency engine under this subpart and must meet all requirements for non-emergency engines.

60.4211(f)(1) There is no time limit on the use of emergency stationary ICE in emergency situations.

60.4211(f)(2) You may operate your emergency stationary ICE for the purpose specified in paragraph (f)(2)(i) of this section for a maximum of 100 hours per calendar year. Any operation for non-emergency situations as allowed by paragraph (f)(3) of this section counts as part of the 100 hours per calendar year allowed by this paragraph (f)(2).

60.4211(f)(2)(i) Emergency stationary ICE may be operated for maintenance checks and readiness testing, provided that the tests are recommended by federal, state or local government, the manufacturer, the vendor, the regional transmission organization or equivalent balancing authority and transmission operator, or the insurance company associated with the engine. The owner or operator may petition the Administrator for approval of additional hours to be used for maintenance checks and readiness testing, but a petition is not required if the owner or operator maintains records indicating that federal, state, or local standards require maintenance and testing of emergency ICE beyond 100 hours per

**SECTION E. Source Group Restrictions.**

calendar year.

60.4211(f)(2)(ii) - (iii) [RESERVED]

60.4211(f)(3) Emergency stationary ICE may be operated for up to 50 hours per calendar year in non-emergency situations. The 50 hours of operation in non-emergency situations are counted as part of the 100 hours per calendar year for maintenance and testing provided in paragraph (f)(2) of this section. Except as provided in paragraph (f)(3)(i) of this section, the 50 hours per calendar year for non-emergency situations cannot be used for peak shaving or non-emergency demand response, or to generate income for a facility to an electric grid or otherwise supply power as part of a financial arrangement with another entity.

60.4211(f)(3)(i) The 50 hours per year for non-emergency situations can be used to supply power as part of a financial arrangement with another entity if all of the following conditions are met:

60.4211(f)(3)(i)(A) The engine is dispatched by the local balancing authority or local transmission and distribution system operator;

60.4211(f)(3)(i)(B) The dispatch is intended to mitigate local transmission and/or distribution limitations so as to avert potential voltage collapse or line overloads that could lead to the interruption of power supply in a local area or region.

60.4211(f)(3)(i)(C) The dispatch follows reliability, emergency operation or similar protocols that follow specific NERC, regional, state, public utility commission or local standards or guidelines.

60.4211(f)(3)(i)(D) The power is provided only to the facility itself or to support the local transmission and distribution system.

60.4211(f)(3)(i)(E) The owner or operator identifies and records the entity that dispatches the engine and the specific NERC, regional, state, public utility commission or local standards or guidelines that are being followed for dispatching the engine. The local balancing authority or local transmission and distribution system operator may keep these records on behalf of the engine owner or operator.

60.4211(f)(3)(ii) [Reserved]

60.4211(g) If you do not install, configure, operate, and maintain your engine and control device according to the manufacturer's emission-related written instructions, or you change emission-related settings in a way that is not permitted by the manufacturer, you must demonstrate compliance as follows:

60.4211(g)(1) [NA - ENGINES >100 HP]

60.4211(g)(2) [NA - ENGINES >500 HP]

60.4211(g)(3) If you are an owner or operator of a stationary CI internal combustion engine greater than 500 HP, you must keep a maintenance plan and records of conducted maintenance and must, to the extent practicable, maintain and operate the engine in a manner consistent with good air pollution control practice for minimizing emissions. In addition, you must conduct an initial performance test to demonstrate compliance with the applicable emission standards within 1 year of startup, or within 1 year after an engine and control device is no longer installed, configured, operated, and maintained in accordance with the manufacturer's emission-related written instructions, or within 1 year after you change emission-related settings in a way that is not permitted by the manufacturer. You must conduct subsequent performance testing every 8,760 hours of engine operation or 3 years, whichever comes first, thereafter to demonstrate compliance with the applicable emission standards

60.4211(h) The requirements for operators and prohibited acts specified in 40 CFR 1039.665 apply to owners or operators of stationary CI ICE equipped with AECDs for qualified emergency situations as allowed by 40 CFR 1039.665.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37970, June 28, 2011; 78 FR 6695, Jan. 30, 2013; 81 FR 44219, July 7, 2016; 86 FR 34359, June 29, 2021; 87 FR 48605, Aug. 10, 2022]

**SECTION E. Source Group Restrictions.**

**# 014 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4212]
Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines
What test methods and other procedures must I use if I am an owner or operator of a stationary CI internal combustion engine with a displacement of less than 30 liters per cylinder?**

[NA - TESTING NOT REQUIRED FOR CERTIFIED UNITS WHICH ARE NOT ALTERED PER 60.4211(g)]

**# 015 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4213]
Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines
What test methods and other procedures must I use if I am an owner or operator of a stationary CI internal combustion engine with a displacement of greater than or equal to 30 liters per cylinder?**

[NA - DISPLACEMENT <30 L/CYL]

**# 016 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4214]
Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines
What are my notification, reporting, and recordkeeping requirements if I am an owner or operator of a stationary CI internal combustion engine?**

60.4214(a) [NA - UNITS ARE EMERGENCY]

60.4214(b) If the stationary CI internal combustion engine is an emergency stationary internal combustion engine, the owner or operator is not required to submit an initial notification. Starting with the model years in table 5 to this subpart, if the emergency engine does not meet the standards applicable to non-emergency engines in the applicable model year, the owner or operator must keep records of the operation of the engine in emergency and non-emergency service that are recorded through the non-resettable hour meter. The owner must record the time of operation of the engine and the reason the engine was in operation during that time.

60.4214(c) [NA - NOT REQUIRED TO HAVE A DIESEL PARTICULATE FILTER]

60.4214(d) [NA - ENGINES DO NOT OPERATE FOR THE PURPOSE SPECIFIED IN § 60.4211(f)(3) (NO FINANCIAL ARRANGEMENT WITH ANOTHER ENTITY)]

60.4214(e) Owners or operators of stationary CI ICE equipped with AECDs pursuant to the requirements of 40 CFR 1039.665 must report the use of AECDs as required by 40 CFR 1039.665(e).

60.4214(f) [NA - NOT REQUIRED TO CONDUCT PERFORMANCE TESTING]

60.4214(g) If you are required to submit notifications or reports following the procedure specified in this paragraph (g), you must submit notifications or reports to the EPA via the Compliance and Emissions Data Reporting Interface (CEDRI), which can be accessed through the EPA's Central Data Exchange (CDX) (<https://cdx.epa.gov>). The EPA will make all the information submitted through CEDRI available to the public without further notice to you. Do not use CEDRI to submit information you claim as CBI. Although we do not expect persons to assert a claim of CBI, if you wish to assert a CBI claim for some of the information in the report or notification, you must submit a complete file in the format specified in this subpart, including information claimed to be CBI, to the EPA following the procedures in paragraphs (g)(1) and (2) of this section. Clearly mark the part or all of the information that you claim to be CBI. Information not marked as CBI may be authorized for public release without prior notice. Information marked as CBI will not be disclosed except in accordance with procedures set forth in 40 CFR part 2. All CBI claims must be asserted at the time of submission. Anything submitted using CEDRI cannot later be claimed CBI. Furthermore, under CAA section 114(c), emissions data is not entitled to confidential treatment, and the EPA is required to make emissions data available to the public. Thus, emissions data will not be protected as CBI and will be made publicly available. You must submit the same file submitted to the CBI office with the CBI omitted to the EPA via the EPA's CDX as described earlier in this paragraph (g).

60.4214(g)(1) The preferred method to receive CBI is for it to be transmitted electronically using email attachments, File Transfer Protocol, or other online file sharing services. Electronic submissions must be transmitted directly to the OAQPS CBI Office at the email address oaqpscbi@epa.gov, and as described in paragraph (g) of this section, should include clear CBI markings. ERT files should be flagged to the attention of the Group Leader, Measurement Policy Group; all other files should be flagged to the attention of the Stationary Compression Ignition Internal Combustion Engine Sector Lead. If assistance is needed with submitting large electronic files that exceed the file size limit for email attachments, and if you do not have your own file sharing service, please email oaqpscbi@epa.gov to request a file transfer link.

**SECTION E. Source Group Restrictions.**

60.4214(g)(2) If you cannot transmit the file electronically, you may send CBI information through the postal service to the following address: OAQPS Document Control Officer (C404-02), OAQPS, U.S. Environmental Protection Agency, 109 T.W. Alexander Drive, P.O. Box 12055, Research Triangle Park, North Carolina 27711. ERT files should be sent to the attention of the Group Leader, Measurement Policy Group, and all other files should be sent to the attention of the Stationary Compression Ignition Internal Combustion Engine Sector Lead. The mailed CBI material should be double wrapped and clearly marked. Any CBI markings should not show through the outer envelope.

60.4214(h) If you are required to electronically submit a report through CEDRI in the EPA's CDX, you may assert a claim of EPA system outage for failure to timely comply with that reporting requirement. To assert a claim of EPA system outage, you must meet the requirements outlined in paragraphs (h)(1) through (7) of this section.

60.4214(h)(1) You must have been or will be precluded from accessing CEDRI and submitting a required report within the time prescribed due to an outage of either the EPA's CEDRI or CDX systems.

60.4214(h)(2) The outage must have occurred within the period of time beginning five business days prior to the date that the submission is due.

60.4214(h)(3) The outage may be planned or unplanned.

60.4214(h)(4) You must submit notification to the Administrator in writing as soon as possible following the date you first knew, or through due diligence should have known, that the event may cause or has caused a delay in reporting.

60.4214(h)(5) You must provide to the Administrator a written description identifying:

60.4214(h)(5)(i) The date(s) and time(s) when CDX or CEDRI was accessed and the system was unavailable;

60.4214(h)(5)(ii) A rationale for attributing the delay in reporting beyond the regulatory deadline to EPA system outage;

60.4214(h)(5)(iii) A description of measures taken or to be taken to minimize the delay in reporting; and (iv) The date by which you propose to report, or if you have already met the reporting requirement at the time of the notification, the date you reported.

60.4214(h)(6) The decision to accept the claim of EPA system outage and allow an extension to the reporting deadline is solely within the discretion of the Administrator.

60.4214(h)(7) In any circumstance, the report must be submitted electronically as soon as possible after the outage is resolved.

60.4214(i) If you are required to electronically submit a report through CEDRI in the EPA's CDX, you may assert a claim of force majeure for failure to timely comply with that reporting requirement. To assert a claim of force majeure, you must meet the requirements outlined in paragraphs (i)(1) through (5) of this section.

60.4214(i)(1) You may submit a claim if a force majeure event is about to occur, occurs, or has occurred or there are lingering effects from such an event within the period of time beginning five business days prior to the date the submission is due. For the purposes of this section, a force majeure event is defined as an event that will be or has been caused by circumstances beyond the control of the affected facility, its contractors, or any entity controlled by the affected facility that prevents you from complying with the requirement to submit a report electronically within the time period prescribed. Examples of such events are acts of nature (e.g., hurricanes, earthquakes, or floods), acts of war or terrorism, or equipment failure or safety hazard beyond the control of the affected facility (e.g., large scale power outage).

60.4214(i)(2) You must submit notification to the Administrator in writing as soon as possible following the date you first knew, or through due diligence should have known, that the event may cause or has caused a delay in reporting.

60.4214(i)(3) You must provide to the Administrator:

60.4214(i)(3)(i) A written description of the force majeure event;

**SECTION E. Source Group Restrictions.**

60.4214(i)(3)(ii) A rationale for attributing the delay in reporting beyond the regulatory deadline to the force majeure event;

60.4214(i)(3)(iii) A description of measures taken or to be taken to minimize the delay in reporting; and

60.4214(i)(3)(iv) The date by which you propose to report, or if you have already met the reporting requirement at the time of the notification, the date you reported.

60.4214(i)(4) The decision to accept the claim of force majeure and allow an extension to the reporting deadline is solely within the discretion of the Administrator.

60.4214(i)(5) In any circumstance, the reporting must occur as soon as possible after the force majeure event occurs.

60.4214(j) Any records required to be maintained by this subpart that are submitted electronically via the EPA's CEDRI may be maintained in electronic format. This ability to maintain electronic copies does not affect the requirement for facilities to make records, data, and reports available upon request to a delegated air agency or the EPA as part of an on-site compliance evaluation.

[71 FR 39172, July 11, 2006, as amended at 78 FR 6696, Jan. 30, 2013; 81 FR 44219, July 7, 2016; 87 FR 48606, Aug. 10, 2022; 89 FR 70512, Aug. 30, 2024]

017 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4218]

Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines

What parts of the General Provisions apply to me?

60.4218(a) Table 8 to this subpart shows which parts of the General Provisions in §§ 60.1 through 60.19 apply to you.

60.4218(b) The provisions of 40 CFR 1068.10 and 1068.11 apply for engine manufacturers. For others, the general confidential business information (CBI) provisions apply as described in 40 CFR part 2.

[88 FR 4471, Jan. 24, 2023]



SECTION F. Alternative Operation Requirements.

No Alternative Operations exist for this State Only facility.



SECTION G. Emission Restriction Summary.

No emission restrictions listed in this section of the permit.

**SECTION H. Miscellaneous.**

#001

This facility is located behind the Berks County Fire Training Center at 895 Morgantown Road, Reading, PA.

#002

This permit includes the sources & conditions of State-Only Operating Permit No. 06-03102, issued on 9/26/23, & Plan Approval No. 06-03102B. This permit supersedes those permits.

#003

Source ID 101, Primary Clarification, includes the following equipment and controlled by wet scrubbers (C01 & C02):

- four primary settling tanks (clarifiers)
- one primary distribution box

#004

Source ID 102, Sludge Digestion, includes the following equipment and controlled by an enclosed flare (C04):

- five anaerobic digesters with sludge heaters/heat exchangers

#005

Source ID 103, Solids Holding Tanks, includes the following equipment and controlled by a carbon adsorption system (C05A):

- sludge blend tank
- digested sludge holding tank
- filtrate/centrate pumping station

#006

Source ID 104, Solids Handling Building, includes the following equipment and controlled by a carbon adsorption system (C05A):

- two dewatering centrifuges
- two gravity belt thickeners
- one scum concentrator

#007

Source ID 109, Influent Junction Box, includes the following equipment and controlled by a dry media scrubber (C09):

- influent junction box
- air mixing system

#008

Source ID 111, 2005 Emergency Generator Engines, consists of the following diesel fired generators at the following location::

- 540 hP - Post Aeration Blower Building
- 540 hP - Transfer Pump Station

The emergency generators are trailer mounted units manufactured in 2005, however they are maintained as stationary sources.


#009

Source ID 111A, New Emergency Generator Engines, consists of the following diesel fired generators at the following location:

- 1350 hP - Blower Building Generator No. 1
- 1350 hP - Blower Building Generator No. 2
- 680 hP - RAS/WAS Pump Station
- 810 hP - Effluent Substation Building
- 1080 hP - Solids Area Substation Building
- 1350 hP - Solids Handling Building
- 680 hP - Administration Building

#010

This is Revision No.1 of the facility's State-Only Operating Permit issued on 9/26/23. This revision incorporates Plan Approval No. 06-03102B.



***** End of Report *****
